

## Evaluation Report “S” Deck Metal Wall Assembly

### Manufacturer:

**Berridge Manufacturing Company**

**1720 Maury Road  
Houston, TX 77026  
(800) 231-8127**

*for*

**Florida Product Approval**

**# FL 14669.6 R5**

**Florida Building Code 8th Edition (2023)**

**Method: 1 - D**

**Category: Structural Components**

**Sub - Category: Structural Wall**

**Product: “S” Deck Wall Panel**

**Material: Steel**


### Prepared by:

James L. Buckner, P.E., S.E.C.B.  
Florida Professional Engineer # 31242  
Florida Evaluation ANE ID: 1916  
Project Manager: Diana Galloway  
Report No. 23-542- S-SG-ER  
(Revises 20-227-S-SG-ER, FL14669.6 R4)  
Date: 09/26/2023

### Contents:

Evaluation Report                      Pages 1 – 8

This item has been digitally signed and sealed by James L. Buckner, P.E., on this date below. Printed copies of this document are not considered signed and sealed, and the signature must be verified on any electronic copies.

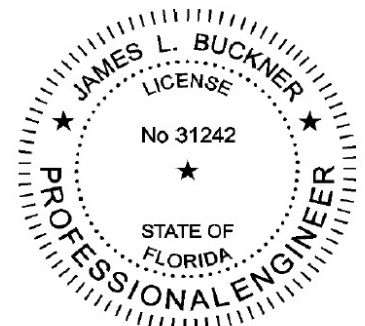

James L. Buckner, P.E.  
FL31242

Date: 2023.09.26 15:25:27  
-04'00

<b>Manufacturer:</b>	<b>Berridge Manufacturing Company</b> 1720 Maury Road Houston, TX 77026 (800) 231-8127 <a href="http://www.berridge.com">www.berridge.com</a>
<b>Product Name:</b>	<b>“S” Deck”</b>
<b>Product Category:</b>	Structural Components
<b>Product Sub-Category</b>	Structural Wall
<b>Compliance Method:</b>	State Product Approval Rule 61G20-3.005 (1) (d)
<b>Product/System Description:</b>	“S” Deck (Straight “S” Deck or Curved “S” Deck) Wall Panel Steel lapped wall panel fastened into structural Steel Supports.
<b>Product Assembly as Evaluated:</b>	Refer to Page 4 of this report for product assembly components/materials & standards:  <ol style="list-style-type: none"><li>1. Wall Panel</li><li>2. Fasteners</li></ol>
<b>Support:</b>	<b>Type:</b> Steel Supports (Design of steel support and its attachment to support framing is outside the scope of this evaluation.)  <b>Description:</b> Material: Steel Thickness: 16 Gauge minimum Yield Strength: 50 ksi minimum Girt/Stud Size: 2” min. flange bearing
<b>Performance:</b>	Wind Resistance: <ul style="list-style-type: none"><li>• Design Pressure: <b>Refer to Table A</b> (Refer to “Table A” attachment details herein)</li></ul>

- Performance Standards:** The product described herein has demonstrated compliance with:
- **ASTM E 1592-05 (2017)** – *Test Method for Structural Performance of Sheet Metal Roof and Siding Systems By Uniform Static Air Pressure Difference*
- Standards Equivalency:** The ASTM E 1592-01 standard version used to test the product meets the prescribed standards in ASTM E 1592-05 (2017) standard version adopted by the Florida Building Code 8th Edition (2023) for use as evaluated in this report.
- Code Compliance:** The product(s) described herein have demonstrated compliance with the performance standards listed above as referenced in the Florida Building Code 8<sup>th</sup> Edition (2023).
- Evaluation Report Scope:** This product evaluation is limited to compliance with the structural requirements of the Florida Building Code, as related to the scope section to Florida Product Approval Rule 61G20-3.001.
- Limitations and Conditions of Use:**
- Arch Minimum Radius for Curved Panel is 60" (5'- 0").
  - Diaphragm and axial load capacity is outside the scope of this evaluation.
  - Scope of "Limitations and Conditions of Use" for this evaluation:  
This evaluation report for "Optional Statewide Approval" contains technical documentation, specifications and installation method(s) which include "Limitations and Conditions of Use" throughout the report in accordance with Rule 61G20-3.005. Per Rule 61G20-3.004, the Florida Building Commission is the authority to approve products under "Optional Statewide Approval".
  - Option for application outside "Limitations and Conditions of Use"  
Rule 61G20-3.005(1)(e) allows engineering analysis for "project specific approval by the local authorities having jurisdiction in accordance with the alternate methods and materials authorized in the Code". Any modification of the product as evaluated in this report and approved by the Florida Building Commission is outside the scope of this evaluation and will be the responsibility of others.
  - This report is a building code product evaluation per FLPE rule (FAC) 61G15-36 to comply with Florida product approval rule (FAC) 61G20-3. This evaluation report is part of the Florida Building Commission approval for the listed code related criteria. This report by James Buckner, P.E. and CBUG Engineering is not a design certification of code compliance construction submittal documentation, per FBC section 107, for any individual structure, site specific or permit design.
  - All metal components and fasteners shall be corrosion resistant in accordance with applicable sections of FBC.
  - Design of support system is outside the scope of this report. Support shall be designed by others and shall comply with the FBC Chapters 22 for steel and Chapter 16 for structural loading.
  - Fire Classification is outside the scope of Rule 61G20-3, and is therefore not included in this evaluation.
  - Design of support system is outside the scope of this report. Support shall be designed by others and shall comply with the FBC Chapters 22 for steel and

Chapter 16 for structural loading.

- Fire Classification is outside the scope of Rule 61G20-3, and is therefore not included in this evaluation.
- This evaluation report does not evaluate the use of this product for use in the High Velocity Hurricane Zone code section. (Dade & Broward Counties)

**Quality Assurance:**

The manufacturer has demonstrated compliance of wall panel products in accordance with the Florida Building Code and Rule 61G20-3.0005 (3) for manufacturing under a quality assurance program audited by an approved quality assurance entity through **UL, LLC (FBC Organization #: QUA 9625)**.

**Components/Materials  
(by Manufacturer):**

**Wall Panel:** Berridge “S” Deck”  
Material: Steel  
Thickness: 24 Gauge  
Panel Width: 31.5” Coverage  
Rib Height: 7/8”  
Yield Strength: 40 ksi min.  
Steel Grade: 40  
Corrosion Resistance: In compliance with FBC Section 1405.2

**Fastener:**

FASTENER 1: Panel to Support  
Type: Hex-Head Sheet Metal Screw with WSW  
Size: #12 – 14 x 3/4”  
Corrosion Resistance: Per FBC Section 1405.17  
Standard: Approved per FBC Section 1405.17

FASTENER 2: Panel to Panel, Stitch Lap  
Type: Hex-Head Sheet Metal Screw with WSW  
Size : #12 – 14 x 1”  
Corrosion Resistance: Per FBC Section 1405.17  
Standard: Approved per FBC Section 1405.17

**Installation:**

**Installation Method:**

(Refer to **"TABLE A"** below and drawings at the end of this report.)

- Girt/Support Spacing: **Refer to Table A Below**
- Fastener spacing: **Refer to Table A Below**  
(along the girt, in the valley of panel corrugations)
- Side Lap Spacing: **Refer to Table A Below**  
(along the length of the side laps and within 3" from each end)
- Rib Interlock: Lapped
- Minimum fastener penetration thru support, 3/4".  
(through flange of steel supports)

<b>TABLE "A"</b>				
<b>ALLOWABLE LOADS</b>				
	<b>METHOD 1:</b>		<b>METHOD 2:</b>	
<b>Design Pressure:</b>	Positive:	Negative:	Positive:	Negative:
	<b>+ 78 PSF</b>	<b>- 78 PSF</b>	<b>+ 190 PSF</b>	<b>- 190 PSF</b>
Panel Type:	Straight or Curved "S" Deck			
Max. Support Spacing:	60" (5' - 0")		30" (2' - 6")	
Fastener Spacing:	8" (every 3 <sup>rd</sup> valley)		5-1/3" (every other valley)	
Side Lap Spacing:	12"		12"	
Span Condition:	3 or more		3 or more	
Notes: <ul style="list-style-type: none"> <li>• Positive Pressure Inward/Negative Pressure Outward</li> <li>• Allowable design pressure(s) for allowable stress design (ASD).</li> <li>• Fastener Attachment to Steel Supports May Be Designed By A Qualified Design Professional As Required By The Florida Building Code For Site Specific Projects.</li> <li>• Diaphragm and axial load capacity are not included in this evaluation.</li> </ul>				


Install the "S" Deck wall panel assembly in compliance with the installation method listed in this report and applicable code sections of FBC 8th Edition (2023). The installation method described herein is in accordance with the scope of this evaluation report. Refer to manufacturer's installation instructions as a supplemental guide for attachment.

**Referenced Data:**


1. TAS 125-03 Uplift Test (per ASTM E 1592-01)  
By Force Engineering & Testing Inc., Inc. (FBC Organization #TST ID:5328)
  - Report # 49-0007T-07 A-C, Report Date: 3/21/07  
Test Specimen(s) A,B,C (Method 1)
  - Report # 49-0007T-07 D, Report Date: 3/21/07  
Test Specimen(s) D (Method 2)
2. Engineering Analysis  
By CBUCK Engineering
3. Equivalency of Test Standard Certification  
By James L. Buckner, P.E. @ CBUCK Engineering
4. Quality Assurance  
UL, LLC (FBC Organization #: QUA 9625)
5. Certification of Independence  
By James L. Buckner, P.E. @ CBUCK Engineering

## Installation Method Berridge Manufacturing Company "S" Deck" Steel Wall Panel attached to Steel Supports

### Profile Drawings

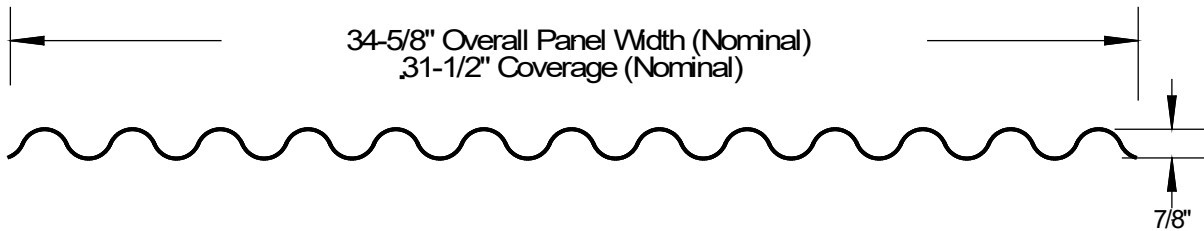


TYPICAL "S" Deck" PANEL  
PROFILE VIEW

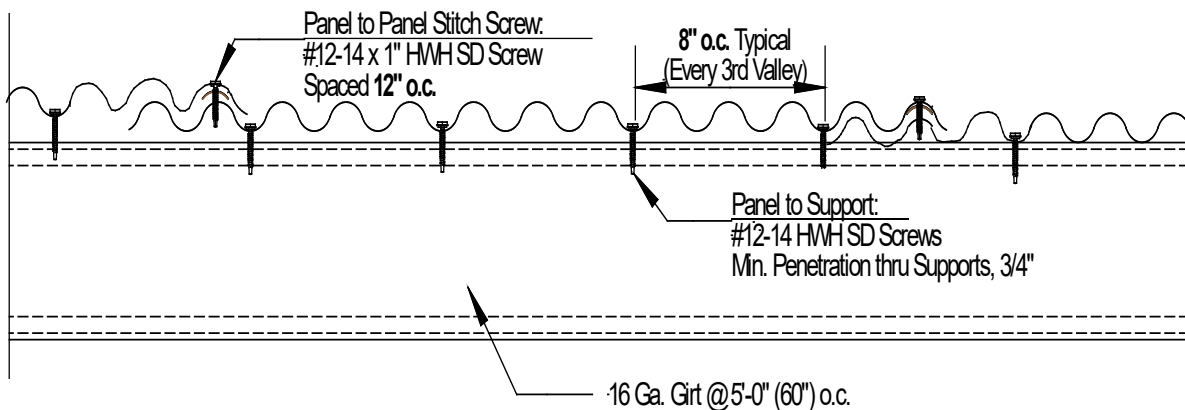

TYPICAL PANEL ASSEMBLY  
SECTION VIEW


## Installation Method Berridge Manufacturing Company "S" Deck" Steel Wall Panel attached to Steel Supports

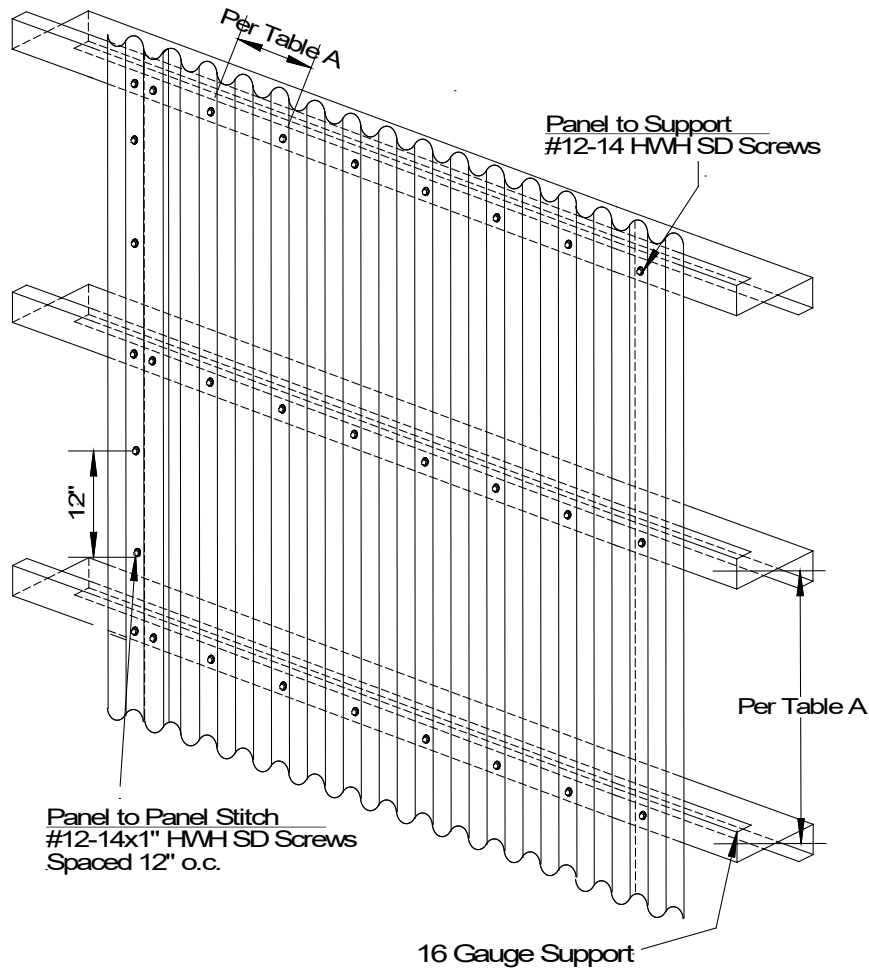

**STRAIGHT "S" DECK - TYPICAL ELEVATION VIEW  
 OUTSIDE OF WALL ASSEMBLY**

TABLE "A"				
	METHOD 1:		METHOD 2:	
	Positive:	Negative:	Positive:	Negative:
<b>Design Pressure:</b>	<b>+ 78 PSF</b>	<b>- 78 PSF</b>	<b>+ 190 PSF</b>	<b>- 190 PSF</b>
<b>Panel Type:</b>	Straight or Curved "S" Deck		Straight or Curved "S" Deck	
<b>Max. Support Spacing:</b>	60" (5' - 0")		30" (2' - 6")	
<b>Fastener Spacing:</b>	8" (every 3 <sup>rd</sup> valley)		5-1/3" (every other valley)	
<b>Side Lap Spacing:</b>	12"		12"	
<b>Span Condition:</b>	3 or more		3 or more	

## Installation Method Berridge Manufacturing Company "S" Deck" Steel Wall Panel attached to Steel Supports

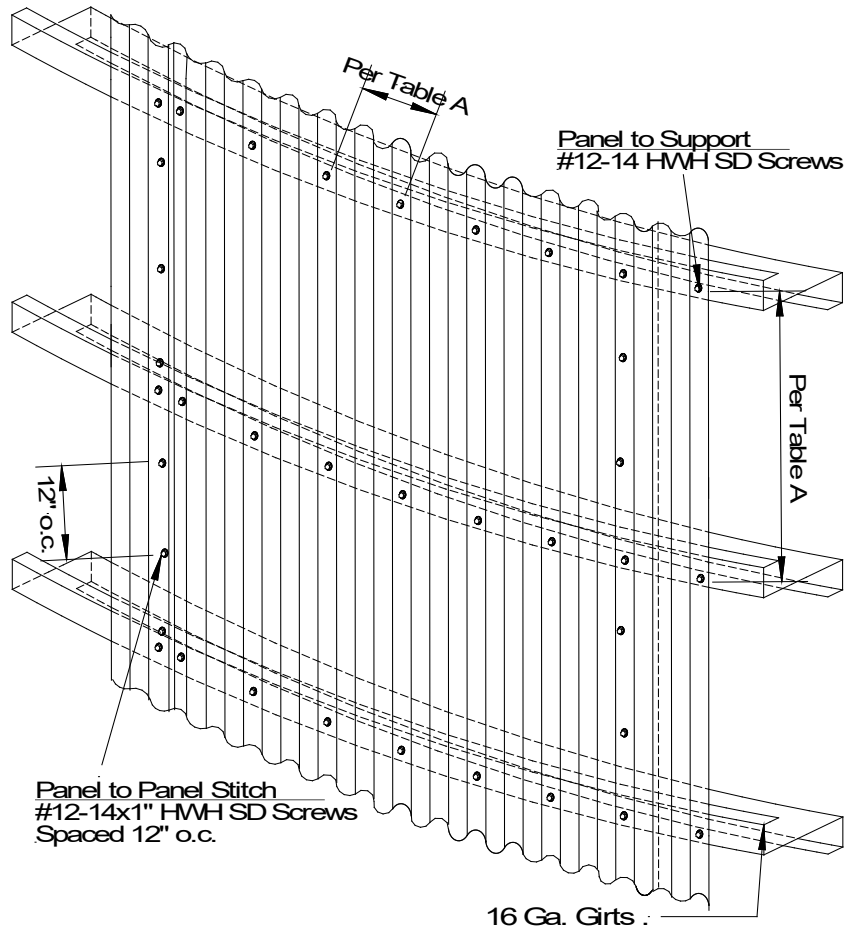

**CURVED "S" DECK - TYPICAL ELEVATION VIEW  
 OUTSIDE OF WALL ASSEMBLY**

TABLE "A"				
	METHOD 1:		METHOD 2:	
Design Pressure:	Positive:	Negative:	Positive:	Negative:
	+ 78 PSF	- 78 PSF	+ 190 PSF	- 190 PSF
Panel Type:	Straight or Curved "S" Deck		Straight or Curved "S" Deck	
Max. Support Spacing:	60" (5' - 0")		30" (2' - 6")	
Fastener Spacing:	8" (every 3 <sup>rd</sup> valley)		5-1/3" (every other valley)	
Side Lap Spacing:	12"		12"	
Span Condition:	3 or more		3 or more	