

R W Building Consultants, Inc.

Consulting and Engineering Services for the Building Industry

P.O. Box 230 Valrico, FL 33595 Phone 813.659.9197

Florida Board of Professional Engineers Registry License No. 9813

Product Evaluation Report Report No.: FL-15560.17 Date: December 9, 2020

Product Category	Sub Category	Manufacturer	Product Name
Exterior Doors	Sliding Exterior Door Assemblies	Fleetwood Windows and Doors 1 Fleetwood Way Corona, CA 92879 (951) 279-1070	Series 3070-HI Sliding Glass / Pocket Door "Impact"

Scope: Product Evaluation report issued by R W Building Consultants, Inc. & Lyndon F. Schmidt, P.E. (System ID # 1998) for Fleetwood Windows and Doors based on Rule Chapter No. 61G20-3, Method 1D of the State of Florida Product Approval, Department of Business & Professional Regulation.

RW Building Consultants and Lyndon F. Schmidt, P.E. do not have nor will acquire financial interest in the company manufacturing or distributing the product or in any other entity involved in the approval process of the product named herein.

Limitations:

1. This product has been evaluated and is in compliance with the 7th Edition (2020) Florida Building Code (FBC) structural requirements including the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in the "HVHZ" this product complies with Section 1626 of the Florida Building Code and does not require an impact resistant covering.
4. When used in areas outside of the "HVHZ" requiring wind borne debris protection, this product complies with FBC Sections 1609.1.2 & R301.2.1.2 and does not require an impact resistant covering. This product meets missile level "D" and includes Wind Zone 4 as defined in ASTM E 1996 and FBC Sections 1609.1.2.2 & R301.2.1.2.1.
5. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
6. Site conditions that deviate from the details of drawing FL-15560.17 require further engineering analysis by a licensed engineer or registered architect.
7. This product meets water infiltration requirements for "HVHZ".
8. Aluminum components, including fasteners, shall meet the requirements of FBC Section 2003.
9. Gaskets shall comply with FBC Section 2411.3.4.
10. See drawing FL-15560.17 for size and design pressure limitations.

Supporting Documents:

- | | | | |
|--|--|--|--|
| 1. Test Report No.
ATI E8391.03-301-18
ATI E8391.02-301-44
ATI E8391.01-301-44 | Test Standard
TAS 201, 202 & 203-94
ASTM E 1886-13a/E 1996-14a
AAMA/WDMA/CSA 101/I.S.2/A440-11 | Testing Laboratory
Architectural Testing, Inc.
Architectural Testing, Inc.
Architectural Testing, Inc. | Signed by
Tyler Westerling, P.E.
Tyler Westerling, P.E.
Tyler Westerling, P.E. |
|--|--|--|--|

- | | |
|--|--|
| 2. Miami-Dade NOA
20-0915.21 | Materials Testing
SentryGlas® Interlayer (Kuraray) |
|--|--|

- | | |
|--|---|
| 3. Materials Testing
Gaskets by Tremco | Test Standard
ASTM C 864 (Option II) per FBC 2411.3.4 |
|--|---|


- | | |
|--|---|
| 4. Drawing No.
No. FL-15560.17 | Prepared by
RW Building Consultants, Inc. (#9813) |
|--|---|

- | | |
|---|--|
| 5. Calculations
Anchoring
ASTM E 1300 Glass Load | Prepared by
RW Building Consultants, Inc. (#9813)
Lyndon F. Schmidt, P.E. |
|---|--|

- | | |
|--|--|
| 6. Quality Assurance
Certificate of Participation issued by National Accreditation and Management Institute, certifying that Fleetwood Windows and Doors is manufacturing products within a quality assurance program that complies with ISO/IEC 17020 and Guide 53. | |
|--|--|

Signed & Sealed by
Lyndon F. Schmidt, P.E.

Signed & Sealed by
Lyndon F. Schmidt, P.E.

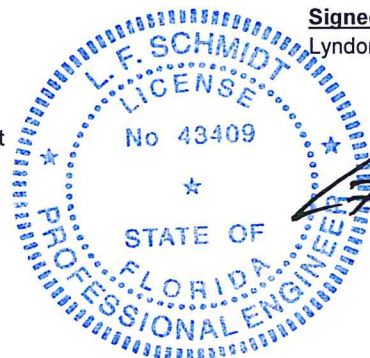

Lyndon F. Schmidt, P.E.
FL PE No. 43409
12/9/2020