



NEMO|etc.

Certificate of Authorization #32455
353 Christian Street, Unit #13
Oxford, CT 06478
(203) 262-9245

ENGINEER

EVALUATE

TEST

CONSULT

P.E. EVALUATION REPORT (PEER)

Versico Roofing Systems

P.O. Box 1289
Carlisle, PA 17013
(717) 245-7264

PEER-VRS-001.A.R8

FL1616-R14 (NON-HVHZ)

Date of Issuance: 03/20/2012

Revision 8: 09/21/2023

SCOPE:

This P.E. Evaluation Report (henceforth 'PEER') is issued under F.A.C. [Rule 61G20-3](#) and the applicable rules and regulations governing the use of construction materials in the State of Florida. The documentation submitted has been reviewed by Robert Nieminen, P.E. for use of the product under the Florida Building Code. The product described herein has been evaluated for compliance with the 8th Edition (2023) Florida Building Code [sections noted herein](#).

DESCRIPTION: Versico EPDM Single Ply Roof Systems (NON-HVHZ)

LABELING: Labeling shall be in accordance with the requirements of the Accredited Quality Assurance Agency noted herein.


CONTINUED COMPLIANCE: This PEER is valid until such time as the named product(s) changes, the referenced Quality Assurance or production facility location(s) changes, or Code provisions that relate to the product(s) change. Acceptance of our PEERs by the named client constitutes agreement to notify NEMO ETC, LLC of any changes to the product(s), the Quality Assurance or the production facility location(s). NEMO ETC, LLC requires a complete review of its PEER relative to updated Code requirements with each Code Cycle.

ADVERTISEMENT: The Florida Product Approval Number (FL#) preceded by the words "NEMO P.E. Evaluated" may be displayed in advertising literature. If any portion of the PEER is displayed, then it shall be done in its entirety.

INSPECTION: Upon request, a copy of this entire PEER shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This PEER consists of pages 1 through 4, plus 36-pages of Appendix.

Prepared by:

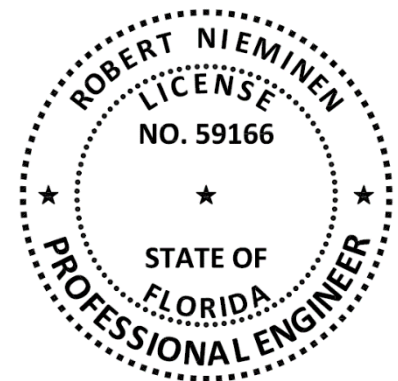

CERTIFICATION OF INDEPENDENCE:

1. NEMO ETC, LLC does not have, nor does it intend to acquire or will it acquire, a financial interest in any company manufacturing or distributing products it evaluates.
2. NEMO ETC, LLC is not owned, operated or controlled by any company manufacturing or distributing products it evaluates.
3. Robert Nieminen, P.E. does not have nor will acquire, a financial interest in any company manufacturing or distributing products for which the PEERs are being issued.
4. Robert Nieminen, P.E. does not have, nor will acquire, a financial interest in any other entity involved in the approval process of the product.
5. This is a building code evaluation. Neither NEMO ETC, LLC nor Robert Nieminen, P.E. are, in any way, the Designer of Record for any project on which this PEER, or previous versions thereof, is/was used for permitting or design guidance unless retained specifically for that purpose.

ROOFING SYSTEMS EVALUATION:
1. SCOPE:

Product Category: Roofing
Sub-Category: Single Ply Roof Systems
Product Approval Method: Method 1, Option D – Codified Material, Evaluation by Engineer
Compliance Statement: Versico EPDM Single Ply Roof Systems, as produced by Carlisle SynTec Systems, have demonstrated compliance with the following sections of the 8th Edition (2023) Florida Building Code through testing in accordance with the following Standards. Compliance is subject to the [Installation Requirements](#) and [Limitations of Use](#) set forth herein.

2. STANDARDS:

SECTION	PROPERTY	STANDARD	YEAR
1504.3.1	Wind resistance	FM 4474	2011
1504.6	Physical properties	ASTM G155	2013
1504.7	Impact resistance	FM 4470, Section 4.6	2016
1507.12.2	Material standard	ASTM D4637	2015
1523.6.2	Wind resistance	TAS 114	2011 (per 2023 Code)

3. REFERENCES:

ENTITY	EXAMINATION	REFERENCE	DATE
NEMO	PEER	PEER-CRL-001.A.R8	09/19/2023
UL, LLC (QUA9625)	Quality Control	Service Confirmation	07/06/2022

4. PRODUCT DESCRIPTION:

This PEER covers Versico EPDM Single Ply Roof Systems installed in accordance with Carlisle SynTec Systems published installation instructions and the [Limitations of Use](#) herein.

TABLE 1: EVALUATED MEMBRANES

TYPE	PRODUCT		MATERIAL STANDARD			PLANT(S)
			REFERENCE	TYPE	GRADE	
ROOF COVER OR CAP PLY	VersiGard Non-Reinforced	45, 60, 90	ASTM D4637	I	N/A	Carlisle, PA Greenville, IL
	VersiGard White Standard	60, 90	ASTM D4637	I	N/A	Carlisle, PA
	VersiGard Reinforced Standard	45, 60, 75	ASTM D4637	II	N/A	Carlisle, PA
	VersiGard White Reinforced EPDM	60	ASTM D4637	II	N/A	Carlisle, PA
	VersiGard Black VersiFleece 100, VersiGard Black VersiFleece 115 and VersiGard Black VersiFleece 145	45, 60, 90	ASTM D4637	III	N/A	Carlisle, PA
	VersiFleece AC EPDM	45, 60	ASTM D4637	III	N/A	Carlisle, PA
	VersiGard White VersiFleece 100, VersiGard White VersiFleece 115 and VersiGard White VersiFleece 145	45, 60, 90	ASTM D4637	III	N/A	Carlisle, PA

5. LIMITATIONS:

- 5.1 This is a building code evaluation. Neither NEMO ETC, LLC nor Robert Nieminen, P.E. are, in any way, the Designer of Record for any project on which this PEER, or previous versions thereof, is/was used for permitting or design guidance. PEERs are not to be construed as representing any attributes not specifically listed, nor are PEERs to be construed as an endorsement of the subject, or a recommendation for its use. There is no warranty by NEMO ETC, LLC or Robert Nieminen, P.E., express or implied, as to any finding or other matter in this PEER, or as to any product covered by the PEER.
- 5.2 This PEER is not for use in FBC High Velocity Hurricane Zone jurisdictions, as defined in FBC Chapter 2 (Broward and Miami-Dade Counties).
- 5.3 This PEER pertains to above-deck roof components. Roof decks and structural members shall be in accordance with FBC requirements to the satisfaction of the Authority Having Jurisdiction.
- 5.4 This PEER does not include evaluation of fire classification. Refer to **FBC 1505** for requirements and limitations regarding roof assembly fire classification. Refer to **FBC 2603** for requirements and limitations concerning the use of foam plastic insulation.
- 5.5 This PEER does not include evaluation of roof edge termination. Refer to **FBC 1504.5** for requirements and limitations regarding edge securement for low-slope roofs.
- 5.6 Refer to **FBC 1511** for requirements and limitations regarding recover installations.
- 5.6.1 For mechanically attached components over existing roof decks, fasteners shall be tested in the existing deck for withdrawal resistance. A qualified design professional shall review the data for comparison to the minimum requirements for the system. Testing shall be in accordance with [ANSI/SPRI FX-1](#) or [Testing Application Standard TAS 105](#).
- 5.6.2 For bonded insulation or membrane over existing substrates in a re-roof (tear off) or recover installation, the existing deck or existing roof surface shall be examined for compatibility with the adhesive to be installed. If any surface conditions exist that bring system performance into question, field uplift testing in accordance with [ANSI/SPRI IA-1](#), [ASTM E907](#), [FM Loss Prevention Data Sheet 1-52](#) or [Testing Application Standard TAS 124](#) shall be conducted on mock-ups of the proposed new roof assembly.
- 5.6.3 For bonded insulation or membrane over existing substrates in a recover installation, the existing roof system shall be capable of resisting project design pressures on its own merit to the satisfaction of the Authority Having Jurisdiction, as documented through field uplift testing in accordance with [ASTM E907](#), [FM Loss Prevention Data Sheet 1-52](#) or [Testing Application Standard TAS 124](#).
- 5.7 Refer to Appendix 1 for system attachment requirements for wind load resistance.
- 5.7.1 “MDP” = Maximum Design Pressure is the result of testing for wind load resistance based on allowable wind loads, and reflects the ultimate passing pressure divided by 2 (the 2 to 1 margin of safety per **FBC 1504.9** has already been applied). Refer to **FBC 1609** for determination of design wind loads.
- 5.7.2 For mechanically attached components or partially-bonded insulation, the maximum design pressure for the selected assembly shall meet or exceed at least the Zone 1 PRIME design pressure determined in accordance with **FBC Chapter 16**. Elevated pressure zones shall employ an attachment density designed by a qualified design professional to resist the elevated pressure criteria. Commonly used methods are [ANSI/SPRI WD1](#), [FM Loss Prevention Data Sheet 1-29](#), [Roofing Application Standard RAS 117](#) or [RAS 137](#). Assemblies marked with an asterisk* carry the limitations set forth in **Section 2.2.10.1 of FM Loss Prevention Data Sheet 1-29 (February 2020)** for Zone 2/3 enhancements.
- 5.7.3 For assemblies with all components fully bonded in place, the maximum design pressure for the selected assembly shall meet or exceed critical design pressure determined in accordance with **FBC Chapter 16**. No rational analysis is permitted for these systems.

- 5.8 All components in the roof assembly shall have quality assurance audit in accordance with F.A.C. [Rule 61G20-3](#). Refer to the Product Approval of the component manufacturer for components listed in Appendix 1 that are produced by a Product Manufacturer other than the report holder on [Page 1](#) of this PEER.

6. INSTALLATION:

Versico EPDM Single Ply Roof Systems shall be installed in accordance with **Carlisle SynTec Systems** published installation instructions, subject to the [Limitations of Use](#) noted herein.

7. BUILDING PERMIT REQUIREMENTS:

As required by the Building Official or Authority Having Jurisdiction to properly evaluate the installation of this product.

8. MANUFACTURING PLANTS:

Contact the named QA entity for manufacturing facilities covered by F.A.C. [Rule 61G20-3](#) QA requirements. Refer to [Section 4](#) herein for products and production locations having met codified material standards.

9. QUALITY ASSURANCE ENTITY:

[UL LLC – QUA9625](#); (360) 817-5512; bsai.inspections@ul.com

- THE 36-PAGES THAT FOLLOW FORM PART OF THIS PEER -

FBC NON-HVHZ

APPENDIX 1: ATTACHMENT REQUIREMENTS FOR WIND UPLIFT RESISTANCE

TABLE	DECK	APPLICATION	TYPE	DESCRIPTION	PAGE
1A	Wood	New, Reroof (Tear-Off), Recover	C-1	Mechanically Attached Insulation, Bonded Roof Cover	5
2A	Steel or Structural Concrete	New, Reroof (Tear-Off), Recover	B-1	Mechanically Attached Base Insulation, Bonded Top Insulation, Bonded Roof Cover	7
2B	Steel	New, Reroof (Tear-Off), Recover	B-2	Mech Attached Base Insulation, Bonded Temp Roof, Bonded Top Insulation, Bonded Roof Cover	11
2C	Steel or Structural Concrete	New, Reroof (Tear-Off), Recover	C-1	Mechanically Attached Insulation, Bonded Roof Cover	12
2D	Steel or Structural Concrete	New, Reroof (Tear-Off), Recover	D-1	Insulated, Mechanically Attached Roof Cover (Stress Plates)	19
2E	Steel or Structural Concrete	New, Reroof (Tear-Off), Recover	D-1	Insulated, Mechanically Attached Roof Cover (Battens)	19
3A	Structural Concrete	New, Reroof (Tear-Off)	A-1	Bonded Insulation, Bonded Roof Cover	21
3B	Structural Concrete	New, Reroof (Tear-Off)	F	Non-Insulated, Bonded Roof Cover	29
4A	Deck with Lightweight concrete	New, Reroof (Tear-Off)	A-2	Mechanically Attached Anchor Sheet, Bonded Insulation, Bonded Roof Cover	30
4B	Deck with Lightweight concrete	New	F	Non-Insulated, Bonded Roof Cover	30
5A	Various	Recover	A-1	Bonded Insulation, Bonded Roof Cover	31
5B	Various	Recover	F	Non-Insulated, Bonded Roof Cover	36

The following notes apply to the systems outlined herein:

- The roof system evaluation herein pertains to above-deck roof components. Roof decks and structural members shall be in accordance with FBC requirements to the satisfaction of the Authority Having Jurisdiction.
- Unless otherwise noted, fasteners and stress plates shall be as follows. Fasteners shall be of sufficient length for the following engagements:

FASTENER/PLATE OPTIONS				
DECK TYPE	BY	FBC FILE NO.	PARTS	MINIMUM ENGAGEMENT
Wood	Verisco	N/A	HPV Fastener with HPV Insulation Fastening Plate	Minimum ¾-inch plywood penetration or minimum 1-inch wood plank embedment
Steel	Verisco	N/A	HPV Fastener with HPV Insulation Fastening Plate	Minimum ¾-inch steel penetration and engage the top flute of the steel deck
Structural Concrete	Verisco	N/A	MP 14-10 Concrete Fastener, CD-10 Concrete Fastener or MP Concrete Spike with HPV Insulation Fastening Plate	Minimum 1-inch embedment. Fastener installed with a pilot hole in accordance with the fastener manufacturer's published installation instructions

- Unless otherwise noted, insulation may be any one layer or combination of FBC Approved (Local or Statewide) board(s) that meet FBC 1505 and, for foam plastic, FBC Chapter 26, when installed with the roof cover.
- Minimum 200 psi, minimum 2-inch thick FBC Approved lightweight insulating concrete may be substituted for rigid insulation board for System Types B-1, C-1, C-2, D-1 or D-2, whereby fasteners are installed through the lightweight insulating concrete to engage the structural deck. The structural deck shall be of equal or greater type, thickness and strength to the steel and structural concrete deck listings. Roof decks and structural members shall be in accordance with FBC requirements to the satisfaction of the Authority Having Jurisdiction. This is a wind uplift resistance allowance and does not purport to address non-wind-uplift-related issues, such as deck venting or moisture levels within the LWIC and the potential effect on overlying components.
- Preliminary insulation attachment: Unless otherwise noted, use FBC Approved roofing fasteners and plates and refer to Section 2.2.10.1.3 of [FM Loss Prevention Data Sheet 1-29](#). For systems where a vapor barrier is installed, refer to Table 6 of [FM Loss Prevention Data Sheet 1-29](#). For systems where no vapor barrier is installed, Verisco Insultite may be used in place of HPV Fastener for preliminary attachment purposes over wood and steel deck.

- 6 Unless otherwise noted, insulation adhesive application rates are as follows.
- Ribbon or bead width is at the time of application; the ribbons/beads shall expand as noted in the manufacturer’s published instructions.
 - When multiple layers(s) of insulation and/or coverboard are installed in ribbon-applied adhesive, board joints shall be staggered.
 - The maximum edge distance from the adhesive ribbon to the edge of the insulation board shall be not less than one-half the specified ribbons spacing.
 - “FULL” or “SPLATTER” applications may be used wherever “RIBBON” is referenced for insulation securement.

INSULATION ADHESIVE REFERENCES			
ADHESIVE	METHOD	REFERENCE	MINIMUM RATE
Flexible DASH	full-coverage	Flexible DASH (FULL)	Continuous ribbons, 4-inch o.c. or spray-applied at 1 gal./square
Flexible DASH	splatter-applied	Flexible DASH (SPLATTER)	Splatter-applied at 0.5 gal/square (wet) = 4.7 lb/square (dry)
Flexible DASH	ribbon-applied	Flexible DASH (RIBBON)	Continuous ribbons, 12-inch o.c.
Flexible DASH Dual-Tank	full-coverage	Flexible DASH DT (FULL)	Continuous ribbons, 4-inch o.c. or spray-applied at 1 gal./square
Flexible DASH Dual-Tank	splatter-applied	Flexible DASH DT (SPLATTER)	Splatter-applied at 0.4 gal/square (wet) = 3.7 lb/square (dry)
Flexible DASH Dual-Tank	ribbon-applied	Flexible DASH DT (RIBBON)	Continuous ribbons, 12-inch o.c.
Versico OlyBond 500 BA	ribbon-applied	OB500	Continuous 0.75-inch wide ribbons, 12-inch o.c. (PaceCart, SpotShot or Canister)

- 7 Unless otherwise noted, all insulations are flat-stock or taper board of the minimum thickness noted. Tapered polyisocyanurate at the following thickness limitations may be substituted with the following Maximum Design Pressure (MDP) limitations. In no case shall these values be used to ‘increase’ the MDP listings in the tables; rather if MDP listing below meets or exceeds that listed for a particular system in the tables, then the thinner board listed below may be used as a drop-in for the equivalent thicker material listed in the table.

MDP LIMITATIONS FOR TAPERED POLYISOCYANURATE INSULATIONS				
ADHESIVE	INSULATION		MIN. TAPERED THICKNESS (IN)	MDP (psf)
	LISTED PRODUCT	FBC FILE NO.		
Flexible DASH	Any polyisocyanurate listed with adhesive herein	Various	0.5	-157.5
OB500	Any polyisocyanurate listed with adhesive herein	Various	0.5	-187.5

- 8 For adhered roof insulation and board-size: Unless otherwise noted, refer to Section 2.2.10.6.2 of [FM Loss Prevention Data Sheet](#) 1-29.
- 9 For mechanically attached components or partially-bonded insulation, the maximum design pressure for the selected assembly shall meet or exceed at least the Zone 1 PRIME design pressure determined in accordance with FBC Chapter 16. Elevated pressure zones shall employ an attachment density designed by a qualified design professional to resist the elevated pressure criteria. Commonly used methods are [ANSI/SPRI](#) WD1, [FM Loss Prevention Data Sheet](#) 1-29, [Roofing Application Standard](#) RAS 117 and RAS 137. Assemblies marked with an asterisk* carry the limitations set forth in Section 2.2.10.1 of [FM Loss Prevention Data Sheet](#) 1-29 for Zone 2/3 enhancements.
- 10 For assemblies with all components fully bonded, the maximum design pressure for the selected assembly shall meet or exceed critical design pressure determined in accordance with FBC Chapter 16. No rational analysis is permitted for these systems.
- 11 For mechanically attached components over existing decks, fasteners shall be tested in the existing deck for withdrawal resistance. A qualified design professional shall review the data for comparison to the minimum requirements for the system. Testing and analysis shall be in accordance with [ANSI/SPRI](#) FX-1 or [Testing Application Standard](#) TAS 105.
- 12 For bonded insulation or membrane over existing substrates in a re-roof (tear off) or recover installation, the existing deck or existing roof surface shall be examined for compatibility with the adhesive to be installed. If any surface conditions exist that bring system performance into question, field uplift testing shall be conducted on mock-ups of the proposed new roof assembly. For bonded insulation or membrane over existing substrates in a recover installation, the existing roof system shall be capable of resisting project design pressures on its own merit to the satisfaction of the Authority Having Jurisdiction, as documented through field uplift testing. Field uplift testing shall be in accordance with ASTM E907, [FM Loss Prevention Data Sheet](#) 1-52 or [Testing Application Standard](#) TAS 124.
- 13 Refer to FBC 1511 for requirements and limitations regarding recover installations. For Structural Concrete Deck or Recover Applications using System Type C-1 the base insulation layer is optional and for System Type C-2, D-1 or D-2, the insulation is optional. Alternatively, an FBC Approved insulation board or coverboard may be used as a separation layer. Board products shall be preliminarily attached prior to roof cover installation ([Note 5](#)). The separator component shall be documented as meeting FBC 1505 and, for foam plastic, FBC Chapter 26, when installed with the roof cover in Recover applications.

- 14 Lightweight insulating concrete (LWIC) shall be cast in accordance with FBC Section 1917 to the satisfaction of the Authority Having Jurisdiction. For systems where specific LWIC is referenced, refer to current LWIC Product Approval for specific deck construction and limitations. Unless otherwise noted, for systems where specific LWIC is not referenced, the minimum design mix shall be 300 psi. In all cases, the minimum top-coat thickness is 2-inches. For LWIC over structural concrete, reference is made to FBC Section 1917.4.1, Point 1. For “pre-existent” LWIC references, listings were established through testing over lightweight concrete cast using only foaming agent (ASTM C896), water and Portland cement (ASTM C150), with no proprietary additives, in accordance with procedures adopted by Miami-Dade BCCO (FBC CER1592). Use of these listings in new construction or re-roof (tear-off) applications is at the discretion of the Designer or Record and Authority Having Jurisdiction.
- 15 For bonded membrane applications, unless otherwise noted, refer to the following.

MEMBRANE / ADHESIVE COMBINATIONS			
MEMBRANE	ADHESIVE	METHOD	RATE
Bareback Roof Covers	Aqua Base 120 Bonding Adhesive	Contact (both sides)	0.42 gal/square per surface [0.84 gal/square (120 ft ² /gal) finish]
Bareback Roof Covers	Cav-Grip 3V Adhesive / Primer	Contact (both sides)	0.225 gal/square per surface [0.45 gal/square (222 ft ² /gal) finish]
Bareback Roof Covers	EPDM x-23 Low-VOC Bonding Adhesive	Contact (both sides)	0.83 gal/square per surface [(1.66 gal/square (60 ft ² /gal) finish]
Bareback Roof Covers	G200SA Yellow Substrate Adhesive	Contact (both sides)	0.83 gal/square per surface [(1.66 gal/square (60 ft ² /gal) finish]
FleeceBACK Roof Covers	Aqua Base 120 Bonding Adhesive	Wet lay (substrate)	0.83 gal/square (120 ft ² /gal)
FleeceBACK Roof Covers	Flexible DASH	Wet lay (substrate)	RIBBON, X spaced 'X-inch o.c.' as noted herein or FULL Coverage = 1 gal/square or continuous ribbons, maximum 4-inch o.c. or splatter-applied at 0.5 gal/square (wet) = 4.7 lb/square (dry)
FleeceBACK Roof Covers	Flexible DASH Dual-Tank (Flexible DASH DT)	Wet lay (substrate)	RIBBON, X spaced 'X-inch o.c.' as noted herein or FULL Coverage = 1 gal/square, continuous ribbons, maximum 4-inch o.c. or splatter-applied at 0.4 gal/square (wet) = 3.7 lb/square (dry)
AFX Roof Covers	Verisco Cold Applied Adhesive	Wet lay (substrate)	1.5 gal/square
AFX Roof Covers	Hot asphalt	Wet lay (substrate)	25 lbs/square

- 15A For single-ply membranes in System Type D-1 steel deck applications, the roof membrane shall be run with its length perpendicular to the steel deck flutes.
- 15B For membrane attachment using batten-strips, end laps shall be spliced with sufficient dimension to allow for minimum 2-fasteners at each batten-strip lap.
- 15C Side laps shall be sealed in accordance with Verisco requirements:
- Primed with V150 Primer or Low-VOC EPDM Primer and adhered with VersiGard QA Adhesive Seam Tape or QA White Seam Tape
 - Primed with V150 Primer and sealed with pre-applied seam tape.
 - Cleaned with Weathered Membrane Cleaner, optional priming with V150 Primer or Low-VOC EPDM Primer, and adhered with G100B Seam Adhesive or G100 Seam Adhesive White.

16 **Thermal Barrier and/or Vapor Barrier Options:**

- 16A **Structural Concrete Decks:** The lesser of the MDP listings below vs. that for the selected assembly applies.

STRUCTURAL CONCRETE DECK: VAPOR BARRIER FOLLOWED BY ADHERED INSULATION					
OPTION #	PRIMER	VAPOR BARRIER		INSULATION ADHESIVE PER TABLE 3A (NOTES 6,7,8)	MDP (PSF)*
		TYPE	APPLICATION		
C-VB-1.	702 Primer, 702 LV Primer, CAV-GRIP Primer or Cav-Grip 3V A/P	Verisco 725TR	Self-adhering	Flexible DASH (RIBBON)	-157.5
C-VB-2.	702 Primer, 702 LV Primer, CAV-GRIP Primer or Cav-Grip 3V A/P	Verisco 725TR	Self-adhering	Flexible DASH DT (RIBBON)	-172.5
C-VB-3.	702 Primer, 702 LV Primer, CAV-GRIP Primer or Cav-Grip 3V A/P	Verisco 725TR	Self-adhering	Flexible DASH (RIBBON, 6-inch o.c. or SPLATTER) or Flexible DASH DT (RIBBON, 6-inch o.c. or SPLATTER)	-270.0
C-VB-4.	CAV-GRIP Primer or Cav-Grip 3V A/P	Verisco 725TR	Self-adhering	Flexible DASH (FULL COVERAGE, 1 gal/square), Flexible DASH (SPLATTER) or Flexible DASH DT (SPLATTER)	-427.5
C-VB-5.	ASTM D41	SureMB 90 Base, SureMB 90 Poly Base or SureMB 120 Poly Base	Hot-asphalt	Hot asphalt at 25 lbs/square	-172.5

STRUCTURAL CONCRETE DECK: VAPOR BARRIER FOLLOWED BY ADHERED INSULATION					
OPTION #	PRIMER	VAPOR BARRIER		INSULATION ADHESIVE PER TABLE 3A (NOTES 6,7,8)	MDP (psf)*
		TYPE	APPLICATION		
C-VB-6.	ASTM D41	SureMB 90TG or 120TG Base	Torch-applied	Hot asphalt at 25 lbs/square	-180.0
C-VB-7.	None	SureMB 90 Base, SureMB 90 Poly Base or SureMB 120 Poly Base	Verisco Cold Applied Adhesive, 1-inch ribbons, 12-inch o.c.	Flexible DASH (RIBBON) or Flexible DASH DT (RIBBON)	-180.0
C-VB-8.	None	SureMB 90 Base, SureMB 90 Poly Base or SureMB 120 Poly Base	Verisco Cold Applied Adhesive, 1-inch ribbons, 6-inch o.c.	Flexible DASH (RIBBON, 6-inch o.c. or SPLATTER) or Flexible DASH DT (RIBBON, 6-inch o.c. or SPLATTER)	-255.0
C-VB-9.	ASTM D41	SureMB 90TG or 120TG Base	Torch-applied	Flexible DASH (RIBBON) or Flexible DASH DT (RIBBON)	-307.5
C-VB-10.	ASTM D41	SureMB 90TG or 120TG Base	Torch-applied	Flexible DASH (RIBBON, 6-inch o.c. or SPLATTER) or Flexible DASH DT (RIBBON, 6-inch o.c. or SPLATTER)	-495.0

17 For System Types B-1, B-2, C-1, C-2, D-1 or D-2, Versico 725TR or VapAir Seal MD may be installed atop the roof deck prior to installation of the insulation and roof cover. Refer to [FM Loss Prevention Data Sheet 1-29](#) for design and installation limitations.

18 The following products are interchangeable within the scope of this Evaluation Report:

ACCEPTABLE ALTERNATES				
SUB-CATEGORY	BY	LISTED PRODUCT HEREIN	ALTERNATE	FBC FILE
MEMBRANE	Verisco	VersiGard Black VersiFleece	Includes 100, 115 and 145	FL14083
		VersiFleece AC EPDM	Includes AFX 90 and AFX 105	
		VersiGard White VersiFleece	Includes 100, 115 and 145	
ADHESIVES	Verisco	OB500	OMG OlyBond 500 Adhesive Fastener	FL1608
ROOFING INSULATION	Verisco	VersiCore	VersiCore NH, H-Shield, H-Shield NH	FL5968
		SecurShield	SecurShield NH, H-Shield CG, H-Shield CG NH	
		SecurShield HD	SecurShield HD NH, H-Shield HD, H-Shield HD NH	
		SecurShield HD Plus	SecurShield HD Plus NH, H-Shield HD90, H-Shield HD90 NH	
		SecurShield HD Composite	H-Shield HD Composite	
	DuraFaceR	H-Shield NB		
	Georgia-Pacific Gypsum, LLC	DensDeck Prime	DensDeck StormX Prime Roof Board	FL1250

19 "MDP" = Maximum Design Pressure is the result of testing for wind load resistance based on allowable wind loads. Refer to FBC 1609 for determination of design wind loads. ([Note 9](#) and [Note 10](#))

**TABLE 1A: WOOD DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, BONDED ROOF COVER**

System No.	Deck (Note 1)	Base Insulation Layer (Note 3, Note 13)	Top Insulation Layer			Roof Cover (Note 15)	MDP (psf)
			Type	Fasteners (Note 2, Note 11)	Attach		
MEMBRANE APPLIED IN CAV-GRIP 3V ADHESIVE / PRIMER OR G200SA YELLOW SUBSTRATE ADHESIVE:							
W-1	Min. 19/32-inch CDX plywood or wood plank; 2-ft spans	(Optional) One or more layers, any combination, loose laid	Min. 0.5-inch SecurShield HD, SecurShield HD Plus or DuraStorm VSH	Verisco Insultite with SecurFast Insulation Fastening Plate	1 per 2.0 ft ²	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM / Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-30.0
W-2	Min. 19/32-inch CDX plywood or wood plank; 2-ft spans	(Optional) One or more layers, any combination, loose laid	Min. 0.5-inch SecurShield HD, SecurShield HD Plus or DuraStorm VSH	Verisco Insultite with HPV Insulation Fastening Plate	1 per 2.0 ft ²	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM / Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-37.5
W-3	Min. 19/32" plywood or wood plank	(Optional) One or more layers, any combination, loose laid	Min. 0.5-inch thick Verisco Recovery Board, min. 0.25-inch thick DensDeck, DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board, min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Note 2	1 per 2.0 ft ²	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM / Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-45.0*
W-4	Min. 19/32" plywood or wood plank	(Optional) One or more layers, any combination, loose laid	Min. 1.5-inch Polyiso HP-H Composite or H-Shield-WF	Note 2	1 per 3.0 ft ²	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM / Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-45.0*
W-5	Min. 19/32" plywood or wood plank	(Optional) One or more layers, any combination, loose laid	Min. 2.0-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Note 2	1 per 4.0 ft ²	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM / Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-45.0*
W-6	Min. 23/32-inch plywood	(Optional) One or more layers, any combination, loose laid	Min 0.5-inch SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 3.2 ft ²	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM / Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-45.0*
MEMBRANE APPLIED IN EPDM x-23 Low-VOC BONDING ADHESIVE:							
W-7	Min. 23/32-inch plywood	(Optional) One or more layers, any combination, loose laid	Min 0.5-inch SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 3.2 ft ²	VersiGard Non-Reinforced, VersiGard White Standard, VersiGard Reinforced Standard or VersiGard Reinforced FR / EPDM x-23 Low-VOC Bonding Adhesive	-45.0*

**TABLE 1A: WOOD DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, BONDED ROOF COVER**

System No.	Deck (Note 1)	Base Insulation Layer (Note 3, Note 13)	Top Insulation Layer			Roof Cover (Note 15)	MDP (psf)
			Type	Fasteners (Note 2, Note 11)	Attach		
MEMBRANE APPLIED IN FLEXIBLE DASH OR FLEXIBLE DASH DUAL-TANK:							
W-8	Min. 19/32-inch CDX plywood or wood plank; 2-ft spans	(Optional) One or more layers, any combination, loose laid	Min. 0.5-inch SecurShield HD, SecurShield HD Plus or DuraStorm VSH	Verisco Insultite with SecurFast Insulation Fastening Plate	1 per 2.0 ft ²	VersiGard Black VersiFleece or VersiGard White VersiFleece / Flexible DASH or Flexible DASH DT (FULL)	-30.0
W-9	Min. 19/32-inch CDX plywood or wood plank; 2-ft spans	(Optional) One or more layers, any combination, loose laid	Min. 0.5-inch SecurShield HD, SecurShield HD Plus or DuraStorm VSH	Verisco Insultite with HPV Insulation Fastening Plate	1 per 2.0 ft ²	VersiGard Black VersiFleece or VersiGard White VersiFleece / Flexible DASH or Flexible DASH DT (FULL)	-37.5
W-10	Min. 23/32-inch plywood	(Optional) One or more layers, any combination, loose laid	Min 0.5-inch SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 3.2 ft ²	VersiGard Black VersiFleece or VersiGard White VersiFleece / Flexible DASH or Flexible DASH DT (FULL)	-45.0*

FBC NON-HVHZ

**TABLE 2A: STEEL OR STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER**

System No.	Deck (Note 1)	Base Insulation Layer			Top Insulation Layer		Roof Cover (Note 15)	MDP (psf)
		Type	Fasten (Note 2, Note 11)	Attach	Type	Attach (Notes 6,7,8)		
MEMBRANE APPLIED IN CAV-GRIP 3V ADHESIVE / PRIMER OR G200SA YELLOW SUBSTRATE ADHESIVE:								
SC-1	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 0.5-inch DensDeck followed by min. 2-inch Insulfoam VIII	Note 2	1 per 2.7 ft ²	Min. 1.5-inch InsulLam (OSB)	Flexible DASH (RIBBON, 6 or SPLATTER) or Flexible DASH DT (RIBBON, 6 or SPLATTER)	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM / Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-37.5*
SC-2	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 0.5-inch DensDeck followed by min. 2-inch Insulfoam VIII	Note 2	1 per 2.0 ft ²	Min. 2-inch Insulfoam HD Composite	Flexible DASH (RIBBON, 6 or SPLATTER) or Flexible DASH DT (RIBBON, 6 or SPLATTER)	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM / Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-45.0*
SC-3	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1.5-inch VersiCore, SecurShield	Steel: Verisco Insultite with HPV Insulation Fastening Plate Concrete: Note 2	1 per 1.8 ft ²	<u>Insulation:</u> (Optional) Additional layer(s) base insulation <u>Coverboard:</u> Min. 0.5-inch SecurShield HD, SecurShield HD Plus or DuraStorm VSH	Flexible DASH or Flexible DASH DT (RIBBON, 6-inch o.c.)	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM / Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-52.5
SC-4	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1.5-inch VersiCore, SecurShield	Steel: Verisco Insultite with HPV Insulation Fastening Plate Concrete: Note 2	1 per 2.0 ft ²	<u>Insulation:</u> (Optional) Additional layer(s) base insulation <u>Coverboard:</u> Min. 0.5-inch DensDeck Prime, SECUROCK Gypsum-Fiber Roof Board, SecurShield HD, SecurShield HD Plus or DuraStorm VSH	Flexible DASH or Flexible DASH DT (RIBBON)	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM / Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-60.0
SC-5	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 2-inch VersiCore, SecurShield	Steel: Verisco Insultite with HPV Insulation Fastening Plate Concrete: Note 2	1 per 1.8 ft ²	<u>Insulation:</u> (Optional) Additional layer(s) base insulation <u>Coverboard:</u> Min. 0.5-inch SecurShield HD, SecurShield HD Plus or DuraStorm VSH	Flexible DASH or Flexible DASH DT (RIBBON, 6-inch o.c.)	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM / Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-60.0

**TABLE 2A: STEEL OR STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER**

System No.	Deck (Note 1)	Base Insulation Layer			Top Insulation Layer		Roof Cover (Note 15)	MDP (psf)
		Type	Fasten (Note 2, Note 11)	Attach	Type	Attach (Notes 6,7,8)		
SC-6	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 2-inch VersiCore, SecurShield	Steel: Verisco Insultite with HPV Insulation Fastening Plate Concrete: Note 2	1 per 1.6 ft ²	<u>Insulation:</u> (Optional) Additional layer(s) base insulation <u>Coverboard:</u> Min. 0.5-inch DensDeck Prime, SECUROCK Gypsum-Fiber Roof Board, SecurShield HD, SecurShield HD Plus or DuraStorm VSH	Flexible DASH or Flexible DASH DT (RIBBON, 6-inch o.c.)	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM / Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-67.5
SC-7	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1.5-inch VersiCore, SecurShield	Steel: Verisco Insultite with HPV Insulation Fastening Plate Concrete: Note 2	1 per 1.3 ft ²	<u>Insulation:</u> (Optional) Additional layer(s) base insulation <u>Coverboard:</u> Min. 0.5-inch SecurShield HD, SecurShield HD Plus or DuraStorm VSH	Flexible DASH or Flexible DASH DT (FULL)	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM / Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-82.5
SC-8	Min. 22 ga., type B, Grade 80 steel or min. 2,500 psi structural concrete	Min. 2-inch VersiCore, SecurShield	Steel: Verisco Insultite with HPV Insulation Fastening Plate Concrete: Note 2	1 per 1.3 ft ²	<u>Insulation:</u> (Optional) Additional layer(s) base insulation <u>Coverboard:</u> Min. 0.5-inch SecurShield HD, SecurShield HD Plus or DuraStorm VSH	Flexible DASH or Flexible DASH DT (FULL)	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM / Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-90.0
SC-9	Min. 22 ga., type B, Grade 80 steel or min. 2,500 psi structural concrete	Min. 2-inch VersiCore, SecurShield	Steel: Verisco Insultite with HPV Insulation Fastening Plate Concrete: Note 2	1 per 1.0 ft ²	<u>Insulation:</u> (Optional) Additional layer(s) base insulation <u>Coverboard:</u> Min. 0.5-inch DensDeck Prime, SECUROCK Gypsum-Fiber Roof Board, SecurShield HD, SecurShield HD Plus or DuraStorm VSH	Flexible DASH or Flexible DASH DT (FULL)	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM / Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-112.5
SC-10	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 2-inch VersiCore or SecurShield	Note 2	1 per 1.3 ft ²	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	OB500	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM / Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-60.0

MEMBRANE APPLIED IN FLEXIBLE DASH OR FLEXIBLE DASH DUAL-TANK:

**TABLE 2A: STEEL OR STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER**

System No.	Deck (Note 1)	Base Insulation Layer			Top Insulation Layer		Roof Cover (Note 15)	MDP (psf)
		Type	Fasten (Note 2, Note 11)	Attach	Type	Attach (Notes 6,7,8)		
SC-11	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	One or more layers Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Note 2	1 per 2.0 ft ²	Min. 0.25-inch DensDeck, DensDeck Prime	Flexible DASH or Flexible DASH DT (RIBBON)	VersiGard Black VersiFleece or VersiGard White VersiFleece / Flexible DASH or Flexible DASH DT (RIBBON, 12)	-37.5*
SC-12	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 0.5-inch DensDeck or DensDeck Prime	Note 2	1 per 2.0 ft ²	Min. 1.5-inch Kingspan GreenGuard Extruded Polystyrene followed by min. 0.25-inch DensDeck Prime	Flexible DASH or Flexible DASH DT (RIBBON)	VersiGard Black VersiFleece or VersiGard White VersiFleece / Flexible DASH or Flexible DASH DT (RIBBON, 12)	-37.5*
SC-13	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 0.5-inch DensDeck followed by min. 2-inch Insulfoam VIII	Note 2	1 per 2.7 ft ²	Min. 1.5-inch Insullam (OSB)	Flexible DASH (RIBBON, 6 or SPLATTER) or Flexible DASH DT (RIBBON, 6 or SPLATTER)	VersiGard Black VersiFleece or VersiGard White VersiFleece / Flexible DASH or Flexible DASH DT (FULL)	-37.5*
SC-14	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	One or more layers Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Note 2	1 per 2.0 ft ²	Additional layers of base insulation	Flexible DASH or Flexible DASH DT (RIBBON)	VersiGard Black VersiFleece or VersiGard White VersiFleece / Flexible DASH or Flexible DASH DT (RIBBON, 12)	-45.0*
SC-15	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1.5-inch VersiCore or SecurShield	Note 2	1 per 3.2 ft ²	Min. 1.0-inch base insulation	Flexible DASH or Flexible DASH DT (RIBBON)	VersiGard Black VersiFleece or VersiGard White VersiFleece / Flexible DASH or Flexible DASH DT (FULL)	-45.0*
SC-16	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1.5-inch VersiCore or SecurShield	Note 2	1 per 3.2 ft ²	Min. 0.25-inch DensDeck Prime	Flexible DASH or Flexible DASH DT (RIBBON)	VersiGard Black VersiFleece or VersiGard White VersiFleece / Flexible DASH or Flexible DASH DT (FULL)	-45.0*
SC-17	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 2.0-inch VersiCore or SecurShield	Note 2	1 per 4.0 ft ²	Min. 1.0-inch base insulation	Flexible DASH or Flexible DASH DT (RIBBON)	VersiGard Black VersiFleece or VersiGard White VersiFleece / Flexible DASH or Flexible DASH DT (FULL)	-45.0*
SC-18	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 2.0-inch VersiCore or SecurShield	Note 2	1 per 4.0 ft ²	Min. 0.25-inch DensDeck Prime	Flexible DASH or Flexible DASH DT (RIBBON)	VersiGard Black VersiFleece or VersiGard White VersiFleece / Flexible DASH or Flexible DASH DT (FULL)	-45.0*
SC-19	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 0.5-inch DensDeck followed by min. 2-inch Insulfoam VIII	Note 2	1 per 2.0 ft ²	Min. 2-inch Insulfoam HD Composite	Flexible DASH (RIBBON, 6 or SPLATTER) or Flexible DASH DT (RIBBON, 6 or SPLATTER)	VersiGard Black VersiFleece or VersiGard White VersiFleece / Flexible DASH or Flexible DASH DT (FULL)	-45.0*

**TABLE 2A: STEEL OR STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER**

System No.	Deck (Note 1)	Base Insulation Layer			Top Insulation Layer		Roof Cover (Note 15)	MDP (psf)
		Type	Fasten (Note 2, Note 11)	Attach	Type	Attach (Notes 6,7,8)		
SC-20	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1.5-inch VersiCore, SecurShield	Steel: Verisco Insultite with HPV Insulation Fastening Plate Concrete: Note 2	1 per 2.0 ft ²	<u>Insulation:</u> (Optional) Additional layer(s) base insulation <u>Coverboard:</u> Min. 0.5-inch DensDeck Prime, SecurShield HD, SecurShield HD Plus or DuraStorm VSH	Flexible DASH or Flexible DASH DT (RIBBON)	VersiGard Black VersiFleece or VersiGard White VersiFleece / Flexible DASH or Flexible DASH DT (FULL)	-60.0
SC-21	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1.5-inch VersiCore or SecurShield	Note 2	1 per 1.6 ft ²	Min. 1.0-inch base insulation	Flexible DASH (RIBBON, 6 or SPLATTER) or Flexible DASH DT (RIBBON, 6 or SPLATTER)	VersiGard Black VersiFleece or VersiGard White VersiFleece / Flexible DASH or Flexible DASH DT (FULL)	-67.5
SC-22	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 2-inch VersiCore, SecurShield	Steel: Verisco Insultite with HPV Insulation Fastening Plate Concrete: Note 2	1 per 1.6 ft ²	<u>Insulation:</u> (Optional) Additional layer(s) base insulation <u>Coverboard:</u> Min. 0.5-inch DensDeck Prime, SecurShield HD, SecurShield HD Plus or DuraStorm VSH	Flexible DASH or Flexible DASH DT (RIBBON, 6-inch o.c.)	VersiGard Black VersiFleece or VersiGard White VersiFleece / Flexible DASH or Flexible DASH DT (FULL)	-67.5
SC-23	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1.5-inch VersiCore, SecurShield	Steel: Verisco Insultite with HPV Insulation Fastening Plate Concrete: Note 2	1 per 1.3 ft ²	<u>Insulation:</u> (Optional) Additional layer(s) base insulation <u>Coverboard:</u> Min. 0.5-inch SecurShield HD, SecurShield HD Plus or DuraStorm VSH	Flexible DASH or Flexible DASH DT (FULL)	VersiGard Black VersiFleece or VersiGard White VersiFleece / Flexible DASH or Flexible DASH DT (FULL)	-82.5
SC-24	Min. 22 ga., type B, Grade 80 steel or min. 2,500 psi structural concrete	Min. 2-inch VersiCore, SecurShield	Steel: Verisco Insultite with HPV Insulation Fastening Plate Concrete: Note 2	1 per 1.3 ft ²	<u>Insulation:</u> (Optional) Additional layer(s) base insulation <u>Coverboard:</u> Min. 0.5-inch SecurShield HD, SecurShield HD Plus or DuraStorm VSH	Flexible DASH or Flexible DASH DT (FULL)	VersiGard Black VersiFleece or VersiGard White VersiFleece / Flexible DASH or Flexible DASH DT (FULL)	-90.0
SC-25	Min. 22 ga., type B, Grade 80 steel or min. 2,500 psi structural concrete	Min. 2-inch VersiCore, SecurShield	Steel: Verisco Insultite with HPV Insulation Fastening Plate Concrete: Note 2	1 per 1.0 ft ²	<u>Insulation:</u> (Optional) Additional layer(s) base insulation <u>Coverboard:</u> Min. 0.5-inch DensDeck Prime, SecurShield HD, SecurShield HD Plus or DuraStorm VSH	Flexible DASH or Flexible DASH DT (FULL)	VersiGard Black VersiFleece or VersiGard White VersiFleece / Flexible DASH or Flexible DASH DT (FULL)	-112.5

TABLE 2B: STEEL DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE B-2: MECHANICALLY ATTACHED BASE INSULATION, BONDED TEMP ROOF, BONDED TOP INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Thermal Barrier			Primer	Vapor Barrier	Base Insulation Layer		Top Insulation Layer(s)		Roof Cover (Note 15)	MDP (psf)
		Type	Fasten (Note 2, Note 11)	Attach			Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)		
MEMBRANE APPLIED IN FLEXIBLE DASH OR FLEXIBLE FAST DUAL-TANK:												
SC-26	Min. 22 ga., type B, Grade 33 steel	Min. 0.5-inch DensDeck Prime or min. 0.625-inch SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 2.0 ft ²	CAV-GRIP Primer	Versico 725TR, self-adhering	Min. 1.5-inch VersiCore, SecurShield	Flexible DASH or Flexible DASH DT (RIBBON)	<u>Insulation:</u> (Optional) Additional layer(s) base insulation <u>Coverboard:</u> Min. 0.5-inch SecurShield HD, SecurShield HD Plus or DuraStorm VSH	Flexible DASH or Flexible DASH DT (RIBBON, 6-inch o.c.)	VersiGard Black VersiFleece or VersiGard White VersiFleece / Flexible DASH or Flexible DASH DT (FULL)	-45.0*
SC-27	Min. 22 ga., type B, Grade 33 steel	Min. 0.5-inch DensDeck Prime	Note 2	1 per 2.0 ft ²	CAV-GRIP Primer or CCW-702 Quick Dry Primer	Versico 725TR, self-adhering	Min. 1.5-inch VersiCore, SecurShield	Flexible DASH or Flexible DASH DT (RIBBON)	<u>Insulation:</u> (Optional) Additional layer(s) base insulation	Flexible DASH or Flexible DASH DT (RIBBON)	VersiGard Black VersiFleece or VersiGard White VersiFleece / Flexible DASH or Flexible DASH DT (FULL)	-52.5
SC-28	Min. 22 ga., type B, Grade 33 steel	Min. 0.5-inch DensDeck Prime	Versico Insultite with HPV Insulation Fastening Plate	1 per 1.6 ft ²	None	SureMB 90TG or SureMB 120TG, torch-applied	Min. 1.5-inch VersiCore, SecurShield	Flexible DASH or Flexible DASH DT (RIBBON, 6-inch o.c.)	<u>Insulation:</u> (Optional) Additional layer(s) base insulation <u>Coverboard:</u> Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board or min. 0.5-inch SecurShield HD, SecurShield HD Plus or DuraStorm VSH	Flexible DASH or Flexible DASH DT (RIBBON)	VersiGard Black VersiFleece or VersiGard White VersiFleece / Flexible DASH or Flexible DASH DT (FULL)	-67.5

**TABLE 2c: STEEL OR STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, BONDED ROOF COVER**

System No.	Deck (Note 1)	Base Insulation Layer (Note 3, Note 13)	Top Insulation Layer			Roof Cover (Note 15)	MDP (psf)
			Type	Fasteners (Note 2, Note 11)	Attach		
MEMBRANE APPLIED IN CAV-GRIP 3V ADHESIVE / PRIMER OR G200SA YELLOW SUBSTRATE ADHESIVE:							
SC-29	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1.5-inch VersiCore, SecurShield, loose laid	Min. 0.5-inch SecurShield HD	Steel: Verisco Insultite with AccuTrac Plate Concrete: MP 14-10 Concrete Fastener, CD-10 Concrete Fastener or MP Concrete Spike with AccuTrac Plate	1 per 4.0 ft ²	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM / Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-30.0*
SC-30	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1.5-inch thick, one or more layers, any combination, loose laid	Min. 0.5-inch SecurShield HD	Note 2	1 per 2.7 ft ²	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM / Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-37.5*
SC-31	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 0.5-inch thick Verisco Recovery Board	Note 2	1 per 2.0 ft ²	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM / Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-45.0*
SC-32	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 0.25-inch thick DensDeck, DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 2.0 ft ²	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM / Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-45.0*
SC-33	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 1-inch VersiCore or SecurShield	Note 2	1 per 1.6 ft ²	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM / Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-45.0*
SC-34	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Note 2	1 per 2.0 ft ²	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM / Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-45.0*
SC-35	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 2.0-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Note 2	1 per 4.0 ft ²	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM / Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-45.0*

**TABLE 2C: STEEL OR STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, BONDED ROOF COVER**

System No.	Deck (Note 1)	Base Insulation Layer (Note 3, Note 13)	Top Insulation Layer			Roof Cover (Note 15)	MDP (psf)
			Type	Fasteners (Note 2, Note 11)	Attach		
SC-36	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 1.5-inch Polyiso HP-H Composite or H-Shield-WF	Note 2	1 per 3.0 ft ²	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM / Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-45.0*
SC-37	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Min. 0.5-inch SecurShield HD Plus or DuraStorm VSH	Note 2	1 per 4.0 ft ²	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM / Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-45.0*
SC-38	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1-inch VersiCore or SecurShield	Min. 0.5-inch DensDeck Prime	Note 2	1 per 1.6 ft ²	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM / Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-52.5
SC-39	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Min. 0.5-inch SecurShield HD Plus or DuraStorm VSH	Note 2	1 per 1.8 ft ²	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM / Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-60.0
SC-40	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 2-inch SecurShield	Note 2	1 per 2.0 ft ²	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM / Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-60.0
SC-41	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 0.5-inch DensDeck, DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board, followed by min. 1.5-inch Styrofoam Roofmate or Highload 60	Min. 0.5-inch DensDeck, DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 1.3 ft ²	VersiGard Reinforced Standard or VersiGard Reinforced FR / Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-67.5
SC-42	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1.5-inch VersiCore or SecurShield	Min. 0.5-inch DensDeck, DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 1.3 ft ²	VersiGard Reinforced Standard or VersiGard Reinforced FR / Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-67.5

**TABLE 2C: STEEL OR STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, BONDED ROOF COVER**

System No.	Deck (Note 1)	Base Insulation Layer (Note 3, Note 13)	Top Insulation Layer			Roof Cover (Note 15)	MDP (psf)
			Type	Fasteners (Note 2, Note 11)	Attach		
SC-43	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 2.0-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Note 2	1 per 1.6 ft ²	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM / Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-75.0
SC-44	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1-inch VersiCore or SecurShield	Min. 0.5-inch SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 1.6 ft ²	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM / Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-75.0
SC-45	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 2-inch VersiCore or SecurShield	Min. 7/16-inch APA rated OSB	Note 2	1 per 1.6 ft ²	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM / Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-82.5
SC-46	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 0.5-inch DensDeck, DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board, followed by min. 1.5-inch Styrofoam Roofmate or Highload 60	Min. 0.5-inch DensDeck, DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 1.0 ft ²	VersiGard Reinforced Standard or VersiGard Reinforced FR / Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-97.5
SC-47	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1.5-inch VersiCore or SecurShield	Min. 0.5-inch DensDeck, DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 1.0 ft ²	VersiGard Reinforced Standard or VersiGard Reinforced FR / Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-97.5
SC-48	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1.5-inch VersiCore or SecurShield	Min. 7/16-inch APA rated OSB	Note 2	1 per 1.0 ft ²	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM / Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-105.0
SC-49	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 2-inch SecurShield or SecurShield HD Composite	Note 2	1 per 1.0 ft ²	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM / Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-112.5

**TABLE 2c: STEEL OR STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, BONDED ROOF COVER**

System No.	Deck (Note 1)	Base Insulation Layer (Note 3, Note 13)	Top Insulation Layer			Roof Cover (Note 15)	MDP (psf)
			Type	Fasteners (Note 2, Note 11)	Attach		
SC-50	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Min. 0.5-inch SecurShield HD Plus or DuraStorm VSH	Note 2	1 per 1.3 ft ²	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM / Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-112.5
SC-51	Min. 22 ga., type B, Grade 80 steel or min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 2-inch SecurShield or SecurShield HD Composite	Note 2	1 per 1.0 ft ²	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM / Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-127.5
SC-52	Min. 22 ga., type B, Grade 80 steel or min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	0.5-inch DuraStorm VSH	Steel: Verisco Insultite with HPV Insulation Fastening Plate or SecurFast Insulation Fastening Plate Concrete: Note 2	1 per 1.0 ft ²	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM / Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-150.0
MEMBRANE APPLIED IN AQUA BASE 120 BA ADHESIVE:							
SC-53	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 0.5-inch Verisco Recovery Board or min. 0.25-inch DensDeck Prime	Note 2	1 per 4.0 ft ²	VersiGard Non-Reinforced, VersiGard Reinforced Standard or VersiGard Reinforced FR / Aqua Base 120 BA	-30.0*
SC-54	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	None	Min. 0.5-inch Verisco Recovery Board	Note 2	1 per 2.0 ft ²	VersiGard Non-Reinforced, VersiGard Reinforced Standard or VersiGard Reinforced FR / Aqua Base 120 BA	-37.5*
SC-55	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Min. 0.5-inch Verisco Recovery Board	Note 2	1 per 2.0 ft ²	VersiGard Non-Reinforced, VersiGard Reinforced Standard or VersiGard Reinforced FR / Aqua Base 120 BA	-45.0*
SC-56	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 0.25-inch DensDeck Prime	Note 2	1 per 2.0 ft ²	VersiGard Non-Reinforced, VersiGard Reinforced Standard or VersiGard Reinforced FR / Aqua Base 120 BA	-45.0*
SC-57	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 7/16" APA Rated oriented strand board	Note 2	1 per 2.0 ft ²	VersiGard Non-Reinforced, VersiGard Reinforced Standard or VersiGard Reinforced FR / Aqua Base 120 BA	-45.0*
SC-58	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 1-inch VersiCore or SecurShield	Note 2	1 per 1.6 ft ²	VersiGard Non-Reinforced, VersiGard Reinforced Standard or VersiGard Reinforced FR / Aqua Base 120 BA	-45.0*

**TABLE 2c: STEEL OR STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, BONDED ROOF COVER**

System No.	Deck (Note 1)	Base Insulation Layer (Note 3, Note 13)	Top Insulation Layer			Roof Cover (Note 15)	MDP (psf)
			Type	Fasteners (Note 2, Note 11)	Attach		
SC-59	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Note 2	1 per 2.0 ft ²	VersiGard Non-Reinforced, VersiGard Reinforced Standard or VersiGard Reinforced FR / Aqua Base 120 BA	-45.0*
SC-60	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Min. 0.5-inch Verisco Recovery Board	Note 2	1 per 2.0 ft ²	VersiGard Black VersiFleece or VersiGard White VersiFleece / Aqua Base 120 BA	-45.0*
SC-61	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 0.25-inch DensDeck Prime	Note 2	1 per 2.0 ft ²	VersiGard Black VersiFleece or VersiGard White VersiFleece / Aqua Base 120 BA	-45.0*
SC-62	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Note 2	1 per 2.0 ft ²	VersiGard Black VersiFleece or VersiGard White VersiFleece / Aqua Base 120 BA	-45.0*
MEMBRANE APPLIED IN EPDM x-23 LOW-VOC BONDING ADHESIVE:							
SC-63	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 1.5-inch VersiCore or SecurShield	Note 2	1 per 3.2 ft ²	VersiGard Non-Reinforced, VersiGard White Standard, VersiGard Reinforced Standard or VersiGard Reinforced FR / EPDM x-23 Low-VOC Bonding Adhesive	-45.0*
SC-64	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 2.0-inch VersiCore or SecurShield	Note 2	1 per 4.0 ft ²	VersiGard Non-Reinforced, VersiGard White Standard, VersiGard Reinforced Standard or VersiGard Reinforced FR / EPDM x-23 Low-VOC Bonding Adhesive	-45.0*
SC-65	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Min. 0.5-inch Verisco Recovery Board	Note 2	1 per 2.0 ft ²	VersiGard Non-Reinforced, VersiGard White Standard, VersiGard Reinforced Standard or VersiGard Reinforced FR / EPDM x-23 Low-VOC Bonding Adhesive	-45.0*
SC-66	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 2.0-inch VersiCore or SecurShield	Note 2	1 per 1.6 ft ²	VersiGard Non-Reinforced, VersiGard White Standard, VersiGard Reinforced Standard or VersiGard Reinforced FR / EPDM x-23 Low-VOC Bonding Adhesive	-75.0
SC-67	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 2-inch SecurShield	Note 2	1 per 1.0 ft ²	VersiGard Non-Reinforced, VersiGard White Standard, VersiGard Reinforced Standard or VersiGard Reinforced FR / EPDM x-23 Low-VOC Bonding Adhesive	-75.0
MEMBRANE APPLIED IN FLEXIBLE DASH OR FLEXIBLE DASH DUAL-TANK:							

**TABLE 2C: STEEL OR STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, BONDED ROOF COVER**

System No.	Deck (Note 1)	Base Insulation Layer (Note 3, Note 13)	Top Insulation Layer			Roof Cover (Note 15)	MDP (psf)
			Type	Fasteners (Note 2, Note 11)	Attach		
SC-68	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1.5-inch VersiCore, SecurShield, loose laid	Min. 0.5-inch SecurShield HD	Steel: Verisco Insultite with AccuTrac Plate Concrete: MP 14-10 Concrete Fastener, CD-10 Concrete Fastener or MP Concrete Spike with AccuTrac Plate	1 per 4.0 ft ²	VersiGard Black VersiFleece or VersiGard White VersiFleece / Flexible DASH or Flexible DASH DT (FULL)	-30.0*
SC-69	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1.5-inch thick, one or more layers, any combination, loose laid	Min. 0.5-inch SecurShield HD	Note 2	1 per 2.7 ft ²	VersiGard Black VersiFleece or VersiGard White VersiFleece / Flexible DASH or Flexible DASH DT (FULL)	-37.5*
SC-70	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1.5-inch thick, one or more layers, any combination, loose laid	Min 0.5-inch Verisco Recovery Board	Note 2	1 per 2.0 ft ²	VersiGard Black VersiFleece or VersiGard White VersiFleece / Flexible DASH or Flexible DASH DT (RIBBON, 12)	-45.0*
SC-71	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1.5-inch thick, one or more layers, any combination, loose laid	Min 0.5-inch DensDeck Prime	Note 2	1 per 2.0 ft ²	VersiGard Black VersiFleece or VersiGard White VersiFleece / Flexible DASH or Flexible DASH DT (RIBBON, 12)	-45.0*
SC-72	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Min. 0.5-inch SecurShield HD Plus or DuraStorm VSH	Note 2	1 per 4.0 ft ²	VersiGard Black VersiFleece or VersiGard White VersiFleece / Flexible DASH or Flexible DASH DT (FULL)	-45.0*
SC-73	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Min. 0.5-inch SecurShield HD Plus or DuraStorm VSH	Note 2	1 per 1.8 ft ²	VersiGard Black VersiFleece or VersiGard White VersiFleece / Flexible DASH or Flexible DASH DT (FULL)	-60.0
SC-74	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1.5-inch thick, one or more layers, any combination, loose laid	Min 7/16-inch APA or TECO rated OSB	Note 2	1 per 1.9 ft ²	VersiGard Black VersiFleece or VersiGard White VersiFleece / Flexible DASH or Flexible DASH DT (FULL)	-75.0
SC-75	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1.5-inch thick, one or more layers, any combination, loose laid	0.5-inch DuraStorm VSH	Steel: Verisco Insultite with HPV Insulation Fastening Plate or SecurFast Insulation Fastening Plate Concrete: Note 2	1 per 1.0 ft ²	VersiGard Black VersiFleece or VersiGard White VersiFleece / Flexible DASH or Flexible DASH DT (FULL)	-82.5
SC-76	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1.5-inch thick, one or more layers, any combination, loose laid	Min. 0.5-inch DensDeck Prime	Note 2	1 per 1.0 ft ²	VersiGard Black VersiFleece or VersiGard White VersiFleece / Flexible DASH or Flexible DASH DT (FULL)	-97.5
SC-77	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 2-inch Polyiso HP-H, VersiCore	Note 2	1 per 1.0 ft ²	VersiGard Black VersiFleece or VersiGard White VersiFleece / Flexible DASH or Flexible DASH DT (FULL)	-112.5
SC-78	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Min. 0.5-inch SecurShield HD Plus or DuraStorm VSH	Note 2	1 per 1.3 ft ²	VersiGard Black VersiFleece or VersiGard White VersiFleece / Flexible DASH or Flexible DASH DT (FULL)	-112.5

**TABLE 2C: STEEL OR STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, BONDED ROOF COVER**

System No.	Deck (Note 1)	Base Insulation Layer (Note 3, Note 13)	Top Insulation Layer			Roof Cover (Note 15)	MDP (psf)
			Type	Fasteners (Note 2, Note 11)	Attach		
SC-79	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1.5-inch thick, one or more layers, any combination, loose laid	Min. 0.5-inch SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 1.0 ft ²	VersiGard Black VersiFleece or VersiGard White VersiFleece / Flexible DASH or Flexible DASH DT (FULL)	-127.5
SC-80	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 2-inch SecurShield	Note 2	1 per 1.0 ft ²	VersiGard Black VersiFleece or VersiGard White VersiFleece / Flexible DASH or Flexible DASH DT (FULL)	-135.0
SC-81	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1.5-inch thick, one or more layers, any combination, loose laid	Min 7/16-inch APA or TECO rated OSB	Note 2	1 per 1.0 ft ²	VersiGard Black VersiFleece or VersiGard White VersiFleece / Flexible DASH or Flexible DASH DT (FULL)	-135.0
SC-82	Min. 22 ga., type B, Grade 80 steel or min. 2,500 psi structural concrete	Min. 1.5-inch thick, one or more layers, any combination, loose laid	0.5-inch DuraStorm VSH	Steel: Verisco Insultite with HPV Insulation Fastening Plate or SecurFast Insulation Fastening Plate Concrete: Note 2	1 per 1.0 ft ²	VersiGard Black VersiFleece or VersiGard White VersiFleece / Flexible DASH or Flexible DASH DT (FULL)	-135.0
MEMBRANE APPLIED IN VERISCO COLD APPLIED ADHESIVE:							
SC-83	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 0.5-inch Verisco Recovery Board	Note 2	1 per 2.0 ft ²	VersiFleece AC EPDM / Verisco Cold Applied Adhesive	-45.0*
SC-84	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 0.25-inch DensDeck Prime	Note 2	1 per 2.0 ft ²	VersiFleece AC EPDM / Verisco Cold Applied Adhesive	-45.0*
SC-85	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 2-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Note 2	1 per 1.6 ft ²	VersiFleece AC EPDM / Verisco Cold Applied Adhesive	-60.0

**TABLE 2D: STEEL OR STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE D-1: INSULATED, MECHANICALLY ATTACHED ROOF COVER (STRESS PLATES)**

System No.	Deck (Note 1)	Insulation (Note 3, Note 13)		Roof Cover (Note 15)			MDP (psf)
		Type	Attach (Note 5)	Membrane	Fasteners (Note 11)	Attachment	
SC-86	Min. 22 ga, type B, Grade 80 steel or min. 2,500 psi structural concrete	Min. 1.5" thick, one or more layers, any combination	Prelim attach	VersiGard Reinforced Standard or VersiGard Reinforced FR (0.070" thick)	Versico HPV Fastener (steel only), HD 14-10, CD-10 (concrete only) or MP Concrete-Spike (concrete only) with 2 in. Polymer Seam plates	12-inch o.c. within 7-inch wide laps spaced 115-inch o.c.	-30.0
SC-87	Min. 22 ga, type B, Grade 80 steel or min. 2,500 psi structural concrete	Min. 1.5" thick, one or more layers, any combination	Prelim attach	VersiGard Reinforced Standard or VersiGard Reinforced FR	Versico HPV Fastener (steel only), HD 14-10, CD-10 (concrete only) or MP Concrete-Spike (concrete only) with 2 in. Polymer Seam plates	12-inch o.c. within 6-inch wide laps spaced 90-inch o.c.	-30.0

**TABLE 2D: STEEL OR STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE D-1: INSULATED, MECHANICALLY ATTACHED ROOF COVER (STRESS PLATES)**

System No.	Deck (Note 1)	Insulation (Note 3, Note 13)		Roof Cover (Note 15)			MDP (psf)
		Type	Attach (Note 5)	Membrane	Fasteners (Note 11)	Attachment	
SC-88	Min. 22 ga, type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1.5" thick, one or more layers, any combination	Prelim attach	VersiGard Reinforced Standard or VersiGard Reinforced FR	Versico HPV Fastener (steel only), HD 14-10, CD-10 (concrete only) or MP Concrete-Spike (concrete only) with 2 in. Polymer Seam plates	6-inch o.c. within 6-inch wide laps spaced 114-inch o.c.	-37.5
SC-89	Min. 22 ga, type B, Grade 40 steel or min. 2,500 psi structural concrete	Min. 1.5" thick, one or more layers, any combination	Prelim attach	VersiGard Reinforced Standard or VersiGard Reinforced FR (0.070" thick)	Versico HPV Fastener (steel only), HD 14-10, CD-10 (concrete only) or MP Concrete-Spike (concrete only) with 2 in. Polymer Seam plates	6-inch o.c. within 6-inch wide laps spaced 114-inch o.c.	-52.5
SC-90	Min. 22 ga, type B, Grade 80 steel or min. 2,500 psi structural concrete	Min. 1.5" thick, one or more layers, any combination	Prelim attach	VersiGard Reinforced Standard or VersiGard Reinforced FR	Versico HPV Fastener (steel only), HD 14-10, CD-10 (concrete only) or MP Concrete-Spike (concrete only) with 2 in. Polymer Seam plates	6-inch o.c. within 6-inch wide laps spaced 114-inch o.c.	-52.5
SC-91	Min. 22 ga, type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1.5" thick, one or more layers, any combination	Prelim attach	VersiGard Reinforced Standard or VersiGard Reinforced FR	Versico HPV Fastener (steel only), HD 14-10, CD-10 (concrete only) or MP Concrete-Spike (concrete only) with 2 in. Polymer Seam plates	6-inch o.c. within 6-inch wide laps spaced 90-inch o.c.	-52.5
SC-92	Min. 22 ga, type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1.5" thick, one or more layers, any combination	Prelim attach	VersiGard White VersiFleece 145	Versico HPV Fastener (steel only), HD 14-10, CD-10 (concrete only) or MP Concrete-Spike (concrete only) with 2 in. Polymer Seam plates	6-inch o.c. within 6-inch wide laps spaced 112-inch o.c.	-52.5
SC-93	Min. 22 ga, type B, Grade 80 steel or min. 2,500 psi structural concrete	Min. 1.5" thick, one or more layers, any combination	Prelim attach	VersiGard Reinforced Standard or VersiGard Reinforced FR (0.070" thick)	Versico HPV Fastener (steel only), HD 14-10, CD-10 (concrete only) or MP Concrete-Spike (concrete only) with 2 in. Polymer Seam plates	6-inch o.c. within 7-inch wide laps spaced 115-inch o.c.	-60.0

**TABLE 2E: STEEL OR STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE D-1: INSULATED, MECHANICALLY ATTACHED ROOF COVER (BATTENS)**

System No.	Deck (Note 1)	Insulation (Note 3, Note 13)		Roof Cover (Note 15)			MDP (psf)
		Type	Attach (Note 5)	Membrane	Fasteners (Note 11)	Attachment	
SC-94	Min. 22 ga, type B, Grade 40 steel or min. 2,500 psi structural concrete	Min. 1.5" thick, one or more layers, any combination	Prelim attach	VersiGard Reinforced Standard or VersiGard Reinforced FR	Versico HPV-X (steel only), HD 14-10 (concrete only), CD-10 (concrete only) or MP Concrete-Spike (concrete only) with Steel Battens or Sure-Tite Fasteners (steel only) with Sure-Tite Fastening Bar	Fasteners 12-inch o.c. through batten within 6-inch wide laps spaced 114-inch o.c.	-30.0
SC-95	Min. 22 ga, type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1.5" thick, one or more layers, any combination	Prelim attach	VersiGard Reinforced Standard or VersiGard Reinforced FR	Versico HPV-X (steel only), HD 14-10 (concrete only), CD-10 (concrete only) or MP Concrete-Spike (concrete only) with OMG Polymer Batten Strip	Fasteners 12-inch o.c. through batten within 6-inch wide laps spaced 90-inch o.c.	-30.0
SC-96	Min. 22 ga, type B, Grade 80 steel or min. 2,500 psi structural concrete	Min. 1.5" thick, one or more layers, any combination	Prelim attach	VersiGard Reinforced Standard or VersiGard Reinforced FR	Versico HPV-X (steel only), HD 14-10 (concrete only), CD-10 (concrete only) or MP Concrete-Spike (concrete only) with Steel Battens	Fasteners 12-inch o.c. through batten within 6-inch wide laps spaced 90-inch o.c.	-30.0

**TABLE 2E: STEEL OR STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE D-1: INSULATED, MECHANICALLY ATTACHED ROOF COVER (BATTENS)**

System No.	Deck (Note 1)	Insulation (Note 3, Note 13)		Roof Cover (Note 15)			MDP (psf)
		Type	Attach (Note 5)	Membrane	Fasteners (Note 11)	Attachment	
SC-97	Min. 22 ga, type B, Grade 80 steel or min. 2,500 psi structural concrete	Min. 1.5" thick, one or more layers, any combination	Prelim attach	VersiGard Reinforced Standard or VersiGard Reinforced FR	Versico HPV-X (steel only), HD 14-10 (concrete only), CD-10 (concrete only) or MP Concrete-Spike (concrete only) with Steel Battens or Sure-Tite Fasteners (steel only) with Sure-Tite Fastening Bar	Fasteners 12-inch o.c. through batten within min. 5-inch wide laps spaced max 115-inch o.c.	-37.5
SC-98	Min. 22 ga, type B, Grade 80 steel	Min. 1.5" thick, one or more layers, any combination	Prelim attach	VersiGard Reinforced Standard or VersiGard Reinforced FR	Sure-Tite Fasteners (steel only) with Sure-Tite Fastening Bar	Fasteners 12-inch o.c. through batten within 6-inch wide laps spaced 114-inch o.c.	-45.0
SC-99	Min. 22 ga, type B, Grade 33 steel	Min. 1.5" thick, one or more layers, any combination	Prelim attach	VersiGard Reinforced Standard or VersiGard Reinforced FR	Sure-Tite Fasteners (steel only) with Sure-Tite Fastening Bar	Fasteners 12-inch o.c. through batten within 6-inch wide laps spaced 90-inch o.c.	-45.0
SC-100	Min. 22 ga, type B, Grade 40 steel or min. 2,500 psi structural concrete	Min. 1.5" thick, one or more layers, any combination	Prelim attach	VersiGard Reinforced Standard or VersiGard Reinforced FR	Versico HPV-X (steel only), HD 14-10 (concrete only), CD-10 (concrete only) or MP Concrete-Spike (concrete only) with Steel Battens or Sure-Tite Fasteners (steel only) with Sure-Tite Fastening Bar	Fasteners 6-inch o.c. through batten within 6-inch wide laps spaced 114-inch o.c.	-52.5
SC-101	Min. 22 ga, type B, Grade 80 steel	Min. 1.5" thick, one or more layers, any combination	Prelim attach	VersiGard Reinforced Standard or VersiGard Reinforced FR	Sure-Tite Fasteners (steel only) with Sure-Tite Fastening Bar	Fasteners 12-inch o.c. through batten within 6-inch wide laps spaced 90-inch o.c.	-52.5
SC-102	Min. 22 ga, type B, Grade 80 steel or min. 2,500 psi structural concrete	Min. 1.5" thick, one or more layers, any combination	Prelim attach	VersiGard Reinforced Standard or VersiGard Reinforced FR	Versico HPV-X (steel only), HD 14-10 (concrete only), CD-10 (concrete only) or MP Concrete-Spike (concrete only) with Steel Battens or Sure-Tite Fasteners (steel only) with Sure-Tite Fastening Bar	Fasteners 6-inch o.c. through batten within min. 5-inch wide laps spaced max. 115-inch o.c.	-60.0
SC-103	Min. 22 ga, type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1.5" thick, one or more layers, any combination	Prelim attach	VersiGard Reinforced Standard or VersiGard Reinforced FR	Versico HPV-X (steel only), HD 14-10 (concrete only), CD-10 (concrete only) or MP Concrete-Spike (concrete only) with OMG Polymer Batten Strip	Fasteners 6-inch o.c. through batten within 6-inch wide laps spaced 90-inch o.c.	-60.0
SC-104	Min. 22 ga, type B, Grade 80 steel or min. 2,500 psi structural concrete	Min. 1.5" thick, one or more layers, any combination	Prelim attach	VersiGard Reinforced Standard or VersiGard Reinforced FR	Versico HPV-X (steel only), HD 14-10 (concrete only), CD-10 (concrete only) or MP Concrete-Spike (concrete only) with Steel Battens	Fasteners 6-inch o.c. through batten within 6-inch wide laps spaced 90-inch o.c.	-82.5

**TABLE 3A: CONCRETE DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER**

NOTE: REFER TO NOTE 16 FOR VAPOR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Membrane	Application	
MEMBRANE APPLIED IN CAV-GRIP 3V ADHESIVE / PRIMER OR G200SA YELLOW SUBSTRATE ADHESIVE:								
C-1.	Min. 2,500 psi structural concrete (primed)	Min. 0.5-inch VersiCore or SecurShield	Hot Asphalt	(Optional) Additional layers of base insulation	Hot Asphalt	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-157.5
C-2.	Min. 2,500 psi structural concrete (primed)	Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Hot Asphalt	(Optional) Additional layers of base insulation	Hot Asphalt	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-330.0
C-3.	Min. 2,500 psi structural concrete (primed)	Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Hot Asphalt	Min 0.5-inch Verisco Recovery Board	Hot Asphalt	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-330.0
C-4.	Min. 2,500 psi structural concrete (primed)	Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Hot Asphalt	Min. 0.25-inch DensDeck, DensDeck Prime	Hot Asphalt	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-352.5
C-5.	Min. 2,500 psi structural concrete	Min. 1.5-inch InsulLam (OSB)	Flexible DASH or Flexible DASH DT (FULL)	None	N/A	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-105.0
C-6.	Min. 2,500 psi structural concrete	Min. 0.5-inch VersiCore or SecurShield	Flexible DASH or Flexible DASH DT (RIBBON)	(Optional) Additional layers of base insulation	Flexible DASH or Flexible DASH DT (RIBBON)	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-157.5
C-7.	Min. 2,500 psi structural concrete	Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Flexible DASH or Flexible DASH DT (RIBBON)	Min 0.5-inch Verisco Recovery Board	Flexible DASH or Flexible DASH DT (RIBBON)	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-157.5
C-8.	Min. 2,500 psi structural concrete	Min. 0.5-inch VersiCore or SecurShield	Flexible DASH or Flexible DASH DT (RIBBON)	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Flexible DASH or Flexible DASH DT (RIBBON)	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-157.5

TABLE 3A: CONCRETE DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

NOTE: REFER TO NOTE 16 FOR VAPOR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Membrane	Application	
C-9.	Min. 2,500 psi structural concrete	Min. 0.5-inch VersiCore, SecurShield	Flexible DASH or Flexible DASH DT (RIBBON)	<u>Insulation:</u> (Optional) Additional layer(s) base insulation <u>Coverboard:</u> Min. 0.5-inch SecurShield HD, SecurShield HD Plus or DuraStorm VSH	Flexible DASH or Flexible DASH DT (RIBBON)	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-157.5
C-10.	Min. 2,500 psi structural concrete	Min. 1.5-inch Insullam (GYP)	Flexible DASH or Flexible DASH DT (FULL)	None	N/A	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-157.5
C-11.	Min. 2,500 psi structural concrete	Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Flexible DASH or Flexible DASH DT (RIBBON)	Min. 0.25-inch DensDeck, DensDeck Prime	Flexible DASH or Flexible DASH DT (RIBBON)	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-232.5
C-12.	Min. 2,500 psi structural concrete	Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Flexible DASH or Flexible DASH DT (RIBBON)	(Optional) Additional layers of base insulation	Flexible DASH or Flexible DASH DT (RIBBON)	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-240.0
C-13.	Min. 2,500 psi structural concrete	Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Flexible DASH or Flexible DASH DT (RIBBON)	Min. 2-inch Polyiso HP-H Composite	Flexible DASH or Flexible DASH DT (RIBBON)	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-240.0
C-14.	Min. 2,500 psi structural concrete	Min. 1.5-inch Insullam (WF)	Flexible DASH or Flexible DASH DT (FULL)	None	N/A	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-255.0
C-15.	Min. 2,500 psi structural concrete	(Optional) Min. 1.5-inch SecurShield or H-Shield CG	Flexible DASH or Flexible DASH DT (RIBBON)	Min. 1.5-inch SecurShield HD Composite or H-Shield HD Composite	Flexible DASH or Flexible DASH DT (RIBBON)	VersiGard Non-Reinforced, VersiGard Reinforced Standard or VersiGard Reinforced FR	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-270.0
C-16.	Min. 2,500 psi structural concrete	Min. 1.5-inch Insulfoam HD Composite	Flexible DASH or Flexible DASH DT (FULL)	None	N/A	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-270.0

TABLE 3A: CONCRETE DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

NOTE: REFER TO NOTE 16 FOR VAPOR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Membrane	Application	
C-17.	Min. 2,500 psi structural concrete	Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Flexible DASH or Flexible DASH DT (FULL)	(Optional) Additional layers of base insulation	Flexible DASH or Flexible DASH DT (FULL)	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-330.0
C-18.	Min. 2,500 psi structural concrete	Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Flexible DASH or Flexible DASH DT (FULL)	Min 0.5-inch Verisco Recovery Board	Flexible DASH or Flexible DASH DT (FULL)	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-330.0
C-19.	Min. 2,500 psi structural concrete	Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Flexible DASH or Flexible DASH DT (FULL)	Min. 2-inch Polyiso HP-H Composite	Flexible DASH or Flexible DASH DT (FULL)	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-330.0
C-20.	Min. 2,500 psi structural concrete	(Optional) Min. 1.5-inch VersiCore, SecurShield or Min. 1-inch Insulfoam I, II, IX, VIII, XIV or XV	Flexible DASH (RIBBON)	<u>Insulation:</u> (Optional) Additional layer(s) base insulation <u>Coverboard:</u> Min. 0.5-inch SecurShield HD, SecurShield HD Plus or DuraStorm VSH	Flexible DASH (RIBBON)	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-352.5
C-21.	Min. 2,500 psi structural concrete	0.5-inch DuraStorm VSH	Flexible DASH or Flexible DASH DT (FULL)	<u>None</u>	N/A	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-495.0
C-22.	Min. 2,500 psi structural concrete	Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	OB500	Min 0.5-inch Verisco Recovery Board	OB500	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-120.0
C-23.	Min. 2,500 psi structural concrete	Min. 1.0-inch Foamular 250	OB500	Min 0.5-inch Verisco Recovery Board	OB500	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-120.0
C-24.	Min. 2,500 psi structural concrete	Min. 2.0-inch, min. 1.0 pcf, Insulfoam	OB500	Min. 0.25-inch DensDeck or DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	OB500	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-120.0

TABLE 3A: CONCRETE DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

NOTE: REFER TO NOTE 16 FOR VAPOR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Membrane	Application	
C-25.	Min. 2,500 psi structural concrete	Min. 1.5-inch Polyiso MP-N or Polyiso MP-W	OB500	(Optional) Additional layers of base insulation	OB500	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-150.0
C-26.	Min. 2,500 psi structural concrete	Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	OB500	Min. 0.25-inch DensDeck, DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	OB500	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-150.0
C-27.	Min. 2,500 psi structural concrete	Min. 0.5-inch VersiCore or SecurShield	OB500	(Optional) Additional layers of base insulation	OB500	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-157.5
C-28.	Min. 2,500 psi structural concrete	Min. 1.0-inch Styrofoam Roofmate or Highload 60	OB500	Min. 0.25-inch DensDeck, DensDeck Prime	OB500	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-232.5
C-29.	Min. 2,500 psi structural concrete	Min. 1.0-inch Foamular 250	OB500	Min. 0.25-inch DensDeck or DensDeck Prime	OB500	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-277.5
MEMBRANE APPLIED IN AQUA BASE 120 BA ADHESIVE:								
C-30.	Min. 2,500 psi structural concrete (primed)	(Optional) Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Hot Asphalt	Min. 0.5-inch Verisco Recovery Board	Hot Asphalt	VersiGard Non-Reinforced, VersiGard Reinforced Standard or VersiGard Reinforced FR	Aqua Base 120 BA	-90.0
C-31.	Min. 2,500 psi structural concrete (primed)	Min. 0.5-inch VersiCore or SecurShield	Hot Asphalt	(Optional) Additional layers of base insulation	Hot Asphalt	VersiGard Non-Reinforced, VersiGard Reinforced Standard or VersiGard Reinforced FR	Aqua Base 120 BA	-157.5
C-32.	Min. 2,500 psi structural concrete (primed)	Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Hot Asphalt	(Optional) Additional layers of base insulation	Hot Asphalt	VersiGard Non-Reinforced, VersiGard Reinforced Standard or VersiGard Reinforced FR	Aqua Base 120 BA	-165.0
C-33.	Min. 2,500 psi structural concrete (primed)	(Optional) Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Hot Asphalt	Min. 0.25-inch DensDeck Prime	Hot Asphalt	VersiGard Non-Reinforced, VersiGard Reinforced Standard or VersiGard Reinforced FR	Aqua Base 120 BA	-165.0

TABLE 3A: CONCRETE DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

NOTE: REFER TO NOTE 16 FOR VAPOR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Membrane	Application	
C-34.	Min. 2,500 psi structural concrete	(Optional) Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Flexible DASH or Flexible DASH DT (RIBBON)	Min. 0.5-inch Verisco Recovery Board	Flexible DASH or Flexible DASH DT (RIBBON)	VersiGard Non-Reinforced, VersiGard Reinforced Standard or VersiGard Reinforced FR	Aqua Base 120 BA	-90.0
C-35.	Min. 2,500 psi structural concrete	Min. 1-inch Insulfoam I	Flexible DASH or Flexible DASH DT (RIBBON)	Min. 0.5-inch Verisco Recovery Board	Flexible DASH or Flexible DASH DT (RIBBON)	VersiGard Non-Reinforced, VersiGard Reinforced Standard or VersiGard Reinforced FR	Aqua Base 120 BA	-90.0
C-36.	Min. 2,500 psi structural concrete	Min. 1.5-inch Insullam (WF)	Flexible DASH or Flexible DASH DT (FULL)	None	N/A	VersiGard Non-Reinforced, VersiGard White Standard, VersiGard Reinforced Standard or VersiGard Reinforced FR	Aqua Base 120 BA	-90.0
C-37.	Min. 2,500 psi structural concrete	Min. 0.5-inch VersiCore or SecurShield	Flexible DASH or Flexible DASH DT (RIBBON)	(Optional) Additional layers of base insulation	Flexible DASH or Flexible DASH DT (RIBBON)	VersiGard Non-Reinforced, VersiGard Reinforced Standard or VersiGard Reinforced FR	Aqua Base 120 BA	-157.5
C-38.	Min. 2,500 psi structural concrete	Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Flexible DASH or Flexible DASH DT (RIBBON)	(Optional) Additional layers of base insulation	Flexible DASH or Flexible DASH DT (RIBBON)	VersiGard Non-Reinforced, VersiGard Reinforced Standard or VersiGard Reinforced FR	Aqua Base 120 BA	-165.0
C-39.	Min. 2,500 psi structural concrete	(Optional) Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Flexible DASH or Flexible DASH DT (RIBBON)	Min. 0.25-inch DensDeck Prime	Flexible DASH or Flexible DASH DT (RIBBON)	VersiGard Non-Reinforced, VersiGard Reinforced Standard or VersiGard Reinforced FR	Aqua Base 120 BA	-165.0
C-40.	Min. 2,500 psi structural concrete	Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Flexible DASH or Flexible DASH DT (FULL)	(Optional) Additional layers of base insulation	Flexible DASH or Flexible DASH DT (FULL)	VersiGard Black VersiFleece or VersiGard White VersiFleece	Aqua Base 120 BA	-232.5
C-41.	Min. 2,500 psi structural concrete	Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	OB500	(Optional) Additional layers of base insulation	OB500	VersiGard Non-Reinforced, VersiGard Reinforced Standard or VersiGard Reinforced FR	Aqua Base 120 BA	-105.0
C-42.	Min. 2,500 psi structural concrete	(Optional) Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	OB500	Min. 0.5-inch Verisco Recovery Board	OB500	VersiGard Non-Reinforced, VersiGard Reinforced Standard or VersiGard Reinforced FR	Aqua Base 120 BA	-90.0
C-43.	Min. 2,500 psi structural concrete	(Optional) Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	OB500	Min. 0.25-inch DensDeck Prime	OB500	VersiGard Non-Reinforced, VersiGard Reinforced Standard or VersiGard Reinforced FR	Aqua Base 120 BA	-150.0

MEMBRANE APPLIED IN EPDM X-23 LOW-VOC BONDING ADHESIVE:

**TABLE 3A: CONCRETE DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER**

NOTE: REFER TO NOTE 16 FOR VAPOR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Membrane	Application	
C-44.	Min. 2,500 psi structural concrete	Min. 0.5-inch VersiCore or SecurShield	Flexible DASH or Flexible DASH DT (RIBBON)	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Flexible DASH or Flexible DASH DT (RIBBON)	VersiGard Non-Reinforced, VersiGard Reinforced Standard or VersiGard Reinforced FR	EPDM x-23 Low-VOC Bonding Adhesive	-75.0
C-45.	Min. 2,500 psi structural concrete	Min. 1.5-inch InsulLam (GYP)	Flexible DASH or Flexible DASH DT (FULL)	None	N/A	VersiGard Non-Reinforced, VersiGard Reinforced Standard or VersiGard Reinforced FR	EPDM x-23 Low-VOC Bonding Adhesive	-75.0
C-46.	Min. 2,500 psi structural concrete	(Optional) Min. 1.5-inch SecurShield or H-Shield CG	Flexible DASH or Flexible DASH DT (RIBBON)	Min. 1.5-inch SecurShield HD Composite or H-Shield HD Composite	Flexible DASH or Flexible DASH DT (RIBBON)	VersiGard Non-Reinforced, VersiGard Reinforced Standard or VersiGard Reinforced FR	EPDM x-23 Low-VOC Bonding Adhesive	-285.0
C-47.	Min. 2,500 psi structural concrete	Min. 1.5-inch Insulfoam HD Composite	Flexible DASH or Flexible DASH DT (FULL)	None	N/A	VersiGard Non-Reinforced, VersiGard Reinforced Standard or VersiGard Reinforced FR	EPDM x-23 Low-VOC Bonding Adhesive	-472.5
C-48.	Min. 2,500 psi structural concrete	(Optional) Min. 1.5-inch SecurShield or H-Shield CG	Flexible DASH or Flexible DASH DT (FULL)	Min. 1.5-inch SecurShield HD Composite or H-Shield HD Composite	Flexible DASH or Flexible DASH DT (FULL)	VersiGard Non-Reinforced, VersiGard Reinforced Standard or VersiGard Reinforced FR	EPDM x-23 Low-VOC Bonding Adhesive	-495.0
MEMBRANE APPLIED IN FLEXIBLE DASH OR FLEXIBLE DASH DUAL-TANK:								
C-49.	Min. 2,500 psi structural concrete	(Optional) Min. 0.5-inch VersiCore, SecurShield or Min. 1-inch Insulfoam I, II, IX, VIII, XIV or XV	Flexible DASH or Flexible DASH DT (RIBBON)	<u>Insulation:</u> (Optional) Additional layer(s) base insulation <u>Coverboard:</u> Min. 0.5-inch DuraStorm VSH	Flexible DASH or Flexible DASH DT (RIBBON)	VersiGard Black VersiFleece or VersiGard White VersiFleece	Flexible DASH or Flexible DASH DT (RIBBON, 6-inch o.c.)	-90.0
C-50.	Min. 2,500 psi structural concrete	Min. 1-inch Insulfoam I	Flexible DASH or Flexible DASH DT (RIBBON)	Min. 0.5-inch Verisco Recovery Board	Flexible DASH or Flexible DASH DT (RIBBON)	VersiGard Black VersiFleece or VersiGard White VersiFleece	Flexible DASH or Flexible DASH DT (FULL)	-142.5
C-51.	Min. 2,500 psi structural concrete	Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Flexible DASH or Flexible DASH DT (RIBBON)	Min. 0.5-inch Verisco Recovery Board	Flexible DASH or Flexible DASH DT (RIBBON)	VersiGard Black VersiFleece or VersiGard White VersiFleece	Flexible DASH or Flexible DASH DT (FULL)	-157.5
C-52.	Min. 2,500 psi structural concrete	Min. 1.5-inch Kingspan GreenGuard or Min. 1.0-inch Dow STYROFOAM ROOFMATE	Flexible DASH or Flexible DASH DT (RIBBON)	Min. 0.5-inch Verisco Recovery Board	Flexible DASH or Flexible DASH DT (RIBBON)	VersiGard Black VersiFleece or VersiGard White VersiFleece	Flexible DASH or Flexible DASH DT (FULL)	-157.5

TABLE 3A: CONCRETE DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

NOTE: REFER TO NOTE 16 FOR VAPOR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Membrane	Application	
C-53.	Min. 2,500 psi structural concrete	Min. 0.5-inch VersiCore, SecurShield	Flexible DASH or Flexible DASH DT (RIBBON)	Insulation: (Optional) Additional layer(s) base insulation Coverboard: Min. 0.5-inch SecurShield HD, SecurShield HD Plus or DuraStorm VSH	Flexible DASH or Flexible DASH DT (RIBBON)	VersiGard Black VersiFleece or VersiGard White VersiFleece	Flexible DASH or Flexible DASH DT (FULL)	-157.5
C-54.	Min. 2,500 psi structural concrete	(Optional) VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Flexible DASH or Flexible DASH DT (FULL)	Polyiso MP-NB, DuraFaceR, H-Shield NB	Flexible DASH or Flexible DASH DT (FULL)	VersiGard Black VersiFleece or VersiGard White VersiFleece	Flexible DASH or Flexible DASH DT (FULL)	-187.5
C-55.	Min. 2,500 psi structural concrete	Min. 0.5-inch Verisco Recovery Board	Flexible DASH or Flexible DASH DT (RIBBON)	None	N/A	VersiGard Black VersiFleece or VersiGard White VersiFleece	Flexible DASH or Flexible DASH DT (FULL)	-202.5
C-56.	Min. 2,500 psi structural concrete	(Optional) Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Flexible DASH or Flexible DASH DT (RIBBON)	Min. 7/16-inch APA rated OSB or min. 0.25-inch DensDeck or DensDeck Prime	Flexible DASH or Flexible DASH DT (RIBBON)	VersiGard Black VersiFleece or VersiGard White VersiFleece	Flexible DASH or Flexible DASH DT (FULL)	-240.0
C-57.	Min. 2,500 psi structural concrete	Min. 1.5-inch Insullam (WF)	Flexible DASH or Flexible DASH DT (FULL)	None	N/A	VersiGard Black VersiFleece or VersiGard White VersiFleece	Flexible DASH or Flexible DASH DT (FULL)	-255.0
C-58.	Min. 2,500 psi structural concrete	Min. 1-inch Insulfoam I	Flexible DASH or Flexible DASH DT (FULL)	Min. 0.5-inch Verisco Recovery Board	Flexible DASH or Flexible DASH DT (FULL)	VersiGard Black VersiFleece or VersiGard White VersiFleece	Flexible DASH or Flexible DASH DT (FULL)	-300.0
C-59.	Min. 2,500 psi structural concrete	Min. 1-inch FM Approved EPS (BASF, NOVA, or Huntsman beads)	Flexible DASH or Flexible DASH DT (FULL)	Min. 0.5-inch Verisco Recovery Board	Flexible DASH or Flexible DASH DT (FULL)	VersiGard Black VersiFleece or VersiGard White VersiFleece	Flexible DASH or Flexible DASH DT (FULL)	-322.5
C-60.	Min. 2,500 psi structural concrete	Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Flexible DASH or Flexible DASH DT (FULL)	Min. 0.5-inch Verisco Recovery Board	Flexible DASH or Flexible DASH DT (FULL)	VersiGard Black VersiFleece or VersiGard White VersiFleece	Flexible DASH or Flexible DASH DT (FULL)	-330.0
C-61.	Min. 2,500 psi structural concrete	Min. 1.5-inch Kingspan GreenGuard or Min. 1.0-inch Dow STYROFOAM ROOFMATE	Flexible DASH or Flexible DASH DT (FULL)	Min. 0.5-inch Verisco Recovery Board	Flexible DASH or Flexible DASH DT (FULL)	VersiGard Black VersiFleece or VersiGard White VersiFleece	Flexible DASH or Flexible DASH DT (FULL)	-330.0

**TABLE 3A: CONCRETE DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER**

NOTE: REFER TO NOTE 16 FOR VAPOR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Membrane	Application	
C-62.	Min. 2,500 psi structural concrete	(Optional) Min. 1.5-inch VersiCore, SecurShield or Min. 1-inch Insulfoam I, II, IX, VIII, XIV or XV	Flexible DASH (RIBBON)	<u>Insulation:</u> (Optional) Additional layer(s) base insulation <u>Coverboard:</u> Min. 0.5-inch SecurShield HD, SecurShield HD Plus or DuraStorm VSH	Flexible DASH (RIBBON)	VersiGard Black VersiFleece or VersiGard White VersiFleece	Flexible DASH or Flexible DASH DT (FULL)	-352.5
C-63.	Min. 2,500 psi structural concrete	(Optional) Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Flexible DASH or Flexible DASH DT (FULL)	Min. 7/16-inch APA rated OSB or min. 0.25-inch DensDeck or DensDeck Prime	Flexible DASH or Flexible DASH DT (FULL)	VersiGard Black VersiFleece or VersiGard White VersiFleece	Flexible DASH or Flexible DASH DT (FULL)	-457.5
C-64.	Min. 2,500 psi structural concrete	Min. 1.5-inch Insullam (OSB)	Flexible DASH or Flexible DASH DT (FULL)	None	N/A	VersiGard Black VersiFleece or VersiGard White VersiFleece	Flexible DASH or Flexible DASH DT (FULL)	-457.5
C-65.	Min. 2,500 psi structural concrete	DuraStorm VSH	Flexible DASH or Flexible DASH DT (FULL)	None	N/A	VersiGard Black VersiFleece or VersiGard White VersiFleece	Flexible DASH or Flexible DASH DT (FULL)	-495.0
MEMBRANE APPLIED IN HOT ASPHALT:								
C-66.	Min. 2,500 psi structural concrete (primed)	(Optional) Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	HA	Min. 0.5-inch Verisco Recovery Board	HA	VersiFleece AC EPDM	Hot Asphalt	-150.0
MEMBRANE APPLIED IN VERISCO COLD APPLIED ADHESIVE:								
C-67.	Min. 2,500 psi structural concrete	(Optional) Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Flexible DASH or Flexible DASH DT (RIBBON)	Min. 0.5-inch Verisco Recovery Board	Flexible DASH or Flexible DASH DT (RIBBON)	VersiFleece AC EPDM	Verisco Cold Applied Adhesive	-157.5
C-68.	Min. 2,500 psi structural concrete	(Optional) Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Flexible DASH or Flexible DASH DT (RIBBON)	Min. 0.25-inch DensDeck or DensDeck Prime	Flexible DASH or Flexible DASH DT (RIBBON)	VersiFleece AC EPDM	Verisco Cold Applied Adhesive	-240.0
C-69.	Min. 2,500 psi structural concrete	Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Flexible DASH or Flexible DASH DT (RIBBON)	(Optional) Additional layers of base insulation	Flexible DASH or Flexible DASH DT (RIBBON)	VersiFleece AC EPDM	Verisco Cold Applied Adhesive	-240.0

TABLE 3A: CONCRETE DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

NOTE: REFER TO NOTE 16 FOR VAPOR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Membrane	Application	
C-70.	Min. 2,500 psi structural concrete	(Optional) Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Flexible DASH or Flexible DASH DT (FULL)	Min. 0.5-inch Verisco Recovery Board	Flexible DASH or Flexible DASH DT (FULL)	VersiFleece AC EPDM	Verisco Cold Applied Adhesive	-330.0
C-71.	Min. 2,500 psi structural concrete	(Optional) Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Flexible DASH or Flexible DASH DT (FULL)	Min. 0.25-inch DensDeck or DensDeck Prime	Flexible DASH or Flexible DASH DT (FULL)	VersiFleece AC EPDM	Verisco Cold Applied Adhesive	-375.0
C-72.	Min. 2,500 psi structural concrete	Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Flexible DASH or Flexible DASH DT (FULL)	(Optional) Additional layers of base insulation	Flexible DASH or Flexible DASH DT (FULL)	VersiFleece AC EPDM	Verisco Cold Applied Adhesive	-457.5

TABLE 3B: CONCRETE DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE F: NON-INSULATED, BONDED ROOF COVER

System No.	Deck (Note 1)	Roof Cover (Note 15)		MDP (psf)
		Membrane	Application	
C-73.	Min. 2,500 psi structural concrete	VersiGard White Standard	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-240.0
C-74.	Min. 2,500 psi structural concrete	VersiGard Reinforced Standard or VersiGard Reinforced FR	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-240.0
C-75.	Min. 2,500 psi structural concrete	VersiGard Non-Reinforced	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-315.0
C-76.	Min. 2,500 psi structural concrete	VersiGard Black VersiFleece or VersiGard White VersiFleece	Flexible DASH or Flexible DASH DT (FULL).	-495.0
C-77.	Min. 2,500 psi structural concrete	VersiFleece AC EPDM	Hot Asphalt	-97.5
C-78.	Min. 2,500 psi structural concrete primed with CCW-702 or D41 primer	VersiFleece AC EPDM	Hot Asphalt	-495.0

**TABLE 4A: LIGHTWEIGHT CONCRETE OVER STEEL OR STRUCTURAL CONCRETE DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-2: MECHANICALLY ATTACHED ANCHOR SHEET, BONDED INSULATION, BONDED ROOF COVER**

System No.	Deck (Note 1)	LWC (Note 14)	Anchor Sheet			Insulation			Roof Cover (Note 15)	MDP (psf)
			Type	Fasteners	Attach	Base	Top	Attach (Notes 6,7,8)		
ELASTIZELL (NOA 23-0817.05):										
LWC-1	Min. 22 ga., Type B, Grade 33 vented steel or min. 2,500 psi structural concrete	Min. 250 psi, Min. 2-inch thick, Elastizell Range II LWIC	Johns Manville Perma Ply 28	OMG CR Assembled Base Sheet Fasteners	9-inch o.c. in the 3-inch side lap and 9-inch o.c. in two staggered rows in the center of the sheet	Min. 1.0-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Min. 1.0-inch Verisco Recovery Board	Hot asphalt	VersiFleece AC EPDM / Hot asphalt	-45.0

**TABLE 4B: LIGHTWEIGHT CONCRETE OVER STEEL OR STRUCTURAL CONCRETE DECKS – NEW CONSTRUCTION
SYSTEM TYPE F: NON-INSULATED, BONDED ROOF COVER**

System No.	Deck (Note 1)	LWC (Note 14)		Roof Cover (Note 15)		MDP (psf)
		Type	Surface Treatment	Membrane	Application	
CELCORE (FL2037):						
MEMBRANE APPLIED IN FLEXIBLE DASH OR FLEXIBLE FAST DUAL-TANK:						
LWC-2	Min. 22 ga., Type BV, Grade 33 steel; max. 6 ft spans	Min. 36 pcf wet cast density, min. 200 psi, min. 2-inch thick Celcore MF Cellular Concrete.	(Optional) Celcore PVA Curing Compound	VersiGard Black VersiFleece or VersiGard White VersiFleece	Flexible DASH or Flexible DASH DT (FULL)	-60.0
LWC-3	Min. 22 ga., Type BV, Grade 33 steel; max. 4 ft spans.	Min. 38 pcf wet cast density, min. 200 psi, min. 2-inch thick Celcore MF Cellular Concrete with Celcore HS Rheology Modifying Admixture.	Celcore PVA Curing Compound	VersiGard Black VersiFleece or VersiGard White VersiFleece	Flexible DASH or Flexible DASH DT (FULL)	-67.5
LWC-4	Min. 22 ga., Type BV, Grade 33 steel; max. 6 ft spans	Min. 36 pcf wet cast density, min. 200 psi, min. 2-inch thick Celcore MF Cellular Concrete. When walkable, LWIC is attached with HPV Fasteners & Insulation Plates at a density of 1 per 9 ft ² .	(Optional) Celcore PVA Curing Compound	VersiGard Black VersiFleece or VersiGard White VersiFleece	Flexible DASH or Flexible DASH DT (FULL)	-67.5
LWC-5	Min. 22 ga., Type BV, Grade 33 steel; max. 6 ft spans	Min. 36 pcf wet cast density, min. 200 psi, min. 2-inch thick Celcore MF Cellular Concrete. When walkable, LWIC is attached with HPV Fasteners & Insulation Plates at a density of 1 per 1.0 ft ² .	(Optional) Celcore PVA Curing Compound	VersiGard Black VersiFleece or VersiGard White VersiFleece	Flexible DASH or Flexible DASH DT (FULL)	-120.0
ELASTIZELL (NOA 23-0817.05):						
MEMBRANE APPLIED IN FLEXIBLE DASH OR FLEXIBLE FAST DUAL-TANK:						
LWC-6	Min. 22 ga., Type BV, Grade 33 steel; max. 6 ft spans.	Min. 27 pcf wet cast density, min. 250 psi, min. 2-inch thick, Elastizell Range II LWIC	None	VersiGard Black VersiFleece or VersiGard White VersiFleece	Flexible DASH or Flexible DASH DT (FULL)	-30.0
LWC-7	Min. 22 ga., Type BV, Grade 33 steel; max. 5 ft spans.	Min. 27 pcf wet cast density, min. 250 psi, min. 2-inch thick, Elastizell Range II LWIC	None	VersiGard Black VersiFleece or VersiGard White VersiFleece	Flexible DASH or Flexible DASH DT (FULL)	-45.0
LWC-8	Min. 22 ga., Type BV, Grade 33 steel; max. 5 ft spans; primed with Zell Bonding Agent.	Min. 27 pcf wet cast density, min. 250 psi, min. 2-inch thick, Elastizell Range II LWIC	None	VersiGard Black VersiFleece or VersiGard White VersiFleece	Flexible DASH or Flexible DASH DT (FULL)	-60.0
LWC-9	Min. 2,500 psi structural concrete	Min. 27 pcf wet cast density, min. 250 psi, min. 2-inch thick, Elastizell Range II LWIC	None	VersiGard Black VersiFleece or VersiGard White VersiFleece	Flexible DASH or Flexible DASH DT (FULL)	-90.0

TABLE 5A: RECOVER APPLICATIONS
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

^A The reported MDP documents the allowable maximum design pressure of the new insulation, coverboard and roof cover when adhered to the substrate, irrespective of the deck type (See Note 1) or performance of the substrate (See Note 12). The deck and substrate shall be capable of resisting the project design pressure requirements, not to exceed the noted MDP, to the satisfaction of the Authority Having Jurisdiction.

System No.	Substrate (Note 1, Note 12)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)		MDP (psf) ^A
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Membrane	Application	
MEMBRANE APPLIED IN CAV-GRIP 3V ADHESIVE / PRIMER OR G200SA YELLOW SUBSTRATE ADHESIVE:								
R-1	Existing asphaltic BUR	Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Hot Asphalt	(Optional) Additional layers of base insulation	Hot Asphalt	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-330.0
R-2	Existing asphaltic BUR	Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Hot Asphalt	Min 0.5-inch Verisco Recovery Board	Hot Asphalt	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-330.0
R-3	Existing asphaltic BUR	Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Hot Asphalt	Min. 0.25-inch DensDeck, DensDeck Prime	Hot Asphalt	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-352.5
R-4	Existing fully-adhered granule-surfaced asphalt built-up roof (BUR), smooth-surfaced asphalt built-up roof (BUR), granule-surfaced APP or SBS modified bitumen or smooth-surfaced SBS modified bitumen	Min. 1-inch VersiCore, SecurShield	Flexible DASH or Flexible DASH DT (RIBBON)	<u>Insulation:</u> (Optional) Additional layer(s) base insulation <u>Coverboard:</u> (Optional) Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board or min. 0.5-inch SecurShield HD, SecurShield HD Plus or DuraStorm VSH	Flexible DASH or Flexible DASH DT (RIBBON)	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-167.5

TABLE 5A: RECOVER APPLICATIONS
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

^A The reported MDP documents the allowable maximum design pressure of the new insulation, coverboard and roof cover when adhered to the substrate, irrespective of the deck type (See Note 1) or performance of the substrate (See Note 12). The deck and substrate shall be capable of resisting the project design pressure requirements, not to exceed the noted MDP, to the satisfaction of the Authority Having Jurisdiction.

System No.	Substrate (Note 1 , Note 12)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)		MDP (psf) ^A
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Membrane	Application	
R-5	Existing fully-adhered asphalt built-up roof (BUR) with flood coat & gravel (loose gravel removed)	Min. 1-inch VersiCore, SecurShield	Flexible DASH or Flexible DASH DT (RIBBON, 6-inch o.c.)	Insulation: (Optional) Additional layer(s) base insulation Coverboard: (Optional) Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board or min. 0.5-inch SecurShield HD, SecurShield HD Plus or DuraStorm VSH	Flexible DASH or Flexible DASH DT (RIBBON)	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-167.5
R-6	Existing fully-adhered granule-surfaced asphalt built-up roof (BUR), smooth-surfaced asphalt built-up roof (BUR), granule-surfaced APP or SBS modified bitumen or smooth-surfaced SBS modified bitumen	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board or min. 0.5-inch SecurShield HD, SecurShield HD Plus or DuraStorm VSH	Flexible DASH or Flexible DASH DT (RIBBON)	None	N/A	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-302.5
R-7	Existing fully-adhered asphalt built-up roof (BUR) with flood coat & gravel (loose gravel removed)	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board or min. 0.5-inch SecurShield HD, SecurShield HD Plus or DuraStorm VSH	Flexible DASH or Flexible DASH DT (RIBBON, 6-inch o.c.)	None	N/A	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-302.5
R-8	Existing asphaltic BUR or mineral surface cap	Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	OB500	(Optional) Additional layers of base insulation	OB500	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-120.0
R-9	Existing asphaltic BUR or mineral surface cap	Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	OB500	Min 0.5-inch Verisco Recovery Board or min. 0.25-inch DensDeck or DensDeck Prime	OB500	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-120.0

TABLE 5A: RECOVER APPLICATIONS
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

^A The reported MDP documents the allowable maximum design pressure of the new insulation, coverboard and roof cover when adhered to the substrate, irrespective of the deck type (See Note 1) or performance of the substrate (See Note 12). The deck and substrate shall be capable of resisting the project design pressure requirements, not to exceed the noted MDP, to the satisfaction of the Authority Having Jurisdiction.

System No.	Substrate (Note 1, Note 12)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)		MDP (psf) ^A
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Membrane	Application	
R-10	Existing asphaltic BUR or mineral surface cap	Min. 1.0-inch Foamular 250 or Styrofoam Roofmate or Highload 60 or min. 2.0-inch, min. 1.0 pcf, Insulfoam	OB500	Min 0.5-inch Verisco Recovery Board or min. 0.25-inch DensDeck or DensDeck Prime	OB500	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-120.0
R-11	Existing asphaltic BUR or mineral surface cap	Min. 1.0-inch Foamular 250	OB500	Min. 0.25-inch DensDeck or DensDeck Prime	OB500	VersiGard Non-Reinforced, VersiGard Reinforced Standard, VersiGard Reinforced FR, VersiGard White Standard or VersiGard White Reinforced EPDM	Cav-Grip 3V Adhesive / Primer or G200SA Yellow Substrate Adhesive	-120.0
MEMBRANE APPLIED IN AQUA BASE 120 BA ADHESIVE:								
R-12	Existing asphaltic BUR	Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Hot Asphalt	(Optional) Additional layers of base insulation	Hot Asphalt	VersiGard Non-Reinforced, VersiGard Reinforced Standard or VersiGard Reinforced FR	Aqua Base 120 BA	-165.0
R-13	Existing asphaltic BUR	(Optional) Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Hot Asphalt	Min. 0.5-inch Verisco Recovery Board	Hot Asphalt	VersiGard Non-Reinforced, VersiGard Reinforced Standard or VersiGard Reinforced FR	Aqua Base 120 BA	-90.0
R-14	Existing asphaltic BUR	(Optional) Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	Hot Asphalt	Min. 0.25-inch DensDeck Prime	Hot Asphalt	VersiGard Non-Reinforced, VersiGard Reinforced Standard or VersiGard Reinforced FR	Aqua Base 120 BA	-165.0
R-15	Existing asphaltic BUR or mineral surface cap	Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	OB500	(Optional) Additional layers of base insulation	OB500	VersiGard Non-Reinforced, VersiGard Reinforced Standard or VersiGard Reinforced FR	Aqua Base 120 BA	-105.0
R-16	Existing asphaltic BUR or mineral surface cap	(Optional) Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	OB500	Min. 0.5-inch Verisco Recovery Board	OB500	VersiGard Non-Reinforced, VersiGard Reinforced Standard or VersiGard Reinforced FR	Aqua Base 120 BA	-90.0

TABLE 5A: RECOVER APPLICATIONS
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

^A The reported MDP documents the allowable maximum design pressure of the new insulation, coverboard and roof cover when adhered to the substrate, irrespective of the deck type (See Note 1) or performance of the substrate (See Note 12). The deck and substrate shall be capable of resisting the project design pressure requirements, not to exceed the noted MDP, to the satisfaction of the Authority Having Jurisdiction.

System No.	Substrate (Note 1 , Note 12)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)		MDP (psf) ^A
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Membrane	Application	
R-17	Existing asphaltic BUR or mineral surface cap	(Optional) Min. 1.5-inch VersiCore, SecurShield, Polyiso MP-N or Polyiso MP-W	OB500	Min. 0.25-inch DensDeck Prime	OB500	VersiGard Non-Reinforced, VersiGard Reinforced Standard or VersiGard Reinforced FR	Aqua Base 120 BA	-150.0
MEMBRANE APPLIED IN EPDM x-23 LOW-VOC BONDING ADHESIVE:								
R-18	Existing asphaltic BUR or mineral surface cap	Min. 0.5-inch VersiCore or SecurShield	OB500	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	OB500	VersiGard Non-Reinforced, VersiGard Reinforced Standard or VersiGard Reinforced FR	EPDM x-23 Low-VOC Bonding Adhesive	-75.0
R-19	Existing asphaltic BUR or mineral surface cap	Min. 1.5-inch Insullam (GYP)	OB500	None	N/A	VersiGard Non-Reinforced, VersiGard Reinforced Standard or VersiGard Reinforced FR	EPDM x-23 Low-VOC Bonding Adhesive	-75.0
R-20	Existing asphaltic BUR or mineral surface cap	Min. 1.5-inch Insulfoam HD Composite	OB500	None	N/A	VersiGard Non-Reinforced, VersiGard Reinforced Standard or VersiGard Reinforced FR	EPDM x-23 Low-VOC Bonding Adhesive	-120.0
MEMBRANE APPLIED IN FLEXIBLE DASH OR FLEXIBLE DASH DUAL-TANK:								
R-21	Existing fully-adhered granule-surfaced asphalt built-up roof (BUR), smooth-surfaced asphalt built-up roof (BUR), granule-surfaced APP or SBS modified bitumen or smooth-surfaced SBS modified bitumen	(Optional) Min. 1-inch VersiCore, SecurShield	Flexible DASH or Flexible DASH DT (RIBBON)	<u>Insulation:</u> (Optional) Additional layer(s) base insulation <u>Coverboard:</u> Min. 0.5-inch SecurShield HD, SecurShield HD Plus or DuraStorm VSH	Flexible DASH or Flexible DASH DT (RIBBON)	VersiGard Black VersiFleece or VersiGard White VersiFleece	Flexible DASH or Flexible DASH DT (RIBBON, 6-inch o.c.)	-90.0
R-22	Existing fully-adhered asphalt built-up roof (BUR) with flood coat & gravel (loose gravel removed)	Min. 1-inch VersiCore, SecurShield	Flexible DASH or Flexible DASH DT (RIBBON, 6-inch o.c.)	<u>Insulation:</u> (Optional) Additional layer(s) base insulation <u>Coverboard:</u> Min. 0.5-inch SecurShield HD, SecurShield HD Plus or DuraStorm VSH	Flexible DASH or Flexible DASH DT (RIBBON)	VersiGard Black VersiFleece or VersiGard White VersiFleece	Flexible DASH or Flexible DASH DT (RIBBON, 6-inch o.c.)	-90.0
R-23	Existing fully-adhered asphalt built-up roof (BUR) with flood coat & gravel (loose gravel removed)	Min. 0.5-inch SecurShield HD, SecurShield HD Plus or DuraStorm VSH	Flexible DASH or Flexible DASH DT (RIBBON, 6-inch o.c.)	None	N/A	VersiGard Black VersiFleece or VersiGard White VersiFleece	Flexible DASH or Flexible DASH DT (RIBBON, 6-inch o.c.)	-90.0

TABLE 5A: RECOVER APPLICATIONS
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

^A The reported MDP documents the allowable maximum design pressure of the new insulation, coverboard and roof cover when adhered to the substrate, irrespective of the deck type (See Note 1) or performance of the substrate (See Note 12). The deck and substrate shall be capable of resisting the project design pressure requirements, not to exceed the noted MDP, to the satisfaction of the Authority Having Jurisdiction.

System No.	Substrate (Note 1 , Note 12)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)		MDP (psf) ^A
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Membrane	Application	
R-24	Existing fully-adhered granule-surfaced asphalt built-up roof (BUR), smooth-surfaced asphalt built-up roof (BUR), granule-surfaced APP or SBS modified bitumen or smooth-surfaced SBS modified bitumen	Min. 1-inch VersiCore, SecurShield	Flexible DASH or Flexible DASH DT (RIBBON)	Insulation: (Optional) Additional layer(s) base insulation Coverboard: (Optional) Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board or min. 0.5-inch SecurShield HD, SecurShield HD Plus or DuraStorm VSH	Flexible DASH or Flexible DASH DT (RIBBON)	VersiGard Black VersiFleece or VersiGard White VersiFleece	Flexible DASH or Flexible DASH DT (FULL)	-167.5
R-25	Existing fully-adhered asphalt built-up roof (BUR) with flood coat & gravel (loose gravel removed)	Min. 1-inch VersiCore, SecurShield	Flexible DASH or Flexible DASH DT (RIBBON, 6-inch o.c.)	Insulation: (Optional) Additional layer(s) base insulation Coverboard: (Optional) Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board or min. 0.5-inch SecurShield HD, SecurShield HD Plus or DuraStorm VSH	Flexible DASH or Flexible DASH DT (RIBBON)	VersiGard Black VersiFleece or VersiGard White VersiFleece	Flexible DASH or Flexible DASH DT (FULL)	-167.5
R-26	Existing fully-adhered granule-surfaced asphalt built-up roof (BUR), smooth-surfaced asphalt built-up roof (BUR), granule-surfaced APP or SBS modified bitumen or smooth-surfaced SBS modified bitumen	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board or min. 0.5-inch SecurShield HD, SecurShield HD Plus or DuraStorm VSH	Flexible DASH or Flexible DASH DT (RIBBON)	None	N/A	VersiGard Black VersiFleece or VersiGard White VersiFleece	Flexible DASH or Flexible DASH DT (FULL)	-302.5
R-27	Existing fully-adhered asphalt built-up roof (BUR) with flood coat & gravel (loose gravel removed)	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board or min. 0.5-inch SecurShield HD, SecurShield HD Plus or DuraStorm VSH	Flexible DASH or Flexible DASH DT (RIBBON, 6-inch o.c.)	None	N/A	VersiGard Black VersiFleece or VersiGard White VersiFleece	Flexible DASH or Flexible DASH DT (FULL)	-302.5

TABLE 5B: RECOVER APPLICATIONS
SYSTEM TYPE F: NON-INSULATED, BONDED ROOF COVER

^A The reported MDP documents the allowable maximum design pressure of the new roof cover when adhered to the substrate, irrespective of the deck type (See Note 1) or performance of the substrate (See Note 12). The deck and substrate shall be capable of resisting the project design pressure requirements, not to exceed the noted MDP, to the satisfaction of the Authority Having Jurisdiction.

System No.	Substrate (Note 1 , Note 12)	Roof Cover (Note 15)		MDP (psf) ^A
		Membrane	Application	
R-28	Existing, fully-adhered EPDM	VersiGard Black VersiFleece or VersiGard White VersiFleece	Flexible DASH or Flexible DASH DT (RIBBON, 12)	-30.0
R-29	Existing, fully-adhered asphaltic BUR	VersiFleece AC EPDM	Verisco Cold Applied Adhesive	-60.0
R-30	Existing, fully-adhered EPDM	VersiGard Black VersiFleece or VersiGard White VersiFleece	Flexible DASH or Flexible DASH DT (RIBBON, 6)	-75.0
R-31	Existing, fully-adhered EPDM	VersiGard Black VersiFleece or VersiGard White VersiFleece	Flexible DASH or Flexible DASH DT (FULL)	-315.0

FBC NON-HVHZ