



EVALUATION REPORT

FLORIDA BUILDING CODE, 8TH EDITION (2023)

Manufacturer: ATLAS ROOFING CORPORATION
 2000 Riveredge Parkway, Suite 800
 Atlanta, GA 30328
 (770) 612-6267
www.atlasroofing.com

Issued October 5, 2023

Quality Assurance: PRI Construction Materials Technologies, LLC (QUA9110)

SCOPE

Category: Roofing
Subcategory: Underlayments
Code Edition: Florida Building Code, 8th Edition (2023) including High-Velocity Hurricane Zones (HVHZ)
Code Sections: 1504.2.1.4, 1507.1.1, 1518.2, 1523.1.1, 1523.6.5.2.1
Properties: Physical properties

REFERENCES

<u>Entity</u>	<u>Report No.</u>	<u>Standard</u>	<u>Year</u>
PRI Construction Materials Technologies (TST6049)	ATL-033-02-01	ASTM D 226	2017
PRI Construction Materials Technologies (TST6049)	MSA-047-02-01	ASTM D 1970	2017a
PRI Construction Materials Technologies (TST6049)	MSA-054-02-01.1	TAS 103	2020
		TAS 110	2000
PRI Construction Materials Technologies (TST6049)	MSA-056-02-01	ASTM D 1970	2017a
PRI Construction Materials Technologies (TST6049)	MSA-060-02-01	ASTM D 1970	2017a
PRI Construction Materials Technologies (TST6049)	MSA-062-02-01.1	ASTM D 1623	2017
PRI Construction Materials Technologies (TST6049)	1085T0002	TAS 110	2000
PRI Construction Materials Technologies (TST6049)	1085T0007	ASTM D 1623	2017
PRI Construction Materials Technologies (TST6049)	117T0001	ASTM D 1623	2017
PRI Construction Materials Technologies (TST6049)	117T0004	TAS 110	2000
PRI Construction Materials Technologies (TST6049)	117T0005	UL 1897	2015
PRI Construction Materials Technologies (TST6049)	117T0039	ASTM D 1970	2017a
PRI Construction Materials Technologies (TST6049)	117T0040	UL 1897	2015
PRI Construction Materials Technologies (TST6049)	1085T0011	ASTM D 1623	2017
		TAS 103	2020
PRI Construction Materials Technologies (TST6049)	1085T0015	ASTM D 1623	2017
		TAS 103	2020
PRI Construction Materials Technologies (TST6049)	1085T0046	TAS 110	2000
		TAS 103	2020
PRI Construction Materials Technologies (TST6049)	1085T0047	ASTM D 1970	2017a
		TAS 110	2000
UL LLC (TST1740)	02-NK40952	ASTM D 1970	2017a
UL LLC (TST1740)	02-NK40952	ASTM D 226	2017
UL LLC (TST1740)	02-NK40952	ASTM D 2626	2004(2012)E1
UL LLC (TST1740)	02-NK40952	ASTM D 4869	2016a
UL LLC (TST1740)	02-NK40952	ASTM D 6380	2003(2018)

PRODUCT DESCRIPTION

#15 Specification Felt	ASTM D 226, Type I asphalt saturated organic felt underlayment for use in the HVHZ.
#30 Organic Saturated Felt	ASTM D 4869, Type II asphalt saturated organic felt underlayment <u>for use in the non-HVHZ only.</u>
#30 Specification Felt	ASTM D 226, Type II asphalt saturated organic felt underlayment for use in the HVHZ and non-HVHZ.
#43 Base Sheet	ASTM D 2626 asphalt saturated and coated, non-perforated, organic felt underlayment for use in the HVHZ and non-HVHZ.
#90 Mineral Surface Roll Roofing	ASTM D 6380, Class M asphalt-saturated organic roll roofing sheet for use in the HVHZ and non-HVHZ.
Gorilla Guard® EVERFELT 30	Asphalt-saturated organic felt underlayment reinforced with glass fiber that meets the performance requirements of ASTM D 226, Type I for use in the HVHZ.
Slate/Tile Underlayment	ASTM D 6380, Class M asphalt-saturated organic roll roofing sheet for use in the HVHZ and non-HVHZ.
WeatherMaster® Ice and Water 100	ASTM D 1970 SBS modified, self-adhering underlayment reinforced with a fiberglass mat and a granular surface for use in the HVHZ and non-HVHZ. The self-adhesive side is covered with a release film, which is removed during installation.
WeatherMaster® Ice and Water 200	ASTM D 1970 SBS modified, self-adhering underlayment reinforced with a fiberglass mat and a granular surface for use in the HVHZ and non-HVHZ. The self-adhesive side is covered with a split-release film, which is removed during installation.
WeatherMaster® Ice and Water 216	ASTM D 1970 SBS modified, self-adhering underlayment reinforced with a fiberglass mat and a granular surface for use in the HVHZ and non-HVHZ. The self-adhesive side is covered with a split-release film, which is removed during installation.
WeatherMaster® Flexible Ice and Water	ASTM D 1970 SBS modified, self-adhering underlayment with plastic film surface for use in the HVHZ and non-HVHZ. The self-adhesive side is covered with a split-release film, which is removed during installation.
WeatherMaster® Pro-Grade Ice and Water	ASTM D 1970, TAS 103, and FRSA/TRI <i>Florida High Wind Concrete and Clay Tile Installation</i> Manual, Seventh Edition compliant SBS modified, self-adhering underlayment with a fiberglass mat reinforcement and a poly-fabric surface for use in the HVHZ and non-HVHZ. The self-adhesive side is covered with a release film, which is removed during installation.
WeatherMaster® Tile	ASTM D 1970, TAS 103, and FRSA/TRI <i>Florida High Wind Concrete and Clay Tile Installation</i> Manual, Seventh Edition compliant SBS modified, self-adhering underlayment with a fiberglass mat reinforcement and a poly-fabric surface for use in the HVHZ and non-HVHZ. The self-adhesive side is covered with a release film, which is removed during installation.

APPLICATION METHOD

Installation shall be in accordance with the published manufacturer's installation instructions, the FBC, and the requirements below.

Deck substrates shall be clean, dry, and free from any irregularities and debris. All fasteners in the deck shall be checked for protrusion and corrected prior to underlayment application.

The roof deck shall be installed in accordance with FBC requirements.

Exposure of the underlayments shall be limited to a maximum 30 days except as follows:

- a) #15 Specification Felt, #30 Specification Felt, and #40 Base Sheet – exposure for greater than 24 hours may adversely affect product performance
- b) WeatherMaster® Pro-Grade Ice and Water – maximum 180 days
- c) WeatherMaster® Tile – maximum 180 days

Self-adhering underlayments may be adhered to primed or unprimed plywood substrates in the non-HVHZ. WeatherMaster® Ice and Water 100, WeatherMaster® Ice and Water 200, WeatherMaster® Ice and Water 216 may be adhered to OSB or wood plank sheathing.

Underlayment shall be attached in accordance with FBC Sections 1507.1.1 and 1507.2.9.2 for the non-HVHZ, FBC Section 1518.2 for the HVHZ, and the manufacturer's installation instructions.

Roof coverings shall be mechanically fastened through the underlayment to the roof deck except as follows (or as indicated in other current FBC product approval documents):

- a) WeatherMaster® Pro-Grade Ice and Water – ICP Construction Polysat AH-160, DAP Touch 'n Seal Storm Bond Roof Tile Adhesive or DuPont Tile Bond
- b) WeatherMaster® Tile – ICP Construction Polysat AH-160, DAP Touch 'n Seal Storm Bond Roof Tile Adhesive or DuPont Tile Bond

Underlayments shall be permitted to be used with mechanically fastened roof coverings as prescribed in FBC Sections 1507.1.1 and 1507.2.9.2 for the non-HVHZ and FBC Section 1518.2 for the HVHZ.

WIND RESISTANCE OF ROOF TILE UNDERLAYMENT SYSTEMS

The *Allowable Design Pressures* shown below were calculated using a 2:1 margin of safety per FBC Section 1504.9.

Underlayment System No.1 – Direct Deck Application

Roof Deck: Min. 15/32-inch, 32/16 span rated, CDX plywood attached to wood supports spaced a maximum 24" o.c. Deck attachment to be designed by others.

Underlayment: **WeatherMaster® Tile** or **WeatherMaster® Pro-Grade Ice and Water** shall be fully adhered to the plywood deck and backnailed 12-inches o.c. to the plywood deck using min. 12ga, 1-1/4" galvanized, ring shank roofing nails with min. 32ga 1-5/8" diameter tin caps.


Allowable Design Pressure: -135 psf

LIMITATIONS

- 1) Fire Classification is not within the scope of this evaluation.
- 2) Roof slope limitations shall be in accordance with FBC requirements.
- 3) Installation of the evaluated product shall comply with this report, the FBC, and the manufacturer's published application instructions. Where discrepancies exist between these sources, the more restrictive and FBC compliant installation detail shall prevail.
- 4) Products described within this report may be used as described in other current FBC product approval documents.
- 5) Roof coverings shall not be adhered directly to the underlayment unless otherwise approved in this or other current FBC product approval documents.
- 6) The roof deck shall be designed by others in accordance with FBC requirements to resist the design wind load pressures for components and cladding.
- 7) All products listed in this report shall be manufactured under a quality assurance program in compliance with Rule 61G20-3.

COMPLIANCE STATEMENT

The products evaluated herein by Zachary R. Priest P.E. have demonstrated compliance with the Florida Building Code, 8th Edition (2023) including High-Velocity Hurricane Zones (HVHZ) as evidenced in the referenced documents submitted by the named manufacturer.

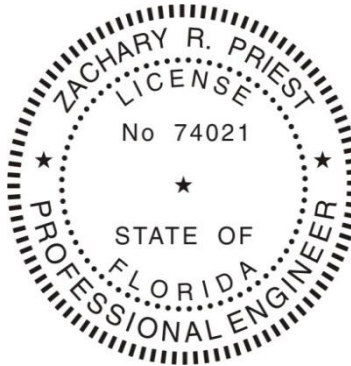

**This item has been
digitally signed and
sealed by Zachary R.
Priest, PE, on 10/5/2023.**

**Printed copies of this
document are not
considered signed and
sealed and the signature
must be verified on any
electronic copies.**

Zachary R. Priest, P.E.
Florida Registration No. 74021
Organization No. ANE9641

CERTIFICATION OF INDEPENDENCE

CREEK Technical Services, LLC does not have, nor will it acquire, a financial interest in any company manufacturing or distributing products under this evaluation.

CREEK Technical Services, LLC is not owned, operated, or controlled by any company manufacturing or distributing products under this evaluation.

Zachary R. Priest, P.E. does not have, nor will acquire, a financial interest in any company manufacturing or distributing products under this evaluation.

Zachary R. Priest, P.E. does not have, nor will acquire, a financial interest in any other entity involved in the approval process of the product.

END OF REPORT