



398 E DANIA BEACH BLVD. SUITE 338, DANIA BEACH, FL 33004

Product Evaluation Report

of

**Euro-Wall, LLC
Euro-C3 BiFold Aluminum Door System
(WZ3) (Impact)**

for

Florida Product Approval

FL# FL17838

Report No. 7628

Current Florida Building Code

Method:	1 – D (Engineering Evaluation)
Category:	Exterior Doors
Sub – Category:	Swinging Exterior Door Assemblies
Product:	Euro-C3 BiFold Aluminum Door System (WZ3) (Impact)
Material:	Aluminum 6063-T5
Product Dimensions:	See Installation Instructions, EWS014

Prepared for:

**Euro-Wall, LLC
P.O. Box 8007
North Port, FL 34290**

Prepared by:


Hermes F. Norero, P.E.

Florida Professional Engineer # 73778

Date: 06/16/2023

Contents:

Evaluation Report Pages 1 – 4

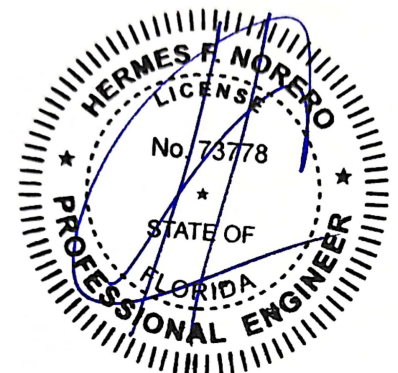

Hermes F. Norero, P.E.
Florida P.E. No. 73778

398 E DANIA BEACH BLVD. SUITE 338, DANIA BEACH, FL 33004

Manufacturer: Euro-Wall, LLC

Product Category: Exterior Doors

Product Sub-Category: Swinging Exterior Door Assemblies

Compliance Method: State Product Approval Method (1)(d)

Product Name: Euro-C3 BiFold Aluminum Door System (WZ3) (Impact)

Scope: This is a Product Evaluation Report issued by Hermes F. Norero, P.E. (FL # 73778) for Euro-Wall, LLC based on Method 1d of the State of Florida Product Approval, Department of Business and Professional Regulation - Florida Building Commission.

Hermes F. Norero, P.E. does not have nor will acquire financial interest in the company manufacturing or distributing the product or in any other entity involved in the approval process of the product named herein.

This product has been evaluated for use in locations adhering to the current Florida Building Code.

See Installation Instructions **EWS014**, signed and sealed by Hermes F. Norero, P.E. (FL # 73778) for specific use parameters.

Limits of Use:

1. This product has been evaluated and is in compliance with the current Florida Building Code, **excluding** the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment into substrate material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection this product complies with Chapter 16 of the current Florida Building Code and **does not** require an impact resistant covering in Wind Zone 3 or less.
4. When used in areas requiring wind borne debris protection this product complies with Chapter 16 of the current Florida Building Code and **does require** an impact resistant covering in Wind Zone 4.
5. Site conditions that deviate from the details of installation instructions **EWS014** require further engineering analysis by a licensed engineer or registered architect.
6. See Installation Instructions **EWS014** for size and design pressure limitations.

Quality Assurance:

The manufacturer has demonstrated compliance of manufacture of products in accordance with the current Florida Building Code for manufacturing under a quality assurance program audited by an approved quality assurance entity through **National Accreditation & Management Institute** (FBC Organization # QUA1789).

Performance Standards:

The product described herein has been evaluated per:

- ASTM E1886-13a
- ASTM E1996-17
- TAS 201-94
- TAS 202-94
- TAS 203-94
- ASTM C864-05

Referenced Data:

1. Product Testing performed by **Architectural Testing, Inc.**
(FBC Organization #: TST4311)

Report:

C4820.04-401-18

C5958.01-401-18

Signed & Sealed by: Shawn G. Collins, FL P.E. No. 70655

Dated:

06/18/13

06/18/13

2. Product Testing performed by **Blackwater Testing, Inc.**
(FBC Organization #: TST10394)

Report:

BT-CON-15-001

BT-EUW-15-001

BT-EUW-16-002A

BT-EUW-16-002A_S

Signed & Sealed by Yamil Kuri, FL P.E. No. 44726

BT-EUW-21-002

BT-EUW-23-001

Signed & Sealed by: Michael D. Caldwell, FL P.E. No. 49979

Dated:

05/19/15

05/19/15

09/20/16

09/20/16

06/11/21

09/13/23

398 E DANIA BEACH BLVD. SUITE 338, DANIA BEACH, FL 33004

3. Product Testing performed by **Intertek - West Palm Beach (an ATI company)**
(FBC Organization #: TST1527)
Report: 100245458COQ-004A
100244636COQ-002
Dated: 09/08/11
09/08/11
4. Material Certification
Miami Dade County RER Notice Acceptance
Current NOA for SentryGlas Interlayer by Kuraray America, Inc.
5. Quality Assurance
National Accreditation & Management Institute, Inc.
(FBC Organization #: QUA1789)

Equivalence of Test Standards:

Various test standards have been evaluated for differences in test methodology, if any, between tested editions of the test standards listed below and those editions referenced in the current Florida Building Code. **Euro-Wall, LLC** has tested their products to the following test standard edition(s):

- 1) ASTM E1886-05
- 2) ASTM E1996-08

Chapter 35 of the current Florida Building Code references the following editions of the above mentioned test standards:

- 1) ASTM E1886-13a
- 2) ASTM E1996-17

After review of the above mentioned referenced standards and editions, it has been found that the results and tests carried out meet the requirements for compliance. All referenced standards have been found to be equivalent.

Installation:

Refer to Installation Instructions (**EWS014**) for anchor spacing and more details of the installation requirements.

Design Pressure:

Refer to Installation Instructions (**EWS014**) for design pressures based on size, configuration, and glass types.