



# BUILDING DROPS

A Perfect Solution in Every Drop

Certificate of Authorization: 29578

398 E Dania Beach Blvd.  
Suite 338  
Dania Beach, FL 33004  
954.399.8478 PH  
954.744.4738 FX  
contact@buildingdrops.com

## Product Evaluation Report

*of*

**JELD-WEN, inc.**  
**Premium Atlantic Vinyl Fixed Window Non-Impact**

*for*

**Florida Product Approval**

**Report No. 4091**

**Current Florida Building Code**

**Method:** 1 – A (Certificate Method)  
**Category:** Windows  
**Sub – Category:** Fixed Window

**Product:** *Premium Atlantic Vinyl Fixed Window*  
**Material:** Vinyl (PVC)  
**Product Dimensions:** 72" x 72"

**Prepared For:**  
**JELD-WEN, inc.**  
**3737 Lakeport Blvd.**  
**Klamath Falls, OR 97601**

**Prepared by:**  
**Hermes F. Norero, P.E.**  
Florida Professional Engineer # 73778  
Date: 12/14/2015


Contents:

Evaluation Report Pages 1 – 4

Digitally signed by Hermes F Norero, P.E.

Reason: I am approving this document

Date: 2016.01.15 14:38:35 -05'00'

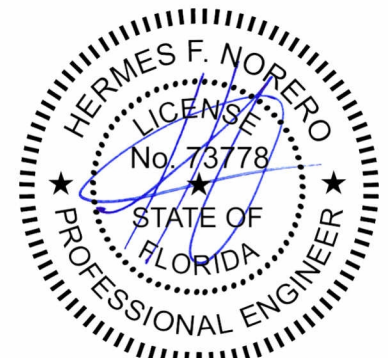

Hermes F. Norero, P.E.  
Florida No. 73778



# BUILDING DROPS

A Perfect Solution in Every Drop

Certificate of Authorization: 29578

Date: 12/14/2015  
Report No: 4091

---

**Manufacturer:** JELD-WEN, inc.

**Product Category:** Window

**Product Sub-Category:** Fixed Window

**Compliance Method:** State Product Approval Method (1)(a)

**Product Name:** Premium Atlantic Vinyl Fixed Window  
(Non-Impact)

**Scope:** This is a Product Evaluation Report issued by Hermes F. Norero, P.E. (FL # 73778) for **JELD-WEN, inc.** based on Method 1a of the State of Florida Product Approval, Florida Department of Business & Professional Regulation - Florida Building Commission.

Hermes F. Norero, P.E. does not have nor will acquire financial interest in the company manufacturing or distributing the product or in any other entity involved in the approval process of the product named herein.

This product has been evaluated for use in locations adhering to the current Florida Building Code.

See Installation Instructions **NCTL-210-4005-1A**, signed and sealed by Hermes F. Norero, P.E. (FL # 73778) for specific use parameters.

## Limits of Use:

1. This product has been evaluated and is in compliance with the current Florida Building Code, excluding the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment into substrate material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection this product complies with Chapter 16 of the current Florida Building Code and does require an impact resistant covering.
4. Site conditions that deviate from the details of drawing **NCTL-210-4005-1A** require further engineering analysis by a licensed engineer or registered architect.
5. See Installation Instructions **NCTL-210-4005-1A** for size and design pressure limitations.

Hermes F. Norero, P.E.  
Florida No. 73778  
Page 2 of 4



# BUILDING DROPS

A Perfect Solution in Every Drop

Certificate of Authorization: 29578

Date: 12/14/2015

Report No: 4091

- 
- Certification Agency:** The manufacturer has demonstrated compliance of products in accordance with the Florida Building Code for manufacturing under a program audited by and approved by **American Architectural Manufacturers Association** (FBC Organization #: CER1498).
- Performance Standards:** The product described herein has been tested per:
- AAMA/WDMA/CSA 101/I.S.2/A440-08
- Referenced Data:**
1. Product Testing performed by **National Certified Testing Laboratories**. (FBC Organization # TST4744)  
Report: NCTL-210-4005-1A, Report Date: 10/12/2015
  2. Certification Agency  
**American Architectural Manufactures Association**  
(FBC Organization #CER1498)



# BUILDING DROPS

A Perfect Solution in Every Drop

Certificate of Authorization: 29578

Date: 12/14/2015

Report No: 4091

**Installation:** 1. Approved anchor types and substrates are as follows:

**Nailing Fin Installation:**

- A. For two by (2X) wood frame substrate (Min. S.G. = 0.42), use **#10 PH Wood Screw** type wood frame anchors of sufficient length to achieve minimum embedment of 1.50" into wood framing.

**Through Frame Installation:**

- A. For two by (2X) wood buck substrate (Min. S.G. = 0.42), use **#10 PH Wood Screw** type installation anchors of sufficient length to achieve a minimum embedment of 1.50" into the wood substrate.
- B. For concrete (Min.  $f'c = 3000$  psi) or masonry (Conforms to ASTM C90) substrate where one by (1X), non-structural, wood bucking is employed, use **3/16" diameter ITW HWH Tapcon** type concrete screw anchors of sufficient length to achieve minimum embedment of 1.25" into concrete or masonry.
- C. For concrete (Min.  $f'c = 3000$  psi) or masonry (Conforms to ASTM C90) substrate where wood bucking is NOT employed, use **3/16" diameter ITW HWH Tapcon** type concrete screw anchors of sufficient length to achieve minimum embedment of 1.25" into concrete or masonry.
- D. For steel stud substrate (Min 18 Ga.,  $F_y = 33$  ksi), use **#10 TEK PH or HWH Screw** type steel stud anchors of sufficient length to achieve minimum 3 threads penetration beyond steel structure.

Refer to Installation Instructions (**NCTL-210-4005-1A**) for anchor spacing and more details of the installation requirements.

**Design Pressure:**

Configuration	Size	Design Pressure
O	72" x 72"	+50/-55 PSF

Hermes F. Norero, P.E.

Florida No. 73778

Page 4 of 4