

L. Roberto Lomas P.E.

1432 Woodford Rd.
Lewisville, NC 27023
434-688-0609
rlomas@lrlomaspe.com

Engineering Evaluation Report

Report No.: 513839A

Manufacturer: Nan Ya Plastics Corp. USA
8989 North Loop East
Houston, TX 77029


Product Line: Series SLPL Fiberglass Skin Glazed Outswing Door

Compliance:

The above mentioned product has been evaluated for compliance with the requirements of the Florida Department of Business and Professional Regulation for Statewide Acceptance per Rule 61G20-3.005 method 1(d). The product listed herein complies with requirements of the current Florida Building Code.

Supporting Technical Documentation:

1. Approval document: drawing number, 08-02986, prepared, signed and sealed by Luis Roberto Lomas P.E.
2. Test report No.: CTLA 1780W-2 signed and sealed by Ramesh Patel P.E.
Certified Testing Laboratories, Orlando, FL
TAS 201 Large Missile Impact Test, Level D, Wind Zone 4
TAS 202 Uniform Static Air Pressure, ± 70.0 psf design pressure, 10.5psf water penetration.
TAS 203 Cyclic Pressure loading ± 70.0 psf design pressure
3. Test report ETC-05-255-16776.1 signed and sealed by Joseph Labora Doldan P.E.
ETC Laboratories, Rochester, NY
Fiberglass testing
ASTM D2843 Smoke density 52.1%
ASTM D635 Rate of burning C1
ASTM D1929 Self ignition temperature 1060 °F
ASTM D638 Tensile strength unexposed 11,860 psi
Tensile strength Xenon arc exposed 11,063 psi
4. Test report ETC-05-255-16777.1 signed and sealed by Joseph Labora Doldan P.E.
ETC Laboratories, Rochester, NY
Cellular PVC testing
ASTM D2843 Smoke density 49.6%
ASTM D635 Rate of burning C1
ASTM D1929 Self ignition temperature 950 °F
ASTM D638 Tensile strength unexposed 6,019 psi
Tensile strength Xenon arc exposed 6,014 psi
5. Test report ETC-05-255-17144-7 signed and sealed by Joseph Labora Doldan P.E.
ETC Laboratories, Rochester, NY
Rigid PVC testing
ASTM D2843 Smoke density 37.4%
ASTM D635 Rate of burning C1
ASTM D1929 Self ignition temperature 900 °F
ASTM D638 Tensile strength unexposed 6,140 psi
Tensile strength Xenon arc exposed 6,053 psi
6. Anchor calculations, report number 513839-1, prepared, signed and sealed by Luis Roberto Lomas P.E.

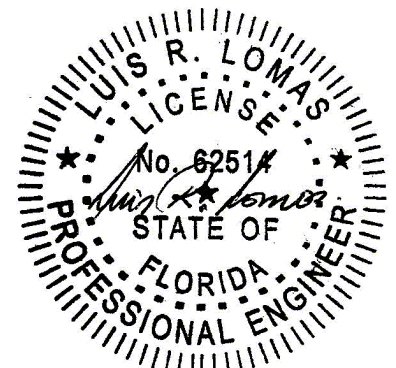

L. Roberto Lomas P.E.

1432 Woodford Rd.

Lewisville, NC 27023

434-688-0609

rlomas@lrlomaspe.com

Engineering Evaluation Report

Report No.: 513839A

Limitations and Conditions of use:

- Maximum design pressure: ± 70.0 psf
- Maximum panel size: 34 1/2" x 93 5/16"
- Approved configurations: O/XX/X, O/XX, O/X, O/XX/O, X/XX/O, XX/O, X/O, X/XX/X, X/XX, XX/X, X/X, XX, X.
- Units must be glazed per ASTM E1300 see installation instructions for glass details.
- This product is rated to be used in the HVHZ.
- This product is impact resistant and does not require impact protection in wind borne debris regions.
- Frame material to be foam PVC.

Installation:

Units must be installed in accordance with manufacturer's installation instructions and approval document, 08-02986.

Certification of Independence:

Please note that I don't have nor will acquire a financial interest in any company manufacturing or distributing the product(s) for which this report is being issued. Also, I don't have nor will acquire a financial interest in any other entity involved in the approval process of the listed product(s).

