

L. Roberto Lomas P.E.

208 7th Avenue
Indialantic, 32903
434-688-0609 (phone fax)
rlomas@lrlomaspe.com

Client: Masonite
Report: 514012C
Date: 10/4/2023

Test Report: N/A

Product: Double Door with and without sidelites 12"x6'8" (composite frame)

Scope:

This analysis provides calculations, quantities, and spacing requirements for installing product to substrate, and it applies only to the product described herein. These calculations comply with requirements of the Florida Building Code 8th edition (2023).

Anchor capacity in shear condition:

Solid members w/ & w/out gap:

a. With threads present in shear plane

Fastener type: #10 wood screw

(NDS 2018, TR12)

Nominal diameter: D: 0.190 in
Root diameter: Dr: 0.152 in
Minimum required penetration: p: 1.140 in
Side member: PVC
Side member thickness: $t_s = 1.000$ in
Side member dowel bearing strength: $F_{es} = 10,000$ psi
Side member dowel bearing length: $l_s = 1.000$ in

Gap: g: 0.0000 in
Moment arm: 0.0000 in
Screw bending yield strength: $F_{yb} = 80,000$ psi
Main member: Spruce-Pine-Fir ($G=0.42$)
Main member thickness: $t_m = 1.500$ in
Main member dowel bearing strength: $F_{em} = 3,350$ psi
Main member dowel bearing length: $l_m = 1.140$ in

Mode I _m	Mode I _s	Mode II	Mode III _m	Mode III _s	Mode IV
qm = 636.5 lbs/in	qs = 1900 lbs/in	A: 0.0005	A: 0.00066	A: 0.00092	A: 0.00105
P = 725.61 lbs	P = 1900 lbs	B: 1.07	B: 0.57	B: 0.5	B: 0.000
K _D = 2.400	K _D = 2.400	C: -681.799	C: -253.623	C: -521.824	C: -93.6
Z _m = 302 lbs	Z _s = 792 lbs	P = 510 lbs	Ms = 46.8 in-lbs	Mm = 46.8 in-lbs	
		K _D = 2.400	P = 324 lbs	P = 529 lbs	P = 299 lbs
Min. Design value:	Z = 125 lbs	Z = 212 lbs	K _D = 2.400	K _D = 2.400	K _D = 2.400
Duration Factor:	C _D = 1.6		Z = 135 lbs	Z = 221 lbs	Z = 125 lbs
Allowable Design Value (Z _{C_D}):	Z' = 199 lbs/anchor				

Fastener type: 1/4 ITW Tapcon

Tabulated values

N.O.A. 21-0201.06

Substrate: Hollow block

Minimum embedment: 1.25 in

Actual edge distance: 2.50 in

Actual C To C spacing: 3.00 in

Allowable Design Value: Z' = 155 lbs/anchor (per interpolation when needed)

edge	spacing (in)	
distance	2.00	4.00
2.00	130	161
4.00	163	202

Fastener type: #10 Self tapping screw

(Calculations per 2017 Aluminum Design Manual)

Nominal screw diameter: D: 0.190 in
Actual edge distance: de: 1.085 in

Screw root area: $A_r = 0.0151$ in²
Screw shear ultimate strength: $F_{su} = 54.0$ ksi

Per table J3.2 of 2010 Steel Construction Manual 14th Edition

Side member material: Vinyl PVC

Main member material: 6063-T5 aluminum

Thickness: $t_1 = 1.000$ in

Thickness: $t_2 = 0.052$ in

Ultimate tensile strength: $F_{tu1} = 14$ ksi

Ultimate tensile strength: $F_{tu2} = 22$ ksi

Nominal strength per bearing (side member): $R_n = 2Dt_1F_{tu1}$

$R_{n1} = 5320$ lbs (Eq J.5-12)

Nominal strength per bearing (main member): $R_n = 2Dt_2F_{tu2}$

$R_{n2} = 435$ lbs (Eq J.5-12)

Nominal strength per tilting: $R_n = 4.2(t_2^3b)^{1/2}F_{tu2}$


$R_n = 478$ lbs (Eq J.5-13)

Nominal screw shear strength: $R_n = A_rF_{su}/1.25$

$R_n = 654$ lbs (Eq J.5-14)

Safety factor: $\Omega = 3$

Allowable shear and bearing capacity: $P_{as} = 145$ lbs/anchor

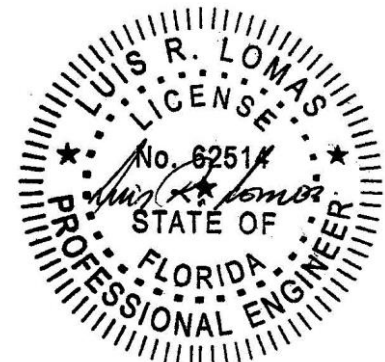

Luis R. Lomas P.E.
FL No.: 62514
10/4/2023

L. Roberto Lomas P.E.


208 7th Avenue
Indialantic, 32903
434-688-0609 (phone fax)
rlomas@lrlomaspe.com

Client: Masonite
Report: 514012C
Date: 10/4/2023


Fastener type:	#10 Self tapping screw	(Calculations per AISI S100-16 and AISC 2017)
Nominal screw diameter:	D: 0.190 in	Screw shear ultimate strength: F_{su} 54.0 ksi
Screw root area:	A_r 0.0151 in ²	Per table J3.2 of 2010 Steel Construction Manual 14th Edition
Side member material:	Vinyl PVC	Main member material: Metal framing
Thickness:	t_1 1.000 in	Thickness: t_2 0.048 in
Ultimate tensile strength:	F_{ut} 14 ksi	Ultimate tensile strength: F_{u2} 52 ksi
Nominal strength per tilting:	$R_n = 4.2(t_2^3 b)^{1/2} F_{u2}$	$R_n =$ 1001 lbs (Eq E4.3.1-1)
Nominal strength per bearing (side member):	$R_n = 2.7 D t_1 F_{ut}$	$R_{n1} =$ 7182 lbs (Eq E4.3.1-2 and -4)
Nominal strength per bearing (main member):	$R_n = 2.7 D t_2 F_{u2}$	$R_{n2} =$ 1280 lbs (Eq E4.3.1-3 and -5)
Nominal screw shear strength:	$R_n = A_r F_{su} / 1.25$	$R_n =$ 654 lbs
Safety factor:	$\Omega = 3$	
Allowable shear and bearing capacity:	P_{as} 218 lbs/anchor	
Minimum anchor capacity:	145 lbs/anchor	

Note: Anchors with the least capacity is used for calculations to qualify anchors with higher capacity.


Anchor calculations, minimum required anchors



Zone	Area (ft ²)	Load (lbs)	Ind. (in)	Max. O.C. (in)	Anchor			Result
					Cap. (lbs)	Qty	Load (lbs)	
A ₁	2.3	138	N/A	N/A	145	1	138	OK
A ₂	7.7	463	6.00	21.00	145	5	93	OK
A ₃	7.7	463	N/A	N/A	145	4	116	OK

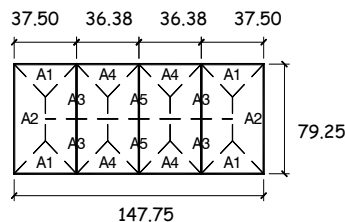

Zone	Area (ft ²)	Load (lbs)	Ind. (in)	Max. O.C. (in)	Anchor			Result
					Cap. (lbs)	Qty	Load (lbs)	
A ₁	2.4	146	N/A	N/A	145	2	73	OK
A ₂	7.9	473	6.00	21.00	145	5	95	OK
A ₃	7.8	468	N/A	N/A	145	4	117	OK
A ₄	2.3	138	N/A	N/A	145	1	138	OK
A ₅	7.7	463	N/A	N/A	145	4	116	OK

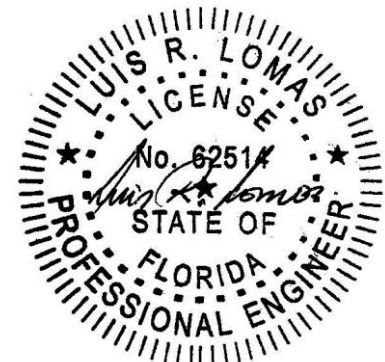

Luis R. Lomas P.E.
FL No.: 62514
10/4/2023



L. Roberto Lomas P.E.

208 7th Avenue
Indialantic, 32903
434-688-0609 (phone fax)
rllomas@lrlomaspe.com

Client: Masonite
Report: 514012C
Date: 10/4/2023

Anchor Locations:

Double door

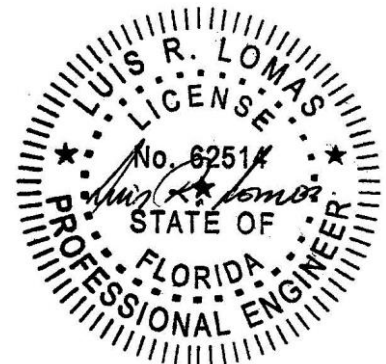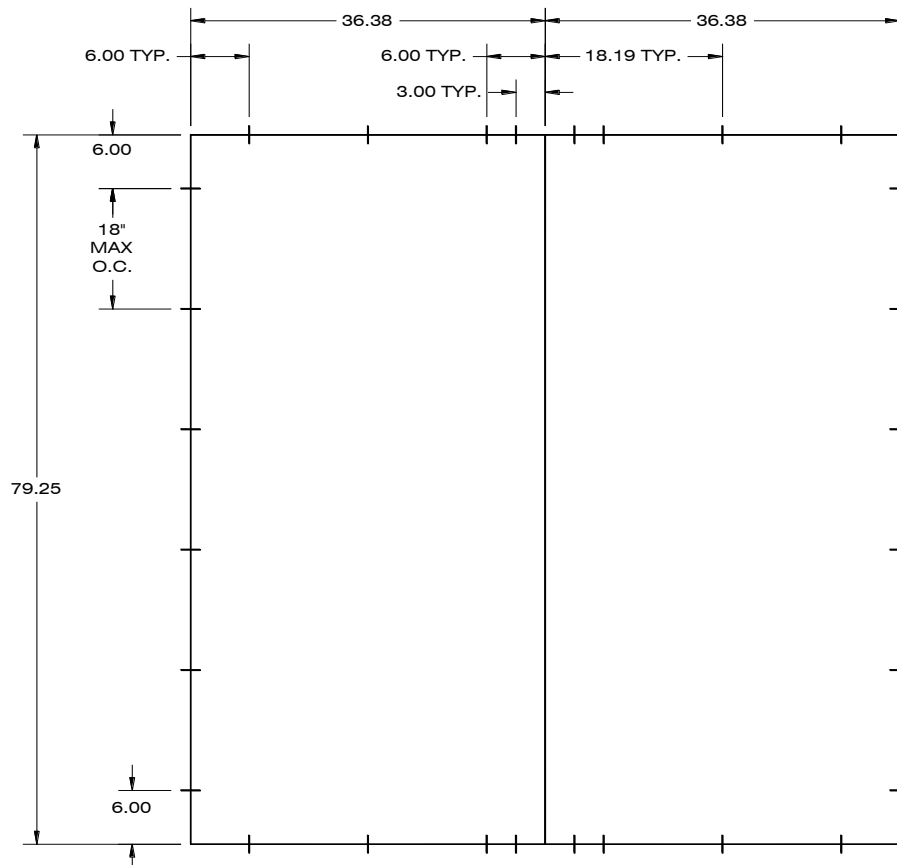



Luis R. Lomas P.E.
FL No.: 62514
10/4/2023

L. Roberto Lomas P.E.

208 7th Avenue
Indialantic, 32903
434-688-0609 (phone fax)
rllomas@lrlomaspe.com

Client: Masonite
Report: 514012C
Date: 10/4/2023

Double door with sidelites

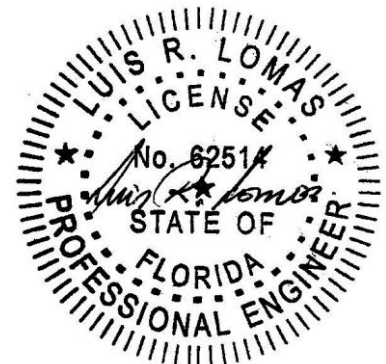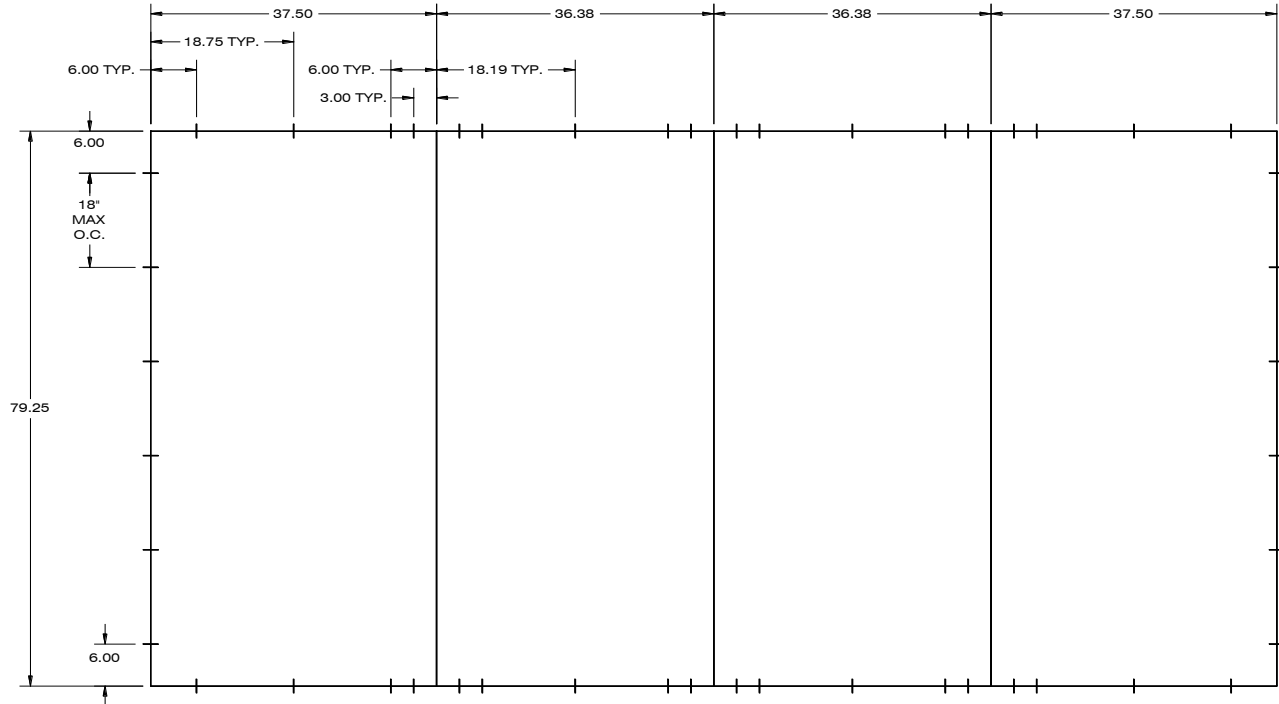

Luis R. Lomas P.E.
FL No.: 62514
10/4/2023


L. Roberto Lomas P.E.

208 7th Avenue
Indialantic, 32903
434-688-0609 (phone fax)
rllomas@lrlomaspe.com

Client: Masonite
Report: 514012C
Date: 10/4/2023

Installation instructions:

1. FOR ANCHORING THROUGH FRAME INTO WOOD FRAMING OR 2X BUCK USE #10 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 1/2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN BELOW.
2. FOR ANCHORING THROUGH FRAME INTO MASONRY/CONCRETE USE 1/4" TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2 1/2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN BELOW.
3. FOR ANCHORING THROUGH FRAME INTO METAL STRUCTURE USE #10 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL WITH 1/2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN BELOW.
4. ALL FASTENERS TO BE CORROSION RESISTANT.
5. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:
 - A. WOOD: MINIMUM SPECIFIC GRAVITY OF G=0.42
 - B. CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF 2,000 PSI.
 - C. MASONRY: HOLLOW/FILLED BLOCK PER ASTM C90 WITH Fm=2,000PSI MINIMUM.
 - D. METAL STRUCTURE: STEEL 18GA (.048") FY=33KSI/FU=52KSI OR ALUMINUM 6063-T5 FU=30KSI .052" THICK MINIMUM
6. ANCHOR LOCATIONS SHOWN IN THIS DOCUMENT ARE THE MINIMUM REQUIRED FOR THE DESCRIBED PRODUCT EXPOSED AT THE DESIGN PRESSURE INDICATED HEREIN.
7. WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
8. WHERE SHIM OR BUCK THICKNESS IS LESS THAN 1-1/2" UNITS MUST BE ANCHORED THROUGH FRAME IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS. ANCHORS SHALL BE SECURELY FASTENED DIRECTLY INTO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE MATERIAL.
9. WHERE WOOD BUCK THICKNESS IS 1-1/2" OR GREATER, BUCK SHALL BE SECURELY FASTENED TO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE. UNITS MAY BE ANCHORED THROUGH FRAME TO SECURED WOOD BUCK IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS.
10. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
11. BUCKS SHALL EXTEND BEYOND WINDOW INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.

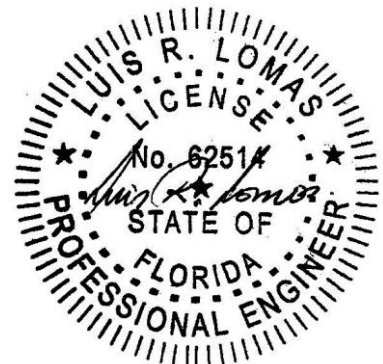

Luis R. Lomas P.E.
FL No.: 62514
10/4/2023