

L. Roberto Lomas P.E.

1432 Woodford Rd.
Lewisville, NC 27023
434-688-0609

rlomas@lrlomaspe.com

Manufacturer: Masonite
Report #: 514009A
Date: 10/10/2017

Test Report: N/A

Product: Single door 3'x8' (Wood Frame)

Scope:

This analysis provides calculations, quantities, and spacing requirements for installing product to substrate, and it applies only to the product described herein. These calculations comply with requirements of the Florida Building Code.

Anchor capacity in shear condition:

Solid members w/ & w/out gap:

a. With threads present in shear plane

Fastener type: #10 wood screw	(NDS 2012, NDS 2015, TR12)
Nominal diameter: D: 0.190 in	Gap: g: 0.0000 in
Root diameter: Dr: 0.152 in	Moment arm: 0.0000 in
Minimum required penetration: p: 1.140 in	Screw bending yield strength: $F_{yb} = 80,000$ psi
Side member: Douglas Fir-Larch ($G=0.50$)	Main member: Spruce-Pine-Fir ($G=0.42$)
Side member thickness: $t_s = 1.000$ in	Main member thickness: $t_m = 1.500$ in
Side member dowel bearing strength: $F_{es} = 4,650$ psi	Main member dowel bearing strength: $F_{em} = 3,350$ psi
Side member dowel bearing length: $l_s = 1.000$ in	Main member dowel bearing length: $l_m = 1.140$ in

Mode I _m	Mode I _s	Mode II	Mode III _m	Mode III _s	Mode IV
$q_m = 636.5$ lbs/in	$q_s = 884$ lbs/in	A: 0.0007	A: 0.00096	A: 0.00107	A: 0.00135
P = 725.61 lbs	P = 884 lbs	B: 1.07	B: 0.57	B: 0.5	B: 0.000
$K_D = 2.400$	$K_D = 2.400$	C: -427.674	C: -253.623	C: -267.699	C: -93.6
$Z_m = 302$ lbs	$Z_s = 368$ lbs	P = 331 lbs	$M_s = 46.8$ in-lbs	$M_m = 46.8$ in-lbs	P = 263 lbs
Min. Design value:	Z = 110 lbs	$K_D = 2.400$	P = 297 lbs	P = 319 lbs	$K_D = 2.400$
Duration Factor:	$C_D = 1.6$	Z = 138 lbs	$K_D = 2.400$	$K_D = 2.400$	Z = 110 lbs
Allowable Design Value (Z_{C_D}):	Z' = 175 lbs/anchor		Z = 124 lbs	Z = 133 lbs	

Fastener type: **1/4 ITW Tapcon**

Tabulated values

N.O.A. 16-1222.06

edge distance	spacing (in)	
	2.00	4.00
2.00	130	161
4.00	163	202

Substrate: Hollow block

Minimum embedment: 1.25 in

Actual edge distance: 2.50 in

Actual C To C spacing: 3.00 in

Allowable Design Value: Z'' = 155 lbs/anchor (per interpolation when needed)

Fastener type: **#10 Tek screw**

Substrate: 18 GA, Steel

Tabulated design value: **Z = 1266** lbs


Safety factor: $F_S = 4$

Allowable Design Value (Z_{F_S}): Z' = 316 lbs/anchor

Minimum anchor capacity: 155 lbs/anchor


Note: Anchors with the least capacity is used for calculations to qualify anchors with higher capacity.

Anchor calculations, minimum required anchors



Design pressure: 70.0 psf

Zone	Area (ft ²)	Load (lbs)	Ind. (in)	Max. O.C. (in)	Anchor			Result
					Cap. (lbs)	Qty	Load (lbs)	
A ₁	2.3	161	N/A	N/A	155	2	80	OK
A ₂	9.7	681	6.00	18.00	155	6	114	OK

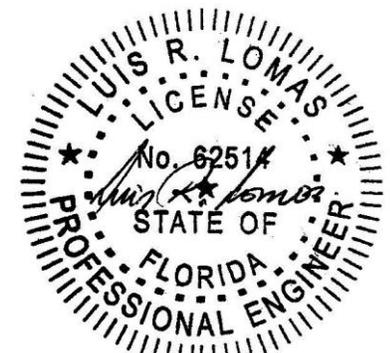

Luis R. Lomas P.E.
FL No.: 62514
10/10/2017

L. Roberto Lomas P.E.

1432 Woodford Rd.

Lewisville, NC 27023

434-688-0609



rlomas@lrlomaspe.com

Manufacturer: Masonite

Report #: 514009A

Date: 10/10/2017

Anchor Locations:

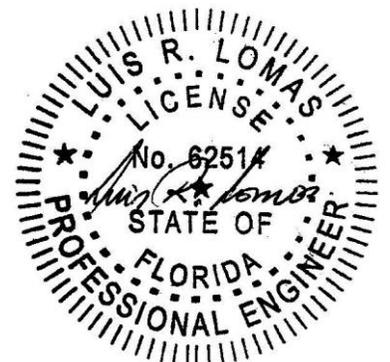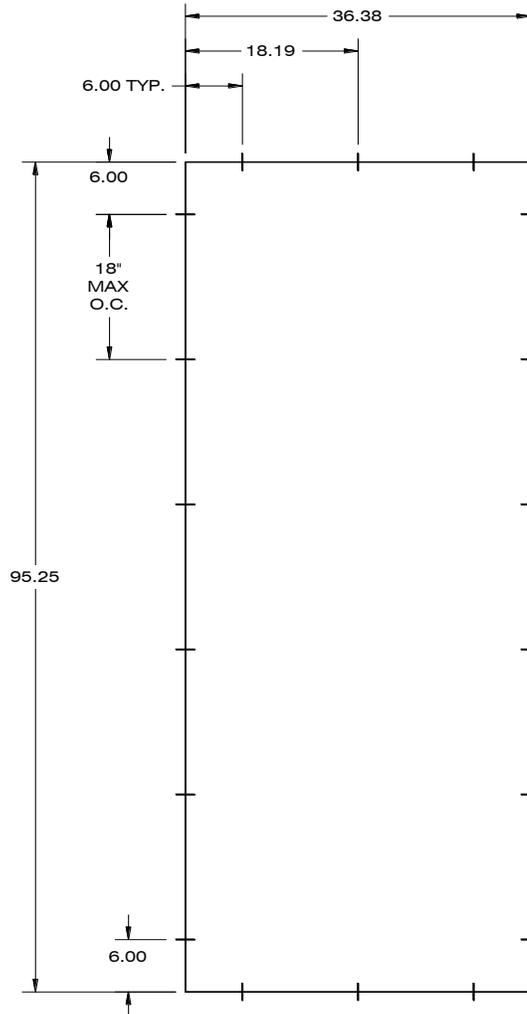

Luis R. Lomas P.E.
FL No.: 62514
10/10/2017

L. Roberto Lomas P.E.


1432 Woodford Rd.
Lewisville, NC 27023
434-688-0609

rlomas@lrlomaspe.com

Manufacturer: Masonite
Report #: 514009A
Date: 10/10/2017

Installation instructions:

1. FOR ANCHORING THROUGH FRAME INTO WOOD FRAMING OR 2X BUCK USE #10 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 1/2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN BELOW.
2. FOR ANCHORING THROUGH FRAME INTO MASONRY/CONCRETE USE 1/4" TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2 1/2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN BELOW.
3. FOR ANCHORING THROUGH FRAME INTO METAL STRUCTURE USE #10 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL WITH 1/2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN BELOW.
4. ALL FASTENERS TO BE CORROSION RESISTANT.
5. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:
 - A. WOOD: MINIMUM SPECIFIC GRAVITY OF G=0.42
 - B. CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF 2,000 PSI.
 - C. MASONRY: HOLLOW/FILLED BLOCK PER ASTM C90 WITH Fm=2,000PSI MINIMUM.
 - D. METAL STRUCTURE: STEEL 18GA (.048") FY=33KSI/FU=52KSI OR ALUMINUM 6063-T5 FU=30KSI .052" THICK MINIMUM
6. ANCHOR LOCATIONS SHOWN IN THIS DOCUMENT ARE THE MINIMUM REQUIRED FOR THE DESCRIBED PRODUCT EXPOSED AT THE DESIGN PRESSURE INDICATED HEREIN.
7. WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
8. 1X BUCK OVER MASONRY/CONCRETE IS OPTIONAL.
9. WHERE SHIM OR BUCK THICKNESS IS LESS THAN 1-1/2" UNITS MUST BE ANCHORED THROUGH FRAME IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS. ANCHORS SHALL BE SECURELY FASTENED DIRECTLY INTO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE MATERIAL.
10. WHERE WOOD BUCK THICKNESS IS 1-1/2" OR GREATER, BUCK SHALL BE SECURELY FASTENED TO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE. UNITS MAY BE ANCHORED THROUGH FRAME TO SECURED WOOD BUCK IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS.
11. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
12. BUCKS SHALL EXTEND BEYOND WINDOW INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.

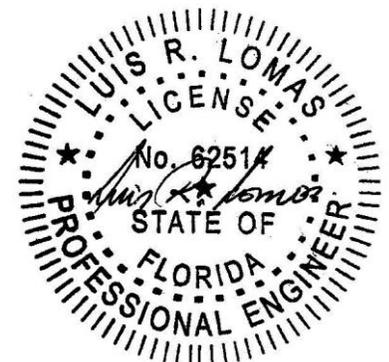

Luis R. Lomas P.E.
FL No.: 62514
10/10/2017