

**L. Roberto Lomas P.E.**

1432 Woodford Rd.  
Lewisville, NC 27023  
434-688-0609

[rlomas@lrlomaspe.com](mailto:rlomas@lrlomaspe.com)

Manufacturer: Masonite  
Report #: 514011A  
Date: 10/10/2017

**Test Report:** N/A

**Product:** Double Door with and without sidelites 12'x8' (composite frame)

**Scope:**

This analysis provides calculations, quantities, and spacing requirements for installing product to substrate, and it applies only to the product described herein. These calculations comply with requirements of the Florida Building Code.

**Anchor capacity in shear condition:**

Solid members w/ & w/out gap:

**a. With threads present in shear plane**

Fastener type: <b>#10 wood screw</b>	(NDS 2012, NDS 2015, TR12)
Nominal diameter: D: 0.190 in	Gap: g: 0.0000 in
Root diameter: Dr: 0.152 in	Moment arm: 0.0000 in
Minimum required penetration: p: 1.140 in	Screw bending yield strength: F <sub>yb</sub> = 80,000 psi
Side member: PVC	Main member: Spruce-Pine-Fir (G=0.42)
Side member thickness: t <sub>s</sub> = 1.000 in	Main member thickness: t <sub>m</sub> = 1.500 in
Side member dowel bearing strength: F <sub>es</sub> = 10,000 psi	Main member dowel bearing strength: F <sub>em</sub> = 3,350 psi
Side member dowel bearing length: l <sub>s</sub> = 1.000 in	Main member dowel bearing length: l <sub>m</sub> = 1.140 in

Mode I <sub>m</sub>	Mode I <sub>s</sub>	Mode II	Mode III <sub>m</sub>	Mode III <sub>s</sub>	Mode IV
qm = 636.5 lbs/in	qs = 1900 lbs/in	A: 0.0005	A: 0.00066	A: 0.00092	A: 0.00105
P = 725.61 lbs	P = 1900 lbs	B: 1.07	B: 0.57	B: 0.5	B: 0.000
K <sub>b</sub> = 2.400	K <sub>b</sub> = 2.400	C: -681.799	C: -253.623	C: -521.824	C: -93.6
Z <sub>m</sub> = 302 lbs	Z <sub>s</sub> = 792 lbs	P = 510 lbs	Ms = 46.8 in-lbs	Mm = 46.8 in-lbs	
		K <sub>b</sub> = 2.400	P = 324 lbs	P = 529 lbs	P = 299 lbs
Min. Design value:	Z = 125 lbs	Z = 212 lbs	K <sub>b</sub> = 2.400	K <sub>b</sub> = 2.400	K <sub>b</sub> = 2.400
Duration Factor:	C <sub>D</sub> = 1.6		Z = 135 lbs	Z = 221 lbs	Z = 125 lbs
<b>Allowable Design Value (ZC<sub>D</sub>):</b>	<b>Z' = 199 lbs/anchor</b>				

Fastener type: **1/4 ITW Tapcon**  
N.O.A. 16-1222.06

Tabulated values

edge distance	spacing (in)	
	2.00	4.00
2.00	130	161
4.00	163	202

Substrate: Hollow block  
Minimum embedment: 1.25 in  
Actual edge distance: 2.50 in  
Actual C To C spacing: 3.00 in  
**Allowable Design Value: Z'' = 155 lbs/anchor (per interpolation when needed)**

Fastener type: **#10 Self tapping screw** (Calculations per 2015 Aluminum Design Manual, section J.5.5)

Nominal screw diameter: D: 0.190 in  
Actual edge distance: de: 1.085 in  
Screw root area: A<sub>r</sub> 0.0151 in<sup>2</sup>  
Screw shear ultimate strength: F<sub>su</sub> 54.0 ksi  
Per table J3.2 of 2010 Steel Construction Manual 14th Edition

Side member material: Vinyl PVC

Main member material: **6063-T5 aluminum**

Thickness: t <sub>1</sub> 1.000 in	Thickness: t <sub>2</sub> 0.052 in
Ultimate tensile strength: F <sub>tu1</sub> 14 ksi	Ultimate tensile strength: F <sub>tu2</sub> 22 ksi
Nominal strength per bearing (side member): Rn = 2Dt <sub>1</sub> F <sub>tu1</sub>	Rn1 = 5320 lbs (Eq J.5-12)
Nominal strength per bearing (main member): Rn = 2Dt <sub>2</sub> F <sub>tu2</sub>	Rn2 = 435 lbs (Eq J.5-12)
Nominal strength per tilting: Rn = 4.2(t <sub>2</sub> <sup>3</sup> D) <sup>1/2</sup> F <sub>tu2</sub>	Rn = 478 lbs (Eq J.5-13)
Nominal screw shear strength: Rn = A <sub>r</sub> F <sub>su</sub> /1.25	Rn = 654 lbs (Eq J.5-14)
Safety factor: Ω = 3	

**Allowable shear and bearing capacity: P<sub>es</sub> 145 lbs/anchor**

Fastener type: **#10 Self tapping screw** (Calculations per AISI-S100-12, sections A2.3.2 and E4.3.1)

Nominal screw diameter: D: 0.190 in  
Screw root area: A<sub>r</sub> 0.0151 in<sup>2</sup>  
Screw shear ultimate strength: F<sub>su</sub> 54.0 ksi  
Per table J3.2 of 2010 Steel Construction Manual 14th Edition

Side member material: Vinyl PVC


Main member material: **Metal framing**

Thickness: t <sub>1</sub> 1.000 in	Thickness: t <sub>2</sub> 0.040 in
Ultimate tensile strength: F <sub>tu1</sub> 14 ksi	Ultimate tensile strength: F <sub>u2</sub>
Nominal strength per tilting: Rn = 4.2(t <sub>2</sub> <sup>3</sup> D) <sup>1/2</sup> F <sub>u2</sub>	Rn = 1001 lbs (Eq E4.3.1-1)
Nominal strength per bearing (side member): Rn = 2.7Dt <sub>1</sub> F <sub>tu1</sub>	Rn1 = 7182 lbs (Eq E4.3.1-2 and -4)
Nominal strength per bearing (main member): Rn = 2.7Dt <sub>2</sub> F <sub>u2</sub>	Rn2 = 1280 lbs (Eq E4.3.1-3 and -5)
Nominal screw shear strength: Rn = A <sub>r</sub> F <sub>su</sub> /1.25	Rn = 654 lbs
Safety factor: Ω = 3	

**Allowable shear and bearing capacity: P<sub>es</sub> 218 lbs/anchor**

**Minimum anchor capacity: 145 lbs/anchor**

Note: Anchors with the least capacity is used for calculations to qualify anchors with higher capacity.

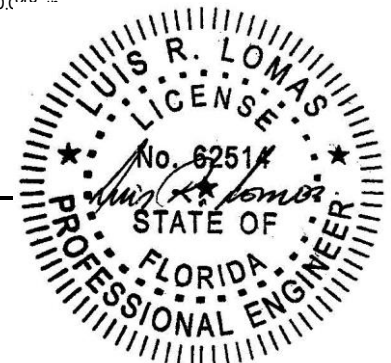


Luis R. Lomas P.E.  
FL No.: 62514  
10/10/2017

**L. Roberto Lomas P.E.**

1432 Woodford Rd.  
 Lewisville, NC 27023  
 434-688-0609  
[rlomas@lrlomaspe.com](mailto:rlomas@lrlomaspe.com)


Manufacturer: Masonite  
 Report #: 514011A  
 Date: 10/10/2017

**Anchor calculations, minimum required anchors**



Design pressure: 55.0 psf

Zone	Area (ft <sup>2</sup> )	Load (lbs)	Ind. (in)	Max. O.C. (in)	Anchor			Result
					Cap. (lbs)	Qty	Load (lbs)	
A <sub>1</sub>	2.3	126	N/A	N/A	145	1	126	OK
A <sub>2</sub>	9.7	535	6.00	21.00	145	5	107	OK
A <sub>3</sub>	9.7	535	N/A	N/A	145	4	134	OK


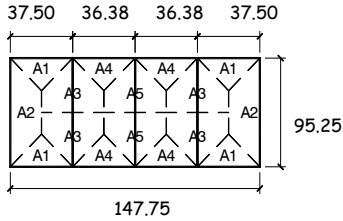


Design pressure: 55.0 psf

Zone	Area (ft <sup>2</sup> )	Load (lbs)	Ind. (in)	Max. O.C. (in)	Anchor			Result
					Cap. (lbs)	Qty	Load (lbs)	
A <sub>1</sub>	2.4	134	N/A	N/A	145	1	134	OK
A <sub>2</sub>	10.0	548	6.00	21.00	145	5	110	OK
A <sub>3</sub>	9.8	542	N/A	N/A	145	4	135	OK
A <sub>4</sub>	2.3	126	N/A	N/A	145	1	126	OK
A <sub>5</sub>	9.7	535	N/A	N/A	145	4	134	OK

**Anchor Locations:**

**Double door**

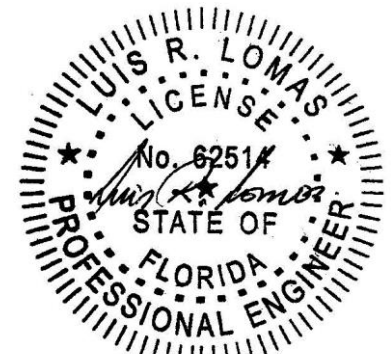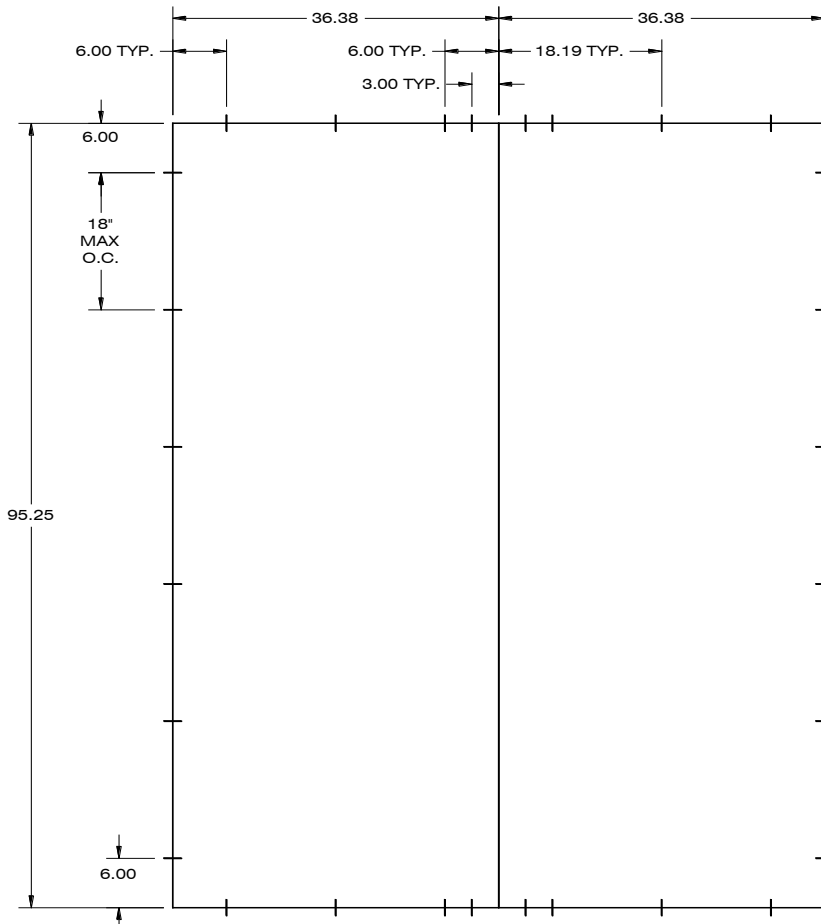

Luis R. Lomas P.E.  
 FL No.: 62514  
 10/10/2017



**L. Roberto Lomas P.E.**

1432 Woodford Rd.  
Lewisville, NC 27023  
434-688-0609

[rlomas@lrlomaspe.com](mailto:rlomas@lrlomaspe.com)

Manufacturer: Masonite  
Report #: 514011A  
Date: 10/10/2017


**Double door with sidelites**

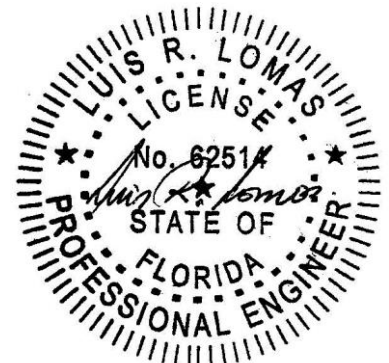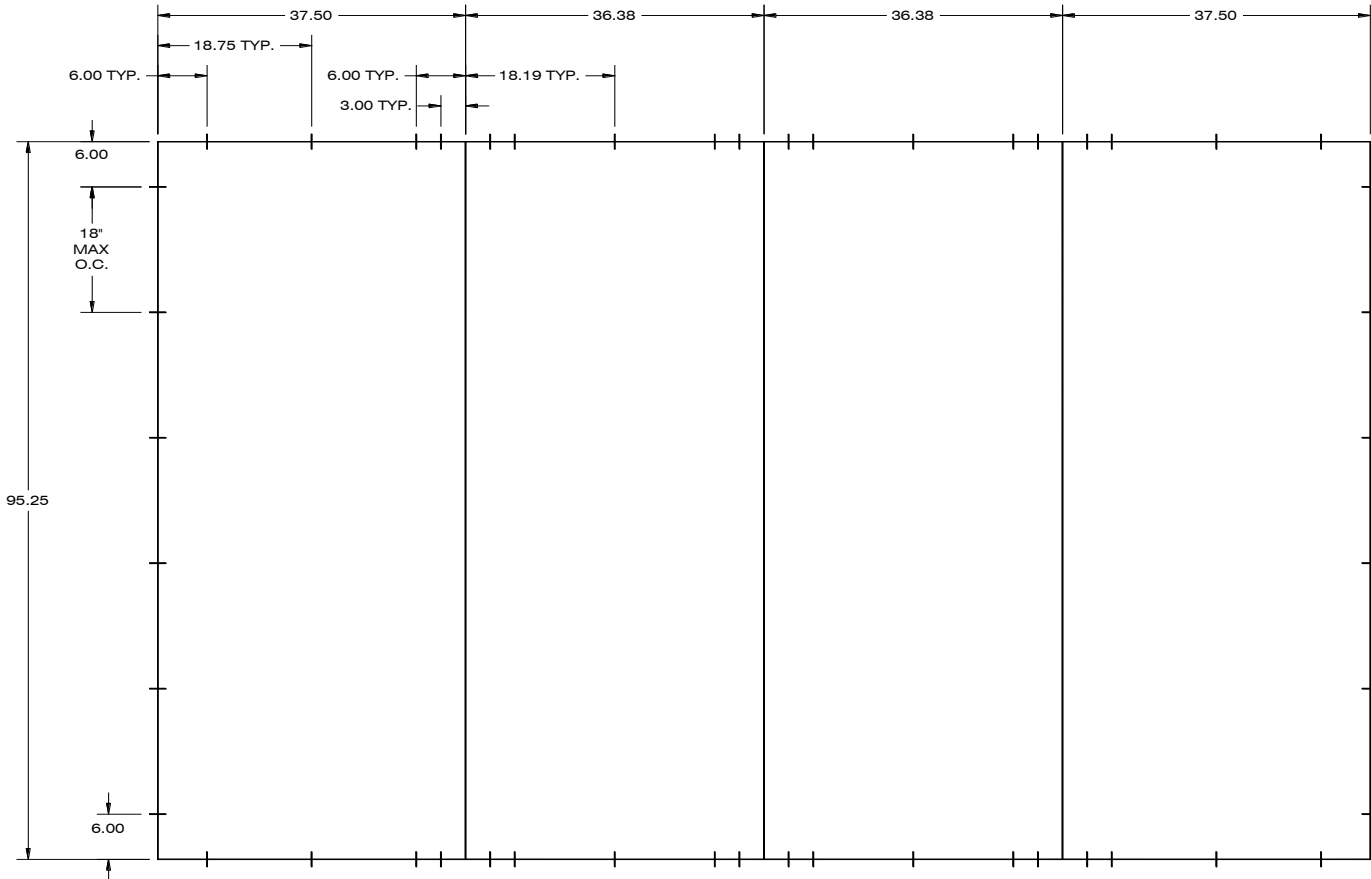

Luis R. Lomas P.E.  
FL No.: 62514  
10/10/2017

**Installation instructions:**

1. FOR ANCHORING THROUGH FRAME INTO WOOD FRAMING OR 2X BUCK USE #10 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 1/2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN BELOW.
2. FOR ANCHORING THROUGH FRAME INTO MASONRY/CONCRETE USE 1/4" TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2 1/2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN BELOW.
3. FOR ANCHORING THROUGH FRAME INTO METAL STRUCTURE USE #10 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL WITH 1/2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN BELOW.
4. ALL FASTENERS TO BE CORROSION RESISTANT.
5. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:
  - A. WOOD: MINIMUM SPECIFIC GRAVITY OF G=0.42
  - B. CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF 2,000 PSI.
  - C. MASONRY: HOLLOW/FILLED BLOCK PER ASTM C90 WITH Fm=2,000PSI MINIMUM.
  - D. METAL STRUCTURE: STEEL 18GA (.048") FY=33KSI/FU=52KSI OR ALUMINUM 6063-T5 FU=30KSI .052" THICK MINIMUM
6. ANCHOR LOCATIONS SHOWN IN THIS DOCUMENT ARE THE MINIMUM REQUIRED FOR THE DESCRIBED PRODUCT EXPOSED AT THE DESIGN PRESSURE INDICATED HEREIN.
7. WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
8. 1X BUCK OVER MASONRY/CONCRETE IS OPTIONAL.
9. WHERE SHIM OR BUCK THICKNESS IS LESS THAN 1-1/2" UNITS MUST BE ANCHORED THROUGH FRAME IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS. ANCHORS SHALL BE SECURELY FASTENED DIRECTLY INTO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE MATERIAL.
10. WHERE WOOD BUCK THICKNESS IS 1-1/2" OR GREATER, BUCK SHALL BE SECURELY FASTENED TO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE. UNITS MAY BE ANCHORED THROUGH FRAME TO SECURED WOOD BUCK IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS.
11. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
12. BUCKS SHALL EXTEND BEYOND WINDOW INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.

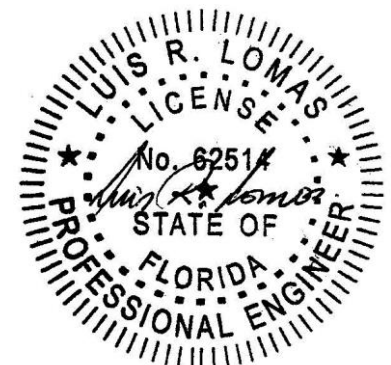

Luis R. Lomas P.E.  
FL No.: 62514  
10/10/2017