

# AL-FAROOQ CORPORATION

CONSULTING ENGINEERS & PRODUCT DEVELOPMENT

## PRODUCT APPROVAL EVALUATION RULE CHAPTER #61G20-3 • METHOD 1 OPTION D

FL 22528

Date: 09/29/2023

**Detailed Product Description:**

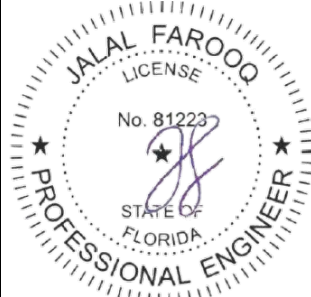
**Manufacturer:** E.S. WINDOWS, LLC.

**Manufacturer Address:** 3550 N.W. 49 STREET – MIAMI, FL. 33142

**Model Name:** SERIES ES-SD451 THERMAL ALUMINUM SLIDING GLASS DOOR

**Maximum Load:** +80 PSF, -80 PSF (Large Missile Impact)

**Installation Drawings #** W17-01

This product complies with the High Velocity Hurricane Zone (HVHZ) testing requirements.					
For maximum sizes, combination of span vs loads and anchor type refer to installation drawings.					
Comparative analysis used <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No					
<b>Mandatory Tests (Tested in accordance with AAMA 101/I.S.2/NAFS/TAS-202)</b>					
TEST	DESCRIPTION	TEST LOCATION	TEST REPORT DATE	TEST REPORT #	TEST SEALED BY
ASTM E283	Air Infiltration Leakage	Fenestration Testing Lab, Inc.	05/05/2017	FTL-8552	Idalmis Ortega, PE
ASTM E331 OR ASTM 547 & TAS 202	Water Penetration	Fenestration Testing Lab, Inc.	05/05/2017	FTL-8552	Idalmis Ortega, PE
ASTM E330 & TAS 202	Uniform Static Air Press.	Fenestration Testing Lab, Inc.	05/05/2017	FTL-8552	Idalmis Ortega, PE
ASTM F842	Forced Entry Test	Fenestration Testing Lab, Inc.	05/05/2017	FTL-8552	Idalmis Ortega, PE
<b>Supplemental Tests (Tested in accordance with TAS-201 and TAS-203)</b>					
TEST	DESCRIPTION	TEST LOCATION	TEST REPORT DATE	TEST REPORT #	TEST SEALED BY
FBC 1626.2 (TAS 201 & 203)	Large Missile Impact & Cyclic	Fenestration Testing Lab, Inc.	05/05/2017	FTL-8552	Idalmis Ortega, PE
Under the limitations of the attached installation drawings, to the best of my knowledge and ability, the above product conforms to the requirements of the 2023 Florida Building Code.					
<b>Evaluation Report Engineer:</b>					
Jalal Farooq PE # 81223 Al-Farooq Corporation EB # 3538					
			Sealed: 10/5/2023		