

Product Report

Manufacturer: Petersen Aluminum Corporation

102 Northpoint Parkway Building 106 Acworth, GA 30102 (800) 272-4482 NON-HVHZ

Florida Product Approval # 23157

Soffit Panels

Compliant with Florida Building Code 2023 (8th ed.) FBC 2023 Sec. 1709.10, Sec. 1404.5, Sec. 1405.2, 1405.11 Compliant with Florida Product Approval Rule # 61G20-3 Compliant Quality Assurance Program: UL LLC

FL 23157.1 Product: Flush Panel (0.032")

12" wide x 0.032" Aluminum Soffit Panel NON-HVHZ

Attached to 16GA support member or equivalent substrate secured with fasteners through the long lap leg, and side lap stitch fasteners in vertical legs. FBC Sec. 1405.11.1 & .2 Corrosion Resistant, additional requirement of (4) fasteners if the area supported exceeds (4) square feet. Panels are 12" wide with 1" right angle vertical legs, configured with nesting capabilities. Corrosion Resistant Compliant Fastener #10 x 1" Pancake Head fastened at each support to 16 GA Zeebar substrate or equivalent, #14 x 7/8" stitch lap fastener at 24" o.c. No pressure equalization factors have been used in analysis and panel may be used as a wall panel. Applicable load tables are included from testing and Petersen Aluminum Corporation.

MATERIAL:	.032"	.032" ALUM		.040" ALUM		24GA STEEL		A STEEL	
PANEL SPANS:	12"	48"	12"	48"	24"	60"	24"	60"	
ULTIMATE PSF LOAD/	-80/-40	-50/-25	-290/-145	-80/-40	-165/-82.5	-100/-50	-210/-105	-140/-70	
2.0 SAFTEY FACTOR*									

Limitations and Conditions of Use:

- 1. Products herein this report are compliant with current Florida Building Code (FBC)2023 8TH ed.
- 2. Install in compliance with FBC 2023., Install per Manufacturer's installation reference.
- 3. Product compliant for State of Florida product approval per Rule 61G20-3. Compliance Method: 1-D
- 4. Engineering analysis for "project specific project approval" to determine appropriate wind safety factors; is allowed by other Florida licensed professionals.
- 5. Fire classification is not part of this acceptance. Shear diaphragm values are outside this report.
- Support framing compliant w/FBC 2023 8th ed., Chapter 22 for Steel, Chapter 23 for Wood and Chapter 16 for Structural Loading.
- 7. This report does not imply warranty, installation, recommended product use outside of this report. **Test References:**


Fenestration Testing Lab TST 1657 Test # 7584-A ASTM 1592-05¹(2005)

EQUIVALENCY : ASTM E 1592-05, test standards are equivalent to ASTM E 1592-2015 test standards

Certificate of Independence:

Locke Bowden, P.E. does not have, not will acquire a financial interest in any company manufacturing or distributing products under this evaluation.

Locke Bowden, P.E. is not owned, operated or controlled by any company manufacturing or distributing products under this report.







Fenestration Testing Laboratory, Inc.

8148 N.W. 74th Avenue Medley, FL 33166 Phone: (305) 885-3328 Fax: (305) 885-3329 (888) 819-7877 e-mail: clientservices@fenlab.com www.fil-inc.com

Certificate Number	TST1657
Report Date:	2/5/2014
Completion Date:	1/23/2014
Expiration Date:	1/23/2024
Page:	8 of 17
Lab Number:	7584-A
Project Number:	13-4858

OFFICIAL TEST REPORT

Aluminum Flush Panel

12" wide by	0.032" thick	
Purlin	Span	Loads (psf)
ft	in	Test
		In the Local Control of the

π	IN	Test	Allowed
1.00	12	80	48
1.50	18		45
2.00	24		42
2.50	30		39
3.00	36		36
3.50	42		33
4.00	48	50	30

Design Load Safety Factor of 1.65

NOTES:

- 1. Tested in accordance with ASTM E 1592-05 Air Bag testing, negative uplift.
- 2. Intermediate values based on linear interpolation from tested values.

Allowed

3. Actual testing conducted at 1'-0" and 4'-0" spacing.

Aluminum Flush Panel

Purlin	Span	Loads (psf)	
ft	in	Test	Allowed
1.00	12	80	40
1.50	18		38
2.00	24		35
2.50	30		33
3.00	36		30
3.50	42		28
4.00	48	50	25

Design Load Safety Factor of 2.0


NOTES:

- 4. Tested in accordance with ASTM E 1592-05 Air Bag testing, negative uplift.
- 5. Intermediate values based on linear interpolation from tested values.

6. Actual testing conducted at 1'-0" and 4'-0" spacing.



PAC-CLAD FLUSH PANEL r.05/14

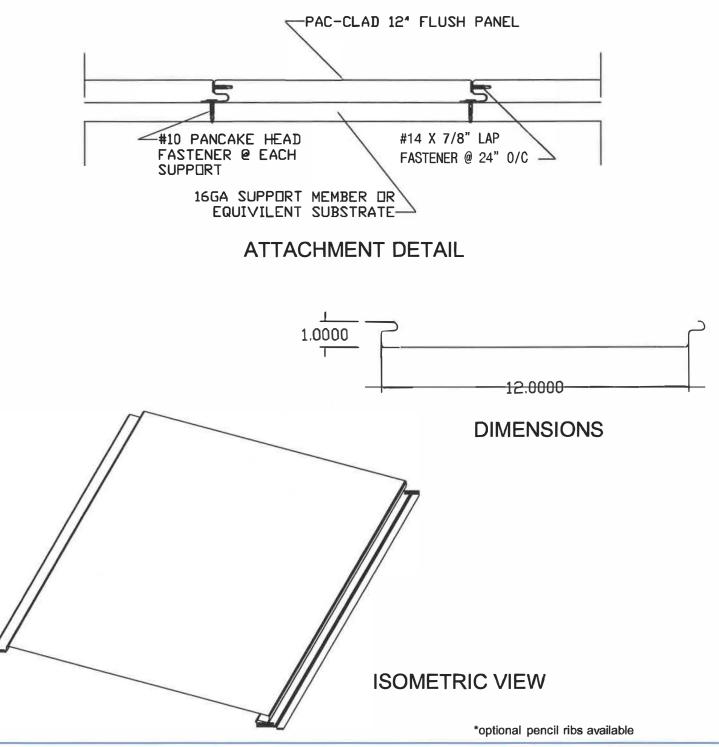

Petersen Aluminum Corporation 102 Northpoint Parkway Building 106 Acworth GA 30102 Toll Free: 800-272-4482 Fax: 770-420-2533 www.pac-clad.com