



398 E DANIA BEACH BLVD. SUITE 338, DANIA BEACH, FL 33004

## Product Evaluation Report

*of*

**Andersen Corporation  
E-Series Hinged Patio Door - Outswing  
(Non-HVHZ) (Non-Impact)**

*for*

**Florida Product Approval**

**FL# FL25570**

**Report No. 8531**

### Current Florida Building Code

**Method:** 1 – D (Engineering Evaluation)  
**Category:** Exterior Doors  
**Sub – Category:** Swinging Exterior Door Assemblies


**Product:** E-Series Hinged Patio Door - Outswing  
**Materials:** Wood & Aluminum Clad  
**Product Dimensions:** See Installation Instructions, AWD185

### Prepared for:

**Andersen Corporation  
100 Fourth Avenue North  
Bayport, Minnesota 55003**

### Prepared by:

**Hermes F. Norero, P.E.**  
Florida Professional Engineer # 73778  
Date: 05/11/2023

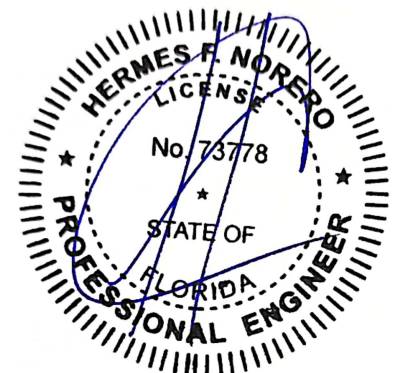

### Contents:

Evaluation Report Pages 1 – 4

Hermes F. Norero, P.E.  
Florida No. 73778

398 E DANIA BEACH BLVD. SUITE 338, DANIA BEACH, FL 33004

**Manufacturer:** Andersen Corporation

**Product Category:** Exterior Doors

**Product Sub-Category:** Swinging Exterior Door Assemblies

**Compliance Method:** State Product Approval Method (1)(d)

**Product Name:** E-Series Hinged Patio Door - Outswing  
(Non-HVHZ) (Non-Impact)

**Scope:** This is a Product Evaluation Report issued by Hermes F. Norero, P.E. (FL # 73778) for **Andersen Corporation** based on Method 1d of the State of Florida Product Approval, Department of Business and Professional Regulation - Florida Building Commission.

Hermes F. Norero, P.E. does not have nor will acquire financial interest in the company manufacturing or distributing the product or in any other entity involved in the approval process of the product named herein.

This product has been evaluated for use in locations adhering to the current Florida Building Code.

See Installation Instructions **AWD185**, signed and sealed by Hermes F. Norero, P.E. (FL # 73778) for specific use parameters.

**Limits of Use:**

1. This product has been evaluated and is in compliance with the current Florida Building Code, **excluding** the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment into substrate material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection this product complies with Chapter 16 of the current Florida Building Code and **does require** an impact resistant covering.
4. Site conditions that deviate from the details of installation instructions **AWD185** require further engineering analysis by a licensed engineer or registered architect.
5. See Installation Instructions **AWD185** for size and design pressure limitations.

398 E DANIA BEACH BLVD. SUITE 338, DANIA BEACH, FL 33004

**Quality Assurance:** The manufacturer has demonstrated compliance of manufacture of products in accordance with the current Florida Building Code for manufacturing under a quality assurance program audited by an approved quality assurance entity through **Window and Door Manufacturers Association-QA** (FBC Organization # QUA2515)

**Performance Standards:** The product described herein has been evaluated per:

- AAMA/WDMA/CSA 101/I.S.2/A440-17

**Referenced Data:**

1. Product Testing performed by **Architectural Testing, Inc. (an Intertek company) - Fridley, MN** (FBC Organization # TST1795)

Report #: C6613.01-201-44,	Report Date: 04/15/13
Report #: C6615.01-201-44,	Report Date: 04/15/13
Report #: C6616.01-201-44,	Report Date: 04/15/13
Report #: D0689.01-201-18,	Report Date: 01/07/14
Report #: D1787.01-201-44,	Report Date: 10/30/13
Report #: D4328.01-201-44,	Report Date: 06/29/15
Report #: D4329.01-201-44,	Report Date: 06/04/14
Report #: D4330.01-201-44,	Report Date: 06/04/14
Report #: D4332.01-201-44,	Report Date: 04/04/14
Report #: D4333.01-201-44,	Report Date: 04/04/14
Report #: D4334.01-201-44,	Report Date: 04/04/14
Report #: D4331.01-201-44,	Report Date: 03/25/14
Report #: D4337.01-201-44,	Report Date: 03/05/14
Report #: D5367.01-201-44,	Report Date: 06/12/14
Report #: G4235.01-201-44,	Report Date: 01/06/14
Report #: H6198.01-201-47,	Report Date: 06/09/15
Report #: H6200.01-201.47,	Report Date: 01/07/14
Report #: H6227.01-201.47,	Report Date: 06/29/15
Report #: H6229.01-201-47,	Report Date: 06/12/14

**Installation:**

Refer to Installation Instructions (**AWD185**) for anchor spacing and more details of the installation requirements.

**Design Pressure:**

Refer to Installation Instructions (**AWD185**) for design pressures based on size, configuration, and glass types.

**Equivalence of Test Standards:**

Various test standards have been evaluated for differences in test methodology, if any, between tested editions of the test standards listed below and those editions referenced in the current Florida Building Code. **Andersen Corporation** has tested their products to the following test standard edition(s):

- 1) AAMA/WDMA/CSA 101/I.S.2/A440-05/08/11

Chapter 35 of the current Florida Building Code references the following editions of the above mentioned test standards:

- 1) AAMA/WDMA/CSA 101/I.S.2/A440-17

After review of the above mentioned referenced standards and editions, it has been found that the results and tests carried out meet the requirements for compliance. All referenced standards have been found to be equivalent.