

Evaluation Report

"Knotwood" Series KED150

Metal Wall Assembly

Manufacturer:

OmniMax International, Inc.

30 Technology Pkwy S, Suite 400 / Suite 600
Peachtree Corners, GA 30092
(855) 566-8966

for

Florida Product Approval

FL 27460.1 R5

Florida Building Code 7th Edition (2020)

Method: 2 - B

Category: Panel Walls

Sub - Category: Siding

Product: "Knotwood" Wall Panel


Material: Aluminum

Panel Series: KED150

Prepared by:

James L. Buckner, P.E., S.E.C.B.
Florida Professional Engineer # 31242
Florida Evaluation ANE ID: 1916
Project Manager: Diana Galloway
Report No. 20-265-KWKED-A8W-ER
(Revises 19-145-Knotwood-A8W-ER, FL27460.1 R4)
Date: 04 / 12 / 22

This item has been electronically signed and sealed by James L. Buckner, P.E., on this date using a Digital Signature. Printed copies of this document are not considered signed and sealed, and the signature must be verified on any electronic copies.

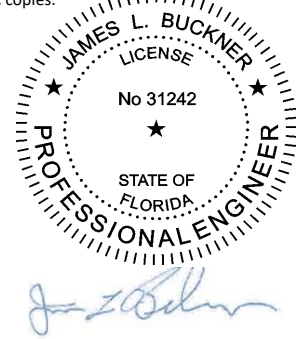

Contents:

Evaluation Report

Pages 1 – 7

2022.04.14 16:14:39 -04'00'

CBUCK, Inc. dba CBUCK Engineering

Phone: (561) 491-9927 · Email: cbuck@cbuckinc.net · Website: www.cbuckinc.net

Business: 1374 Community Dr., Jupiter, FL 33458 · Corp/Mailing: 201 N US HIGHWAY 1 STE D10 #1067, Jupiter, FL 33477

Manufacturer:	OmniMax International, Inc. 30 Technology Pkwy S, Suite 400 / Suite 600 Peachtree Corners, GA 30092 (855) 566-8966 http://www.knotwood.com/
Product Name:	"Knotwood" Series KED150
Product Category:	Panel Walls
Product Sub-Category	Siding
Compliance Method:	State Product Approval Rule 61G20-3.005 (2) (b)
Product/System Description:	"Knotwood" KED150 Wall Panel 0.080" Aluminum interlocking wall panel system with a wood-grain texture appearance, attached through plywood sheathing into wood supports.
Product Assembly as Evaluated:	Refer to Page 4 of this report for product assembly components/materials & standards: <ol style="list-style-type: none">1. Wall Panel2. Wall Panel Clips3. Fasteners4. Optional Fire Barrier or Sheathing Board
Support:	Type: Wood Studs with Optional Sheathing (Design of support system is outside the scope of this evaluation) Wood Stud Description: Stud Size:: 2" (min. thickness) Dimensional Lumber Stud Spacing: 24" o.c. max. Stud Span shall be per site specific Design Professional Sheathing Panel Options: <ul style="list-style-type: none">• 7/16" (nominal) or greater OSB (Oriented Strand Board), or• 15/32" (nominal) or greater Plywood• 1/2" (nominal) Gypsum Fiber Roof Deck Panel (Approved)
Performance:	Wind Resistance: <ul style="list-style-type: none">• Allowable Design Pressure: - 120 PSF (Refer to "Table A" attachment details herein)

Performance Standards:	<p>The product described herein has demonstrated compliance with:</p> <ul style="list-style-type: none">• TAS 201-94, <i>Impact Test Procedures</i>• TAS 202-94, Criteria for Testing Impact and Non-Impact Resistant Building Envelope Components Using Uniform Static Air Pressure Loading• TAS 203-94, Criteria for Testing Products Subject to Cyclic Wind Pressure Loading
Code Compliance:	<p>The product described herein has demonstrated compliance with Florida Building Code 7th Edition (2020), Section 1708.2.</p>
Evaluation Report Scope:	<p>This product evaluation is limited to compliance with the structural requirements of the Florida Building Code, as related to the scope section to Florida Product Approval Rule 61G20-3.001.</p>
Limitations and Conditions of Use:	<ul style="list-style-type: none">• Diaphragm and axial load capacity is outside the scope of this evaluation.• <u>Scope of "Limitations and Conditions of Use" for this evaluation:</u> This evaluation report for "Optional Statewide Approval" contains technical documentation, specifications and installation method(s) which include "Limitations and Conditions of Use" throughout the report in accordance with Rule 61G20-3.005. Per Rule 61G20-3.004, the Florida Building Commission is the authority to approve products under "Optional Statewide Approval".• <u>Option for application outside "Limitations and Conditions of Use"</u> Rule 61G20-3.005(1)(e) allows engineering analysis for "project specific approval by the local authorities having jurisdiction in accordance with the alternate methods and materials authorized in the Code". Any modification of the product as evaluated in this report and approved by the Florida Building Commission is outside the scope of this evaluation and will be the responsibility of others.• This report is a building code product evaluation per FLPE rule (FAC) 61G15-36 to comply with Florida product approval rule (FAC) 61G20-3. This evaluation report is part of the Florida Building Commission approval for the listed code related criteria. This report by James Buckner, P.E. and CBUCK Engineering is not a design certification of code compliance construction submittal documentation, per FBC section 107, for any individual structure, site specific or permit design.• Walls shall have a water-resistant barrier in accordance with FBC 7th Edition (2020), Section 1404.2.• All metal components and fasteners shall be corrosion resistant in accordance with applicable sections of FBC.• Design of support system is outside the scope of this report. Support shall be designed by others and shall comply with the FBC Chapters 22 for steel and Chapter 16 for structural loading.• Fire Classification is outside the scope of Rule 61G20-3, and is therefore not included in this evaluation.• This evaluation report does not evaluate the use of this product for use in the High Velocity Hurricane Zone code section. (Dade & Broward Counties).
Quality Assurance:	<p>The manufacturer has demonstrated compliance of wall panel products in accordance with the Florida Building Code and Rule 61G20-3.0005 (3) for manufacturing under a quality assurance program audited by an approved quality assurance entity.</p>

**Components/Materials
(by Manufacturer):**

Wall Panel System: "Knotwood"

Wall Panel Components
(All dimensions are nominal)

Wall Panel: **KED150-5650**
Material: Aluminum
Thickness: .080" (nominal)
Panel Width: 7-7/16" (5-7/8" Coverage)
Rib Height: 5/8"
Alloy Type: 6063 T5
Yield Strength: 21 ksi min.
Corrosion Resistance: In compliance with FBC Section 1405.2

Panel Clip: **KAOCC45**
Material: Aluminum
Thickness: .080" (nominal)
Panel Clip Size: 1-7/64"
Alloy Type: 6063 T5
Yield Strength: 21 ksi min.
Corrosion Resistance: In compliance with FBC Section 1405.2

Fastener:
Type: Hex-Head Wood Screw w/WSW
Size: 10 x 2-1/2"
Standard/ Approved per FBC Section 1405.17
Corrosion Resistance: Per FBC Section 1405.17

Cladding Starter Piece: **KEDSTR-5650**
Material: Aluminum
Thickness: .080" (nominal)
Dimensions: 5/8" x 1-11/16"
Alloy Type: 6063 T5
Yield Strength: 21 ksi min.
Corrosion Resistance: In compliance with FBC Section 1405.2

Cladding Top Clip Large **KECFTTLM-5650**
Material: Aluminum
Thickness: .060" (nominal)
Size: 2-9/16"
Alloy Type: 6063 T5
Yield Strength: 21 ksi min.
Corrosion Resistance: In compliance with FBC Section 1405.2

Cladding Flashing Base **KECFBF-5650**
Material: Aluminum
Thickness: .060" (nominal)
Size: 2-3/4"
Alloy Type: 6063 T5
Yield Strength: 21 ksi min.
Corrosion Resistance: In compliance with FBC Section 1405.2

Installation:

Installation Method:

(Refer to "TABLE A" below and drawings at the end of this report.)

- Attach panels with Clips and fasteners at spacing per Table "A"
- Support spacing: Per Table "A"
- Minimum fastener embedment into support, 1".
(through optional sheathing, into wood supports)
- For panel construction at the end of panels, including starter clip refer to manufacturer's instructions and any site specific design.

TABLE "A"	
Design Pressure:	± 120 PSF
Support Spacing:	24" o.c. (max.)
Panel Clip Spacing:	24" o.c. (max.)
# Fasteners per Clip:	1
Span Condition:	3 or more
Notes: <ul style="list-style-type: none">• Positive Pressure Inward/Negative Pressure Outward• Allowable design pressure(s) for allowable stress design (ASD).• Fastener Attachment to Steel Supports May Be Designed By A Qualified Design Professional As Required By The Florida Building Code For Site Specific Projects.• Diaphragm and axial load capacity are not included in this evaluation.	


Install the "Knotwood" wall panel assembly in compliance with the installation method listed in this report and applicable code sections of FBC 7th Edition (2020). The installation method described herein is in accordance with the scope of this evaluation report. Refer to manufacturer's installation instructions as a supplemental guide for attachment.

Referenced Data:


1. TAS 201, 202-94 and Cyclic Wind Pressure Loading portion of TAS 203
By Intertek Building & Construction) (FBC Organization
(Intertek/Architectural Testing, Inc. Lancaster, PA #TST ID:1558)
Report #: i6115.01-109-18, Report Date: 8/02/18
2. Engineering Analysis, 18-142-EA
By CBUCK Engineering
3. Quality Assurance
Keystone Certifications, Inc. (FBC Organization #: QUA 1824)
Licensee #10033
(Listed under Fabral, Inc. – a division of Omnimax International, Inc.)
4. Certification of Independence
By James L. Buckner, P.E. @ CBUCK Engineering
(FBC Organization # ANE 1916)

Installation Method
Omnimax International, Inc.
"Knotwood" KED150 Aluminum Wall Panel


Component Drawings

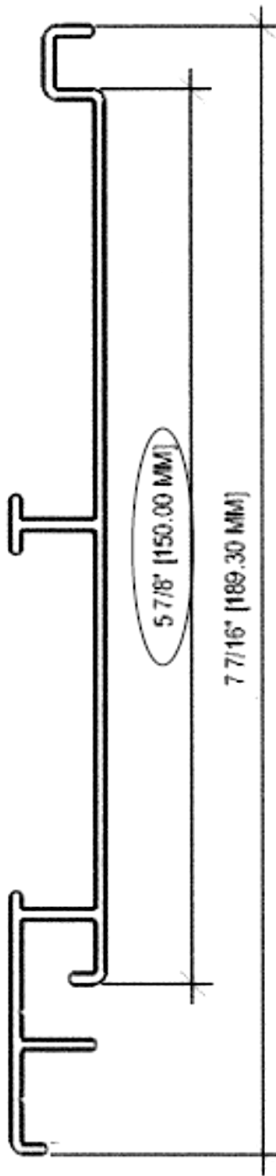


"Knotwood" (KED150-5650)
Typical Panel Profile




"Knotwood" (KAOCC45)
Cladding Clip

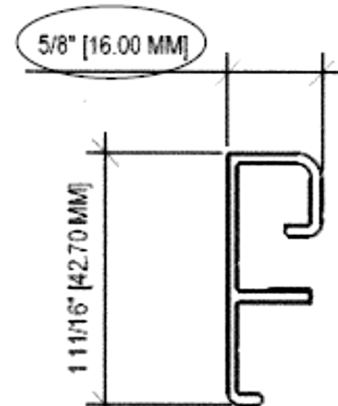

"Knotwood" (KEDSTR-5650)
Starter Piece

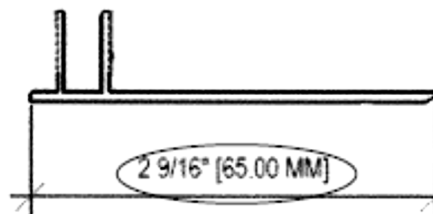


"Knotwood" (KECFTTLM-5650)
Top Clip Large

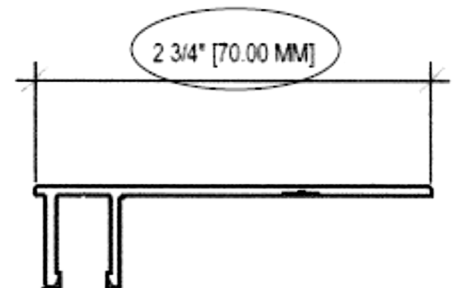


"Knotwood" (KECFBF-5650)
Flashing Base

**Installation Method
Omnimax International, Inc.
"Knotwood" KED150 Aluminum Wall Panel**

Assembly Drawings

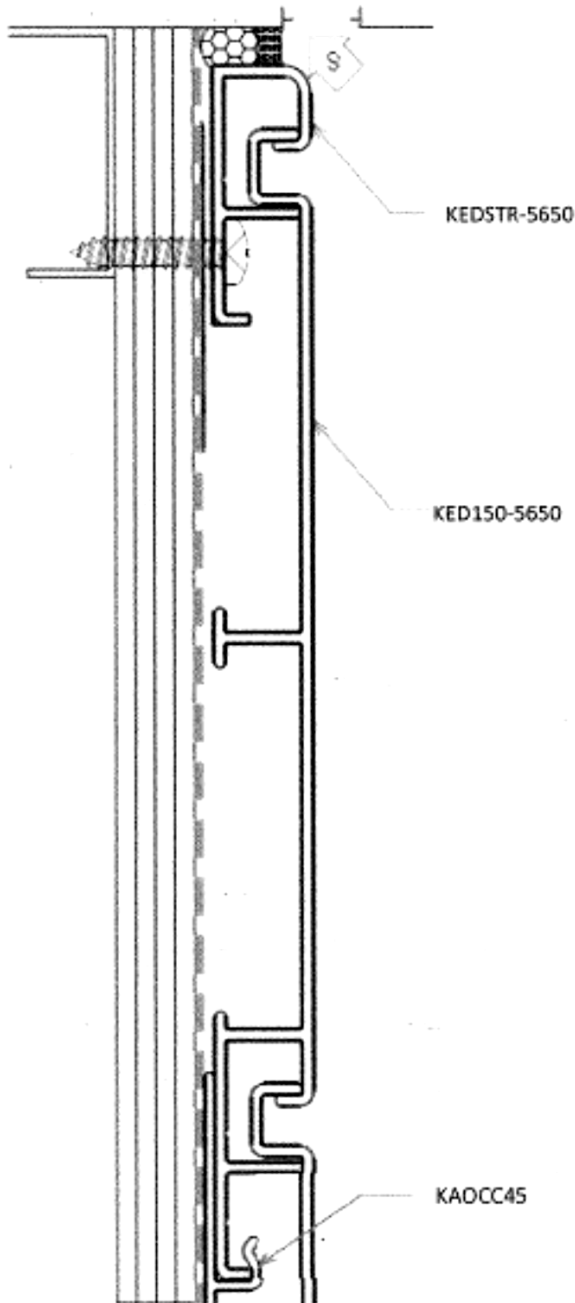

**"Knotwood" Top of Wall Assembly
Typical Side Profile**

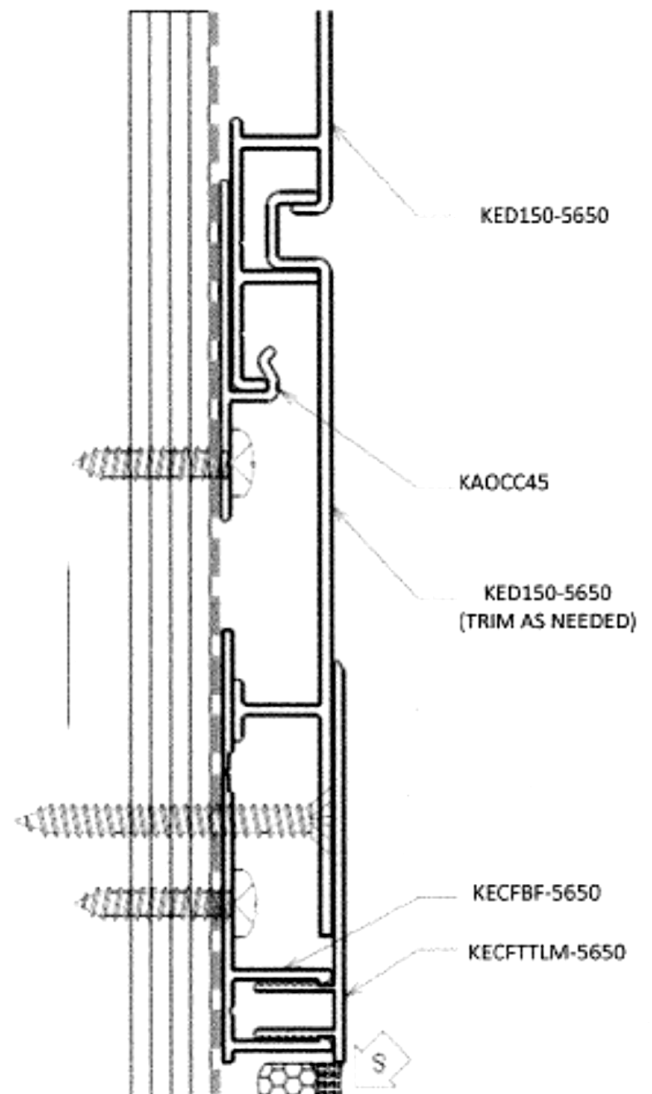

**"Knotwood" Bottom of Wall Assembly
Typical Side Profile**