

**PRODUCT EVALUATION REPORT**

**Mueller, Inc.**

**PBR Through Fastened Roof Panel Over Open Framing**

**Florida Product Approval Number FL 2807.1**

**Category: Structural Components**

**Sub-Category: Roof Deck**

**Compliance Method: 61G20-3.005 (1)(D)**

**NON-HVHZ**

**Product Manufacturer**

Mueller, Inc.  
1915 Hutchings Avenue  
Ballinger, Texas 76821

**Manufacturing Location**

Mueller, Inc.  
6914 Highway 2  
Oak Grove, Louisiana 71263

**Engineer Evaluator**


R. Keith Joyce, P.E., Florida 59081

**Validator**

Dennis Johnson, P.E. Florida 54340  
Florida C.O.A. 30308

**Contents**

**Evaluation Report Pages 1-4 Dated 07-03-2023**

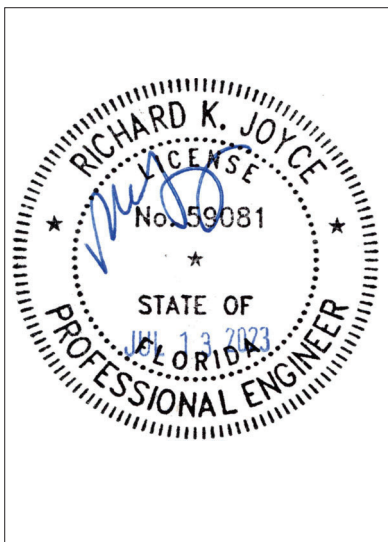

### **Compliance Statement**

The product described in this report has demonstrated compliance with the 2023 (8<sup>th</sup> Edition) Florida Building Code Sections 1504.3.2, 1504.7, 1507.4 and 2210.1.

### **Product Description**

Mueller PBR Through Fastened structural roof panels applied over open framing:

1. PBR 26 Gauge  
(0.0179 Sheet Thickness) with a minimum  $F_y = 80$  ksi and  $F_u = 82$  ksi 12-12 Fastener Spacing
2. PBR 26 Gauge  
(0.0179 Sheet Thickness) with a minimum  $F_y = 80$  ksi and  $F_u = 82$  ksi 5-7-5 Fastener Spacing

### **Panel Fastener**

Corrosion Resistant 1/4 – 14 HWH SD as indicated in the **Load Tables** of this Evaluation Report

### **Substrate Description**

Minimum 16 gauge (0.0596 steel thickness) open framing.  
Framing must be designed in accordance with the 2023 (8<sup>th</sup> Edition) Florida Building Code

### **Quality Assurance Entity**

The manufacturer has established compliance of products in accordance with the 2023 (8<sup>th</sup> Edition) Florida Building Code as relates to Rule 61G20-3.005(3) for manufacturing under a quality assurance program audited by an approved quality assurance entity.

### **Minimum Roof Slope**

Minimum roof slope of ½:12 shall comply with the 2023 (8<sup>th</sup> Edition) Florida Building Code, Including Section 1507.4.2 and in accordance with the Manufacturers recommendations. For slopes less than 3:12 lap sealant must be used at all side laps.

### **Insulation**

Manufacturer's approved products (optional)

### **Fire Classification**

Fire Classification is outside the scope of this evaluation


### **Shear Diaphragm**

Shear Diaphragm is outside the scope of this evaluation

### **Design Procedure**

Based on dimensions of the structure, appropriate wind loads are determined using chapter 16 of the 2023 (8<sup>th</sup> Edition) Florida Building Code for component loading of roof cladding. These component wind loads are compared to the allowable load listed in the **Load Tables** of this evaluation report. The design professional shall select appropriate fastener pattern and panel gauge to reference in the construction documents for proper installation. Design of support framing must be in compliance with the 2023 (8<sup>th</sup> Edition) Florida Building Code.


## R or PBR Panel Fastener Patterns

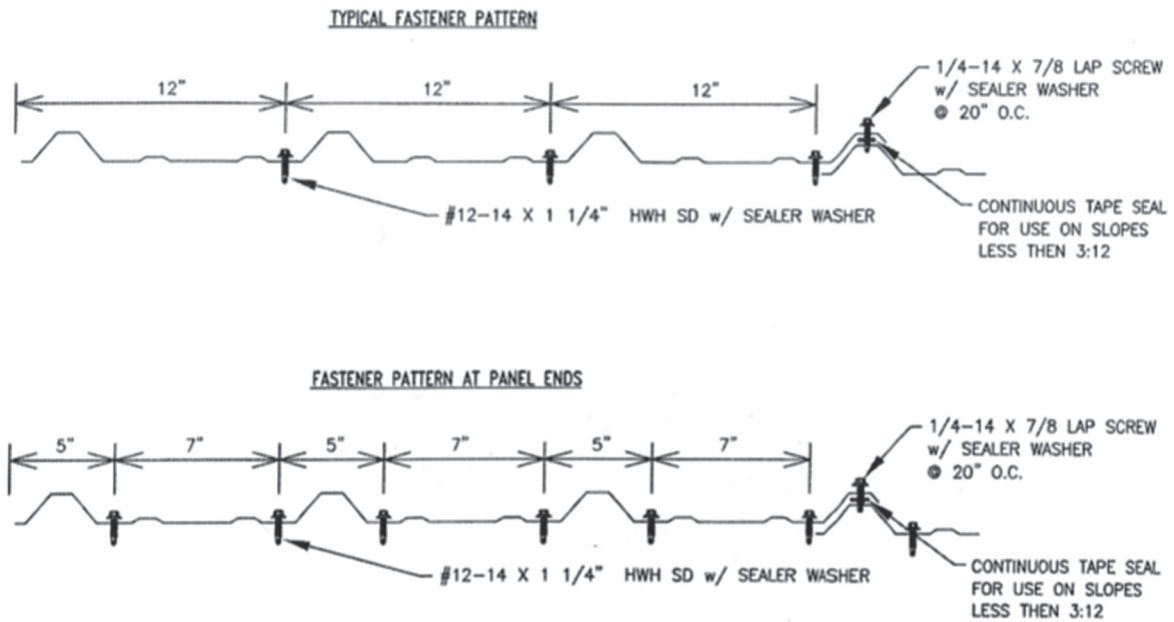

### Notes:

1. Fastener Pattern 5-7-5 is to be used at the ends of all panels
2. Fastener Pattern 12-12 and 5-7-5 are to be used at the intermediate supports as indicated in the span load tables to achieve the required uplift load capacity.

# Mueller (PBR)

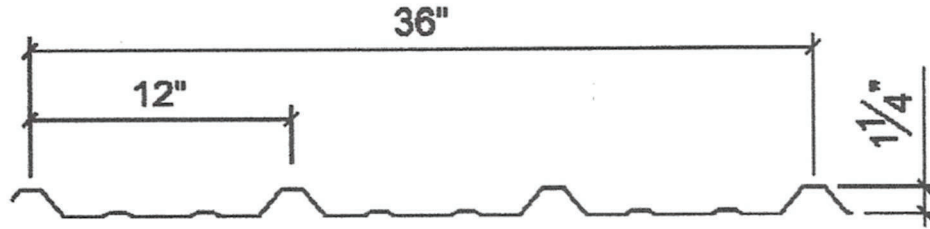

Mueller (PBR) Panel (26 Gauge)				Section Properties					
Panel Gauge	Fy	Fu	Weight	Negative Bending			Positive Bending		
				I <sub>xe</sub>	S <sub>xe</sub>	Maxo	I <sub>xe</sub>	S <sub>xe</sub>	Maxo
	ksi	Ksi	Psf	In <sup>4</sup>	In <sup>3</sup>	Kip-in	In <sup>4</sup>	In <sup>3</sup>	Kip-in
26	60*	61.5*	0.87	0.0275	0.0496	1.783	0.0407	0.0405	1.216

\*= Fy is 80 ksi, Fu is 82 ksi reduced to Fy = 60 ksi and Fu = 61.5 ksi in accordance with the 2016 North American Specification for Cold-Formed Steel Structural Members with Supplement 2 (2020), Section A2.3.2.

## Mueller, Inc.

### PRODUCT INFORMATION

### PBR PANEL

26 gauge (Fy = 60 ksi) #12-14 Fasteners on 12" centers for attachment to all supporting members (16 gauge supporting members minimum)**										
SPAN TYPE	LOAD TYPE	SPAN IN FEET								
		1.0	2.0	3.0	4.0	5.0	6.0	7.0	8.0	9.0
Single	Negative Wind Load	514.1	257.0	132.1	74.3	47.5	33.0	24.3	18.6	13.2
	Live Load/Deflection	357.6	178.8	90.0	50.7	32.4	22.5	16.5	12.7	10.0
2-Span	Negative Wind Load	205.6	102.8	68.5	49.1	31.8	22.2	16.4	12.6	9.9
	Live Load/Deflection	476.8	238.4	118.6	69.7	45.6	32.1	23.7	18.3	14.5
3-Span	Negative Wind Load	233.6	116.8	77.9	58.4	39.4	27.6	20.4	15.7	12.4
	Live Load/Deflection	447.0	223.5	140.7	79.1	50.7	35.2	25.8	19.8	15.6

26 gauge (Fy = 60 ksi) #12-14 Fasteners on 6" centers for attachment to all supporting members (16 gauge supporting members minimum)**										
SPAN TYPE	LOAD TYPE	SPAN IN FEET								
		1.0	2.0	3.0	4.0	5.0	6.0	7.0	8.0	9.0
Single	Negative Wind Load	1028.2	297.2	132.1	74.3	47.5	33.0	24.3	18.6	13.2
	Live Load/Deflection	357.6	178.8	90.0	50.7	32.4	22.5	16.5	12.7	10.0
2-Span	Negative Wind Load	411.3	181.1	85.4	49.1	31.8	22.2	16.4	12.6	9.9
	Live Load/Deflection	476.8	238.4	118.6	69.7	45.6	32.1	23.7	18.3	14.5
3-Span	Negative Wind Load	467.3	217.0	104.5	60.6	39.4	27.6	20.4	15.7	12.4
	Live Load/Deflection	447.0	223.5	140.7	79.1	50.7	35.2	25.8	19.8	15.6

\*\* = Fastener Diameter shall be 1/2" Minimum

#### Notes:

1. Allowable loads are based on uniform span length and uniformly distributed load.
2. Allowable gravity load is limited by bending, shear or deflection.
3. Allowable gravity loads are computed for a maximum total load deflection of L/60.
4. Weight of the panel must be included with gravity load combinations as appropriate.
5. This material is subject to change without notice
6. This material has been developed in accordance with the 2016 North American Specification for Cold-Formed Structural Steel Members with Supplement 2 (2020).

The engineering data contained herein is for the express use of the customers of Mueller Inc. and qualified design professionals.