

Engineering Evaluation Report: SIPA083118-20

Issued Date: 12/04/2018

Report Holder:
Structural Insulated Panel Association (SIPA)
P.O. Box 39848
Fort Lauderdale, FL 33339

Additional Listees:
ACME Panel Company
1905 West Main St.
Radford, VA 24141

The Murus Company
3234 Route 549
Mansfield, PA 16933

FischerSIPS
1844 Northwestern Parkway
Louisville, KY 40203

PorterCorp
4240 North 136th Avenue
Holland, MI 49424

1. SUBJECT

1.1 *Structural Insulated Panels. Wall Panels in 8-ft to 20-ft long spans, 4-5/8-in. to 12-1/4-in. thick.*

2. SCOPE

The evaluator has evaluated the above product(s) for compliance with the applicable sections of the following codes:

- 2.1 6th Edition Florida Building Code, Building (FBC)
- 2.2 State of Florida Product Approval Program Rule 61 G 20-3, FAC
- 2.3 Compliance Method: Evaluation Report from a Licensed Florida Professional Engineer

The evaluator has evaluated the following properties of the above product(s):

- 2.4 Structural performance under axial, transverse and in-plane shear loads
- 2.5 Use in High Velocity Hurricane Zones (HVHZ)
- 2.6 Surface burning characteristics

3. USES

3.1 **General.** *Structural Insulated Panels* are used as structural insulated wall panels capable of resisting transverse, axial and in-plane shear loads.


3.2 **Construction Types.** *Structural Insulated Panels* shall be considered combustible building elements when determining the Type of Construction in accordance with FBC Chapter 6.

3.3 **Fire Resistive Assemblies.** *Structural Insulated Panels* shall not be used as part of a fire-rated assembly unless suitable evidence and details are submitted and approved by the authority having jurisdiction.

3.4 **High Velocity Hurricane Zones.** *Structural Insulated Panels* with an overall thickness of at least 6-1/2-in. have demonstrated compliance with 6th Edition Florida Building Code, Building, Section 1626 for use in High Velocity Hurricane Zones in Risk Category 1, 2, and 3 when assembled in accordance with this report and the manufacturer's installation instructions.

4. DESCRIPTION

4.1 **General.** *Structural Insulated Panels* are factory-assembled, engineered-wood-faced, structural insulated panels (SIPs) with an expanded polystyrene (EPS) foam core. The product is intended for use as load-bearing or non-load-bearing wall panels. *Structural Insulated Panels* are available in 4-5/8-in. through 12-1/4-in. overall thicknesses and are custom-made to the specifications for each use. The maximum product size is 8-ft wide and up to 24-ft in length.

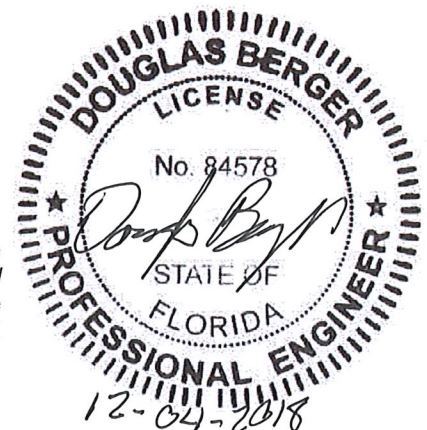

This Engineering Evaluation Report is intended to indicate that the Evaluator has evaluated the product(s) herein based on the information available at the time of report issuance. The Evaluator reserves the right to modify, amend or withdrawal this report at any time based on information that becomes available subsequent to the issuance of this report. The Evaluator makes no warranty, either expressed or implied, regarding the product covered by this report.

4.2 Materials.

4.2.1 Facing. The facing consists of two single-ply oriented strand board (OSB) facings a minimum of 7/16-in. thick conforming to the following minimum properties;

| Thickness | Product | Flatwise Stiffness (lbf-in ² /ft) | | Flatwise Strength (lbf-in/ft) | | Tension (lbf/ft) | | Density (pcf) |
|-----------|---------|---|--------|----------------------------------|--------|---------------------|--------|------------------|
| | | Along | Across | Along | Across | Along | Across | |
| 7/16 | OSB | 54,700 | 27,100 | 950 | 870 | 6,800 | 6,500 | 35 |

Additionally, facing materials shall conform to DOC PS 2, Exposure 1, Rated Sheathing with a span index of 24/16. Panels may be manufactured with the facing strength axis oriented in either direction with respect to the direction of product bending provided the appropriate design values are used.

4.2.2 Core. The core material is EPS foam plastic insulation conforming to ASTM C578, Type I. The foam core, up to 4-in. thickness, has a flame spread rating not exceeding 75 and a smoke-developed rating not exceeding 450 when tested in accordance with ASTM E84. Foam plastic in thicknesses greater than 4-in. has met the requirements found in 6th Edition FBC, Building 2603.9.

4.2.3 Adhesive. Facing materials are adhered to the core material using a thin-film adhesive. The adhesive is applied during the lamination process in accordance with the in-plant quality system documentation.

4.2.4 Material Sources. The facing, core and adhesive used in the construction of *Structural Insulated Panels* must be materials from approved sources as identified in the in-plant quality system documentation.

4.2.5 Splines. *Structural Insulated Panels* are interconnected with surface splines or block splines (Figure 1). Connections using dimensional lumber splines or engineered structural splines are not specifically addressed in this report and must be designed in accordance with accepted engineering practice to meet applicable code requirements.

4.2.5.1 Surface Splines. Surface splines (Figure 1) consist of 3-in. wide by 7/16-in. thick or thicker OSB. At each panel joint, one surface spline is inserted into each of two tight-fitting slots in the core. The slots in the core are located just inside the facing.


4.2.5.2 Block Splines. Block splines (Figure 1) are manufactured in the same manner as the SIP except with an overall thickness that is 1-in. less than the overall thickness of the panels to be joined.

5. DESIGN

5.1 Overall Structural System. The scope of this report is limited to the evaluation of the SIP component. Panel connections and other details related to incorporation of the product into the overall structural system of a building are beyond the scope of this report.

5.2 Design Approval. Where required by the authority having jurisdiction, structures using *Structural Insulated Panels* shall be designed by a registered design professional. Construction documents, including engineering calculations and drawings providing floor plans, window details, door details and connector details, shall be submitted to the code official when application is made for a permit. The individual preparing such documents shall possess the necessary qualifications as required by the applicable code and the professional registration laws of the state where the construction is undertaken. Approved construction documents shall be available at all times on the jobsite during installation.

5.3 Design Loads. Design loads to be resisted by the product shall be as required under the applicable code. Loads on the panels shall not exceed the loads noted in this report. Where loading conditions result in superimposed stresses, the sum of the ratio of actual loads over allowable loads shall not exceed one. Calculations demonstrating that the loads applied are less than the allowable loads described in this report shall be submitted to the code official for approval.

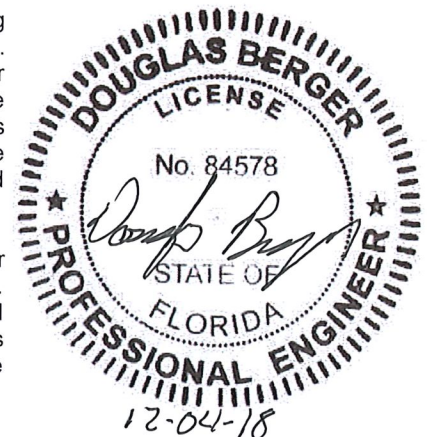

This Engineering Evaluation Report is intended to indicate that the Evaluator has evaluated the product(s) herein based on the information available at the time of report issuance. The Evaluator reserves the right to modify, amend or withdrawal this report at any time based on information that becomes available subsequent to the issuance of this report. The Evaluator makes no warranty, either expressed or implied, regarding the product covered by this report.

5.4 Allowable Loads. Allowable axial, transverse and in-plane shear loads may be calculated using the panel properties provided in Tables 1 and 2 or selected from Tables 3 through 10. For loading conditions not specifically addressed herein, structural members designed in accordance with accepted engineering practice shall be provided to meet applicable code requirements.

5.5 Concentrated Loads. Axial loads shall be applied to the product through continuous members such as structural insulated roof or floor panels or repetitive members such as joists, trusses or rafters spaced at regular intervals of 24-in. on center or less. Such members shall be fastened to a rim board or similar member to distribute the load to the product. For other loading conditions, reinforcement shall be provided. This reinforcement shall be designed in accordance with accepted engineering practice.

5.6 Eccentric and Side Loads. Axial loads shall be applied concentrically to the top of the product. Loads shall not be applied eccentrically or through framing attached to one side of the panel (such as balloon framing) except where additional engineering documentation is provided.

5.7 Openings. Openings in panels are permitted when the header depth is at least 12-in., the interior opening is reinforced with lumber or steel and the panels are not used to resist in-plane shear loads. Joints between SIPs are not permitted within 6-in. of the end of the header and are not permitted within the header. Allowable transverse and axial loads for maximum header spans of 36-in. may be selected from Tables 6 and 8. Allowable transverse and axial loads for maximum header spans of 72-in. may be selected from Tables 7 and 9. Openings in panels beyond the scope of this report shall be reinforced with wood or steel designed in accordance with accepted engineering practice to resist all loads applied to the opening as required by the adopted code. Details for door and window openings shall be provided to clarify the manner of supporting axial, transverse and/or in-plane shear loads at openings. Such details shall be subject to approval by the local authority having jurisdiction.

5.8 In-Plane Shear Design. Shear walls utilizing block or surface splines shall be sized to resist all code required wind and seismic loads without exceeding the allowable loads provided herein. Shear wall chords, hold-downs and connections to transfer shear forces between the wall and surrounding structure shall be designed in accordance with accepted engineering practice. Allowable strengths for SIP shear walls with structural splines along each panel edge shall be designed in accordance with accepted engineering practice and are subject to the limitations for wood sheathed shear walls.

5.8.1 Seismic Design Categories A, B, and C. Use of the shear wall configurations in Table 10 is limited to structures in Seismic Design Categories A, B and C. Where SIPs are used to resist seismic forces the following factors shall be used for design: Response Modification Coefficient, $R = 2.0$; System Overstrength Factor, $\Omega_o = 2.5$; Deflection Amplification Factor, $C_d = 2.0$. The maximum panel height-to-width ratio shall be 2:1.


5.9 High Velocity Hurricane Zones. Panels with an overall thickness of at least 6-1/2-in. have met the requirements of 6th Edition FBC, Building, Section 1626, using the missile impact speed required for risk categories 1, 2 and 3. Panels used in High Velocity Hurricane Zones shall be constructed using a minimum of 0.131 x 2-1/2-in. smooth shank round head nails 6-in. on center at all spline connections and at panel facing to top and bottom plate connections. Top and bottom plates shall be a minimum of #2 SPF 2x dimensional lumber.

5.10 Combined Loads. Panels subjected to any combination of transverse, axial or in-plane shear loads shall be analyzed utilizing a straight-line interaction.

6. INSTALLATION

6.1 General. *Structural Insulated Panels* shall be fabricated, identified and erected in accordance with this report, the approved construction documents, the manufacturer's installation instructions uploaded as part of this product approval, and the applicable codes. In the event of a conflict between the manufacturer's installation instructions and this report, this report shall govern. Approved construction documents shall be available at all times on the jobsite during installation.

6.2 Splines. *Structural Insulated Panels* are interconnected at the panel edges through the use of a spline. The spline type may be of any configuration listed in Section 4.2.5 as required by the specific design. The spline shall be secured in place with not less than

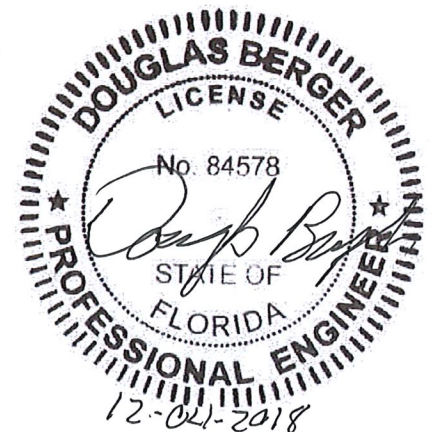

This Engineering Evaluation Report is intended to indicate that the Evaluator has evaluated the product(s) herein based on the information available at the time of report issuance. The Evaluator reserves the right to modify, amend or withdrawal this report at any time based on information that becomes available subsequent to the issuance of this report. The Evaluator makes no warranty, either expressed or implied, regarding the product covered by this report.

0.131-in. x 2-1/2-in. nails, spaced 6-in. on center on both sides of the panel, or an approved equivalent fastener. All joints shall be sealed in accordance with the SIP manufacturer's installation instructions. Alternate spline connections may be required for panels subjected to in-plane shear forces. Such panels shall be interconnected exactly as required in Table 10 or as directed by the designer.

6.3 Plates. The top and bottom plates of the panels shall be dimensional or engineered lumber sized to match the core thickness of the panel. The plates shall be secured using not less than 0.131-in. x 2-1/2-in. nails, spaced 6-in. on center on both sides of the panel, or an approved equivalent fastener. A second top plate of 1-1/8-in. minimum thickness dimensional or engineered lumber with a specific gravity of 0.42 that is cut to the full thickness of the panel shall be secured to the first top plate using 0.131-in. x 3-in. nails or an approved equivalent fastener.

6.4 Cutting and Notching. No field cutting or routing of the panels shall be permitted except as shown on approved construction documents.

6.5 Protection from Decay. SIPs that rest on exterior foundation walls shall not be located within 8-in. of exposed earth. SIPs supported by concrete or masonry that is in direct contact with earth shall be protected from the concrete or masonry by a moisture barrier.

6.6 Protection from Termites. In areas subject to damage from termites, SIPs shall be protected from termites using an approved method. Panels shall not be installed below grade or in contact with earth.

6.7 Heat-Producing Fixtures. Heat-producing fixtures shall not be installed in the panels unless protected by a method approved by the code official or documented in test reports. This limitation shall not be interpreted to prohibit heat-producing elements with suitable protection.

6.8 Plumbing Installation Restrictions. Plumbing and waste lines may extend at right angles through the wall panels but are not permitted vertically within the core. Lines shall not interrupt splines or panel plates unless approved by a registered design professional.


6.9 Voids and Holes

6.9.1 Voids in Core. In lieu of openings designed in accordance with section 5.7, the following voids are permitted. Voids may be provided in the panel core during fabrication at predetermined locations only. Voids parallel to the panel span shall be limited to a single 1-in. maximum diameter hole. Such voids shall be spaced a minimum of 4-ft on center measured perpendicular to the panel span. Two 1/2-in. diameter holes may be substituted for the single 1-in. hole provided they are maintained parallel and within 2-in. of each other. Voids perpendicular to the panel span shall be limited to a single 1-in. maximum diameter hole placed not closer than 16-in. from the support. Additional voids in the same direction shall be spaced not less than 28-in. on center.

6.9.2 Holes in Panels. Holes may be placed in panels during fabrication at predetermined locations only. Holes shall be limited to 4-in. by 4-in. square. The minimum distance between holes shall not be less than 4-ft on center measured perpendicular to the panel span and 24-in. on center measured parallel to the panel span. Not more than three holes shall be permitted in a single line parallel to the panel span. The holes may intersect voids permitted elsewhere in this report.

6.10 Panel Cladding

6.10.1 Exterior Wall Covering. Panels shall be covered on the exterior by a water-resistive barrier as required by the applicable code. The water-resistive barrier shall be attached with flashing in such a manner as to provide a continuous water-resistive barrier behind the exterior wall veneer. The exterior facing of the SIP wall shall be covered with weather protection as required by the adopted building code or other approved materials. Panels to be used in High Velocity Hurricane Zones shall have panel-to-panel spline connections sealed as shown in Figure 3. A polyurethane construction adhesive or approved equivalent shall be used in spline to facing interfaces. A polyurethane expanding foam sealant or approved equivalent shall be used at the foam to foam interface at the panel connection.

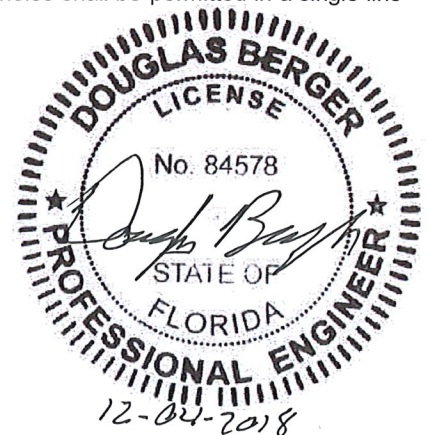

This Engineering Evaluation Report is intended to indicate that the Evaluator has evaluated the product(s) herein based on the information available at the time of report issuance. The Evaluator reserves the right to modify, amend or withdrawal this report at any time based on information that becomes available subsequent to the issuance of this report. The Evaluator makes no warranty, either expressed or implied, regarding the product covered by this report.

6.11 Interior Finish. The SIP foam plastic core shall be separated from the interior of the building by an approved thermal barrier of 1/2-in. gypsum wallboard or equivalent thermal barrier where required by 6th Edition FBC Section 2603.4.

7. CONDITIONS OF USE

Structural Insulated Panels as described in this report comply with the codes listed in Section 2 above, subject to the following conditions:

7.1 Installation complies with this report and the approved construction documents.

7.2 This report applies only to the panel thicknesses specifically listed herein.

7.3 In-use panel heights/spans shall not exceed the values listed herein. Extrapolation beyond the values listed herein is not permitted.

7.4 The panels are manufactured in the production facilities listed in this report.

8. EVIDENCE SUBMITTED

The Evaluator has examined the following evidence to evaluate this product:

8.1 Test Reports:

8.1.1 ASTM E72-02 Section 9, Axial Load, NTA Test Laboratory, IAS Lab Certification No. TL-259, Test Report Numbers:

- 8.1.1.1** PSC030508-2, 48x96x4.625, 6/30/2008
- 8.1.1.2** PSC030508-4, 48x96x8.375, 6/30/2008
- 8.1.1.3** PSC030508-5, 48x96x8.375, 6/30/2008
- 8.1.1.4** PSC030508-9, 48x96x4.625, 6/30/2008
- 8.1.1.5** PSC041108-26, 48x144x4.625, 6/30/2008
- 8.1.1.6** PSC041108-28, 48x240x8.375, 6/30/2008
- 8.1.1.7** PSC041108-29, 48x216x6.625, 6/30/2008
- 8.1.1.8** PSC061008-3, 48x96x8.375, 8/15/2008

8.1.2 ASTM E72-05 Section 9, Axial Load, NTA Test Laboratory, IAS Lab Certification No. TL-259, Test Report Numbers:

8.1.2.1 PSC042209-12, 48x96x4.625, 6/10/2009

8.1.3 ASTM E72-10 Section 9, Axial Load, NTA Test Laboratory, IAS Lab Certification No. TL-259, Test Report Numbers:

- 8.1.3.1** ENR(688)100112-13, 48x96x4.625, 10/24/2012
- 8.1.3.2** EPS(3324)011315-46, 48x96x4.625, 8/7/2015
- 8.1.3.3** EPS052512-3, 48x96x4.625, 10/10/2012

8.1.4 ASTM E72-10 Section 9, Axial Load, NTA Test Laboratory, IAS Lab Certification No. TL-259, Test Report Numbers:

8.1.4.1 PPFMI(745)020613-4, 48x96x4.625, 1/28/2014

8.1.5 ASTM E72-15 Section 9, Axial Load, NTA Test Laboratory, IAS Lab Certification No. TL-259, Test Report Numbers:

8.1.5.1 ACP(647)062717-25, 48x96x4.625, 9/19/2017

8.1.5.2 ATLC062717-24, 48x96x4.625, 9/19/2017

8.1.5.3 JDI(712)032717-15, 48x96x4.625, 6/27/2017

8.1.5.4 SIPA020216-31, Opening, 8/26/16

8.1.5.5 SIPA020216-32, Opening, 8/26/16

8.1.5.6 SIPA020216-33, Opening, 8/26/16

8.1.5.7 SIPA020216-34, Opening, 8/26/16

8.1.5.8 SIPA020216-35, Opening, 8/26/16

8.1.5.9 SIPA030216-13, Opening, 8/26/16


8.1.5.10 SIPA030216-14, Opening, 8/26/16

8.1.5.11 SIPA030216-15, Opening, 8/26/16

8.1.5.12 SIPA030216-16, Opening, 8/26/16

8.1.5.13 SIPA030216-17, Opening, 8/26/16

8.1.6 ASTM E72-02 Section 11, Transverse Load, NTA Test Laboratory, IAS Lab Certification No. TL-259, Test Report Numbers:

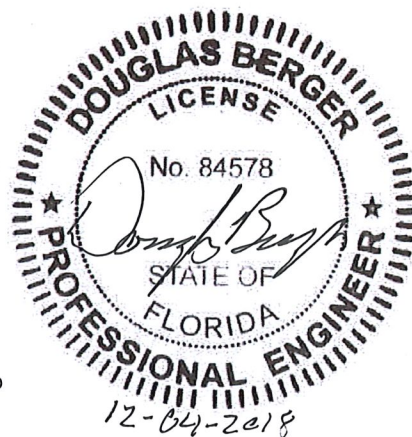

This Engineering Evaluation Report is intended to indicate that the Evaluator has evaluated the product(s) herein based on the information available at the time of report issuance. The Evaluator reserves the right to modify, amend or withdrawal this report at any time based on information that becomes available subsequent to the issuance of this report. The Evaluator makes no warranty, either expressed or implied, regarding the product covered by this report.

Engineering Evaluation Report: SIPA083118-20


Issued Date: 12/04/2018

- 8.1.6.1 PSC021208-23, 48x96x4.625, 6/30/2008
- 8.1.6.2 PSC031308-4, 48x144x4.625, 6/30/2008
- 8.1.6.3 PSC030508-8, 48x96x4.625, 6/30/2008
- 8.1.6.4 PSC031208-1, 48x96x12.375, 6/30/2008
- 8.1.6.5 PSC031208-2, 48x96x4.625, 6/30/2008
- 8.1.6.6 PSC031208-3, 48x96x12.375, 6/30/2008
- 8.1.6.7 PSC031208-4, 48x240x12.375, 6/30/2008
- 8.1.6.8 PSC031208-6, 48x192x10.375, Vertical, 6/30/2008
- 8.1.6.9 PSC031208-7, 48x148x4.625, Vertical, 6/30/2008

- 8.1.7 ASTM E72-05 Section 11, Transverse Load, NTA Test Laboratory, IAS Lab Certification No. TL-259, Test Report Numbers:
 - 8.1.7.1 PSC021208-10, 48x96x8.375, 6/30/2008
 - 8.1.7.2 PSC021508-19, 48x96x4.625, 6/30/2008
 - 8.1.7.3 PSC031308-1, 48x240x8.375, 6/30/2008
 - 8.1.7.4 PSC031308-2, 48x216x6.625, 6/30/2008
 - 8.1.7.5 PSC120407-4, 48x96x8.375, 6/30/2008
 - 8.1.7.6 FSH022709-15, 48x96x6.5, 11/9/2009
 - 8.1.7.7 STI092508-32, 48x96x8.375, 11/19/2008
 - 8.1.7.8 TPC032808-4, 48x96x8.25, 48x240x8.25 1/19/2010
 - 8.1.7.9 PSC030110-8, 48x96x4.625, 12/21/2010
 - 8.1.7.10 EHS082908-32, 48x96x8.25, 1/5/2009
 - 8.1.7.11 EPS011209-20, 48x96x8.375, 5/28/2009
 - 8.1.7.12 FRD070511-22, 48x96x6.5, 7/21/2011
 - 8.1.7.13 IBP091409-14, 48x96x6.5, 12/20/2010
 - 8.1.7.14 PSC042209-10, 48x96x4.625, 6/10/2009
 - 8.1.7.15 PSC042209-11, 48x168x4.625, 6/10/2009
 - 8.1.7.16 STI081209-16, 48x96x6.5, 11/6/2009
 - 8.1.7.17 EHS111808-7, 48x96x8.375, 12/22/2008
 - 8.1.7.18 PSC061008-1, 48x96x8.375, 8/15/2008
 - 8.1.7.19 PSC061008-4, 48x240x8.375 8/15/2008
 - 8.1.7.20 STI092508-32, 48x96x8.375, 11/19/2008
 - 8.1.7.21 TPC041210-31, 48x96x8.25, 9/1/2010

- 8.1.8 ASTM E72-10 Section 11, Transverse Load, NTA Test Laboratory, IAS Lab Certification No. TL-259, Test Report Numbers:
 - 8.1.8.1 ATL061411-3, 48x96x6.5, 7/19/2011
 - 8.1.8.2 ENR(688)100112-11, 48x96x4.625, 10/24/2012
 - 8.1.8.3 ENR(688)100112-12, 48x168x4.625, 10/24/2012
 - 8.1.8.4 EPS(3324)011315-46, 48x96x4.625, 48x168x4.625, 8/7/2015
 - 8.1.8.5 FSH072412-5, 48x96x4.625, 48x168x4.625, 2/27/2013
 - 8.1.8.6 EPS052512-3, 48x96x4.625, 48x122x4.625, 10/10/2012
 - 8.1.8.7 MUR(660)022513-10, 48x96x4.625, 48x168x4.625, 11/2/2015
 - 8.1.8.8 MUR083109-36, 48x96x6.5, 9/23/2011
 - 8.1.8.9 EPS(549)123014-7, 48x96x4.625, 48x168x4.625, 8/28/2015
 - 8.1.8.10 PPFMI(745)020613-4, 48x96x4.625, 48x168x4.625, 1/28/2014
 - 8.1.8.11 STI030111-9, 48x96x6.5, 6/13/2011
 - 8.1.8.12 TPC052912-15, 48x96x6.5, 3/4/2013
 - 8.1.8.13 VNT050211-17, 48x96x4.625, 10/26/2011
 - 8.1.8.14 VNT(679)120811-2, 48x96x6.5, 8/17/2012

- 8.1.9 ASTM E72-15 Section 11, Transverse Load, NTA Test Laboratory, IAS Lab Certification No. TL-259, Test Report Numbers:
 - 8.1.9.1 ACP(647)062717-25, 48x96x4.625, 48x168x4.625, 9/19/2017

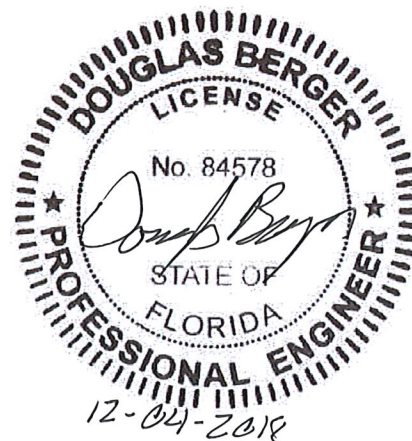

This Engineering Evaluation Report is intended to indicate that the Evaluator has evaluated the product(s) herein based on the information available at the time of report issuance. The Evaluator reserves the right to modify, amend or withdrawal this report at any time based on information that becomes available subsequent to the issuance of this report. The Evaluator makes no warranty, either expressed or implied, regarding the product covered by this report.

- 8.1.9.2 ATLC062717-24, 48x96x4.625, 48x96x168, 9/19/2017
- 8.1.9.3 EPS(549)091416-16, 48x96x4.625, 48x96x168, 11/29/2016
- 8.1.9.4 JDI(712)032717-15, 48x96x4.625, 48x96x168, 6/27/2017
- 8.1.9.5 SIPA030216-18, Opening, 8/26/16
- 8.1.9.6 SIPA030216-19, Opening, 8/26/16
- 8.1.9.7 SIPA030216-20, Opening, 8/26/16
- 8.1.9.8 SIPA030216-21, Opening, 8/26/16
- 8.1.9.9 SIPA030216-22, Opening, 8/26/16
- 8.1.9.10 SIPA020216-36, Opening, 8/26/16
- 8.1.9.11 SIPA020216-37, Opening, 8/26/16
- 8.1.9.12 SIPA020216-38, Opening, 8/26/16
- 8.1.9.13 SIPA020216-39, Opening, 8/26/16
- 8.1.9.14 SIPA020216-40, Opening, 8/26/16
- 8.1.9.15 TOIS030116-64, 48x96x4.625, 6/21/2016

8.1.10 ASTM E72-02 Section 1 4, Racking Load, NTA Test Laboratory, IAS Lab Certification No. TL-259, Test Report Numbers:

- 8.1.10.1 PSC031208-40, (2)48x96x4.625, 6/30/2008
- 8.1.10.2 PSC031708-2, (2)48x96x8.375, 6/30/2008
- 8.1.10.3 PSC042308-13, (2)48x96x8.375, 6/30/2008
- 8.1.10.4 EHS111808-10, (2)48x96x8.375, 12/22/2008
- 8.1.10.5 PSC061008-2, (2)48x96x8.375, 8/15/2008

8.1.11 ASTM D2126 Cyclic Shear Wall Testing, APA, IAS Lab TL-215, Test Report Numbers:

- 8.1.11.1 T2010P-55, 11/30/2010

8.1.12 TAS 201-94, TAS 202-94 and TAS 203-94, NTA, Inc., IAS Lab Certification No. TL-259, Test Report Numbers:

- 8.1.12.1 SIPA091518-1, TAS 201-94, TAS 202-94, TAS203-94, Florida P.E. Seal, Douglas Berger, FL 84578, 11/09/2018

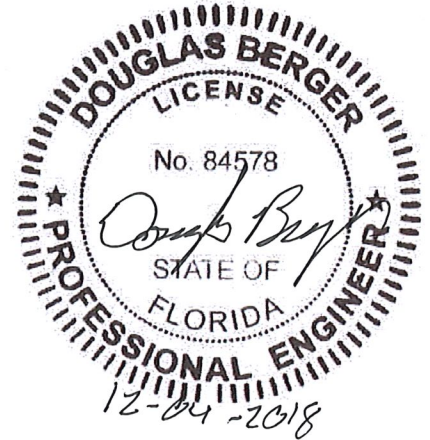


Table 1: Basic Properties¹

| Property | Weak-Axis Bending | Strong-Axis Bending |
|---|-------------------|---------------------|
| Allowable Tensile Stress, F_t (psi) | 245 | 495 |
| Allowable Compressive Stress, F_c (psi) | 340 | 580 |
| Elastic Modulus (Bending), E_b (psi) | 738900 | 658800 |
| Shear Modulus, G (psi) | 270 | 405 |
| Allowable Core Shear Stress, F_v (psi) | 4.5 | 5.0 |
| Core Compressive Modulus, E_c (psi) | 360 | 360 |
| Reference Depth, h_o (in.) | 4.625 | 4.625 |
| Shear Depth Factor Exponent, m | 0.84 | 0.86 |

¹ All properties are based on a minimum panel width of 24-in.

This Engineering Evaluation Report is intended to indicate that the Evaluator has evaluated the product(s) herein based on the information available at the time of report issuance. The Evaluator reserves the right to modify, amend or withdrawal this report at any time based on information that becomes available subsequent to the issuance of this report. The Evaluator makes no warranty, either expressed or implied, regarding the product covered by this report.

Table 2: Section Properties

| Panel Thickness, h (in.) | Core Thickness, c (in.) | Dead Weight, w_d (psf) | Facing Area, A_f (in. ² /ft) | Shear Area, A_v (in. ² /ft) | Moment of Inertia, I (in. ⁴ /ft) | Section Modulus, S (in. ³ /ft) | Radius of Gyration, r (in.) | Centroid -to- Facing Dist., y_c (in.) |
|----------------------------|---------------------------|--------------------------|---|--|---|---|-------------------------------|---|
| 4.625 | 3.75 | 3.2 | 10.5 | 50.3 | 46.0 | 19.9 | 2.09 | 2.31 |
| 6.50 | 5.625 | 3.3 | 10.5 | 72.8 | 96.5 | 29.7 | 3.03 | 3.25 |
| 8.25 | 7.375 | 3.5 | 10.5 | 93.8 | 160.2 | 38.8 | 3.91 | 4.13 |
| 10.25 | 9.375 | 3.6 | 10.5 | 117.8 | 252.7 | 49.3 | -- | -- |
| 12.25 | 11.375 | 3.8 | 10.5 | 141.8 | 366.3 | 59.8 | -- | -- |

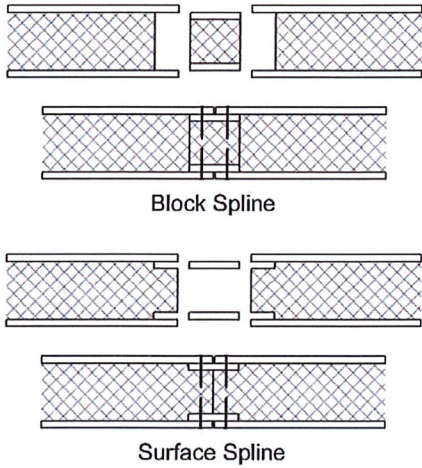


Figure 1: SIP Spline Types



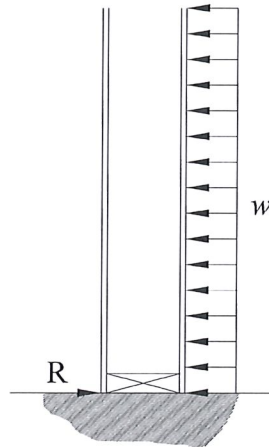


Figure 2: Zero Bearing Support

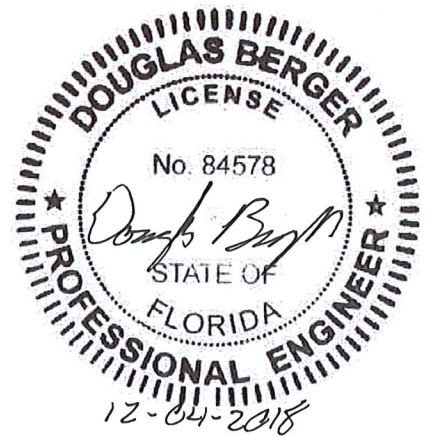


This Engineering Evaluation Report is intended to indicate that the Evaluator has evaluated the product(s) herein based on the information available at the time of report issuance. The Evaluator reserves the right to modify, amend or withdrawal this report at any time based on information that becomes available subsequent to the issuance of this report. The Evaluator makes no warranty, either expressed or implied, regarding the product covered by this report.

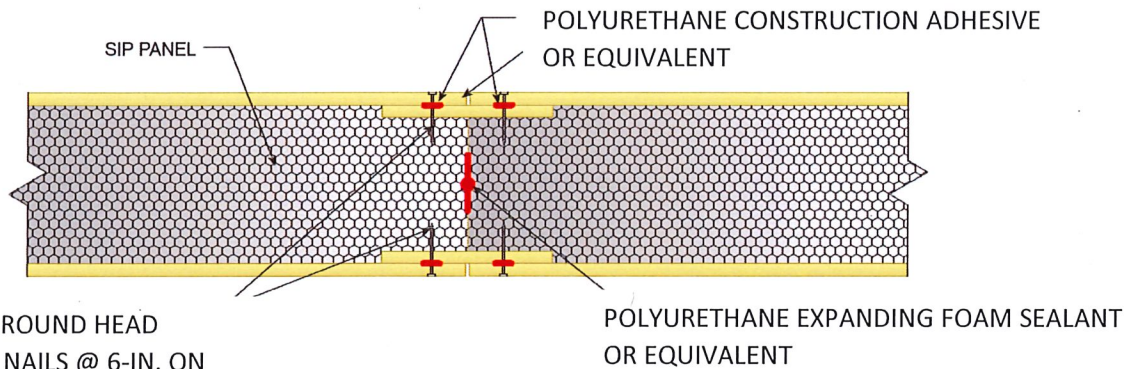

0.131 x 2-1/2-in. ROUND HEAD
SMOOTH SHANK NAILS @ 6-IN. ON
CENTER EACH STRIP AND EACH SIDE.
3/4-IN. EDGE DISTANCE.

Figure 3: Sealing Joints between SIPs

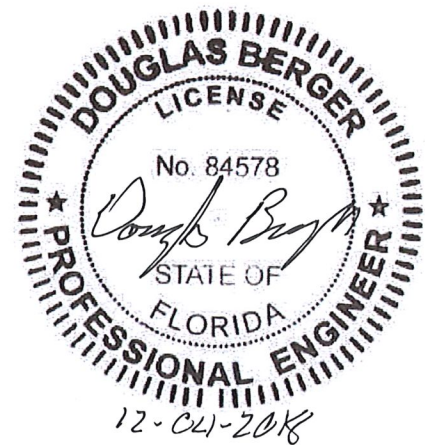

This Engineering Evaluation Report is intended to indicate that the Evaluator has evaluated the product(s) herein based on the information available at the time of report issuance. The Evaluator reserves the right to modify, amend or withdrawal this report at any time based on information that becomes available subsequent to the issuance of this report. The Evaluator makes no warranty, either expressed or implied, regarding the product covered by this report.

Table 3: Allowable Uniform Transverse Loads (psf)^{1,4}

| Panel Length (ft) | 4-5/8-in. SIP thickness | | | 6-1/2-in. SIP thickness | | |
|--------------------|-------------------------------|-------|-------|-------------------------------|-------|-------|
| | Deflection Limit ² | | | Deflection Limit ² | | |
| | L/180 | L/240 | L/360 | L/180 | L/240 | L/360 |
| 8 WAB ³ | 50.8 | 40.9 | 27.3 | 73.8 | 64.7 | 43.1 |
| 8 | 68.8 | 51.6 | 34.4 | 80.6 | 80.6 | 56.6 |
| 10 | 45.1 | 33.8 | 22.5 | 62.0 | 57.9 | 38.6 |
| 12 | 30.8 | 23.1 | 15.4 | 50.4 | 40.9 | 27.3 |
| 14 | 21.7 | 16.3 | -- | 39.6 | 29.7 | 19.8 |
| 16 | -- | -- | -- | 29.4 | 22.1 | 14.7 |
| 18 | -- | -- | -- | 22.4 | 16.8 | -- |

See Table 4 for notes.

Table 4: Allowable Uniform Transverse Loads (psf)^{1,4}


| Panel Length (ft) | 8-1/4-in. SIP thickness | | | 10-1/4-in. SIP thickness | | | 12-1/4-in. SIP thickness | | |
|--------------------|-------------------------------|-------|-------|-------------------------------|-------|-------|-------------------------------|-------|-------|
| | Deflection Limit ² | | | Deflection Limit ² | | | Deflection Limit ² | | |
| | L/180 | L/240 | L/360 | L/180 | L/240 | L/360 | L/180 | L/240 | L/360 |
| 8 WAB ³ | 81.4 | 81.4 | 58.3 | 89.9 | 89.9 | 75.9 | 98.6 | 98.6 | 93.6 |
| 8 | 88.5 | 88.5 | 78.4 | 97.3 | 97.3 | 97.3 | 106.4 | 106.4 | 106.4 |
| 10 | 67.4 | 67.4 | 54.8 | 73.1 | 73.1 | 73.1 | 78.8 | 78.8 | 78.8 |
| 12 | 54.4 | 54.4 | 39.6 | 58.6 | 58.6 | 54.6 | 62.5 | 62.5 | 62.5 |
| 14 | 45.6 | 43.9 | 29.3 | 48.8 | 48.8 | 41.1 | 51.9 | 51.9 | 51.9 |
| 16 | 39.3 | 33.2 | 22.1 | 41.9 | 41.9 | 31.5 | 44.3 | 44.3 | 41.7 |
| 18 | 34.1 | 25.6 | 17.1 | 36.7 | 36.7 | 24.6 | 38.7 | 38.7 | 32.9 |
| 20 | 26.7 | 20.0 | 13.4 | 32.6 | 29.2 | 19.5 | 34.3 | 34.3 | 26.3 |

¹ Table values assume a simply supported panel with 1-1/2-in. of continuous bearing on facing at supports ($C_v = 1.0$) with solid wood plates at bearing locations. Values do not include the dead weight of the panel. For wall panel capacities (4-5/8-in., 6-1/2-in. and 8-1/4-in. thickness panels only) utilizing a zero bearing configuration (Figure 2), the allowable load shall be determined using $C_v = 0.4$.

² Deflection limit shall be selected by building designer based on the serviceability requirements of the structure and the requirements of adopted building code. Values are based on loads of short duration only and do not consider the effects of creep.

³ Tabulated values are based on the strong-axis of the facing material oriented parallel to the direction of panel bending. WAB indicates weak-axis bending of the facing material; the strong-axis of the facing material is oriented perpendicular to the direction of panel bending.

⁴ Permanent loads, such as dead load, shall not exceed 0.50 times the tabulated load.

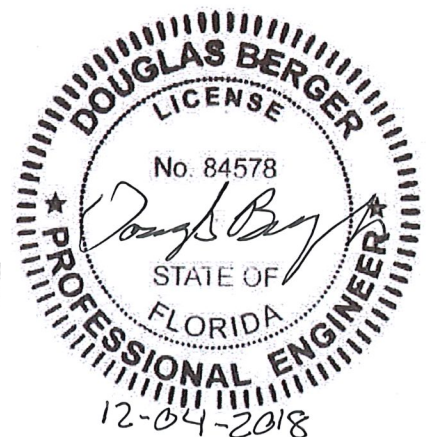

This Engineering Evaluation Report is intended to indicate that the Evaluator has evaluated the product(s) herein based on the information available at the time of report issuance. The Evaluator reserves the right to modify, amend or withdrawal this report at any time based on information that becomes available subsequent to the issuance of this report. The Evaluator makes no warranty, either expressed or implied, regarding the product covered by this report.

Table 5: Allowable Axial Loads (plf) ^{1,2,3,4}

| Lateral Brace Spacing (ft) | Panel Thickness | | |
|-------------------------------|-----------------|-----------|-----------|
| | 4-5/8-in. | 6-1/2-in. | 8-1/4-in. |
| 8 WAB ⁵ | 2320 | 2470 | 2530 |
| 8 | 3630 | 4070 | 4240 |
| 10 | 3260 | 3890 | 4130 |
| 12 | 2810 | 3660 | 4000 |
| 14 | -- | 3390 | 3830 |
| 16 | -- | 3090 | 3640 |
| 18 | -- | 2790 | 3430 |
| 20 | -- | -- | 3190 |


¹ Permanent loads, such as dead load, shall not exceed 0.50 times the tabulated load.

² All values are for normal duration and may not be increased for other durations.

³ Axial loads shall be applied concentrically to the top of the panel through repetitive members spaced not more than 24-in. on center. Such members shall be fastened to a rim board or similar member to distribute along the top of the SIP.

⁴ The ends of both facings must bear on the supporting foundation or structure to achieve the tabulated axial loads.

⁵ Tabulated values are based on the strong-axis of the facing material oriented parallel to the direction of panel bending. WAB indicates weak-axis bending of the facing material; the strong-axis of the facing material is oriented perpendicular to the direction of panel bending.

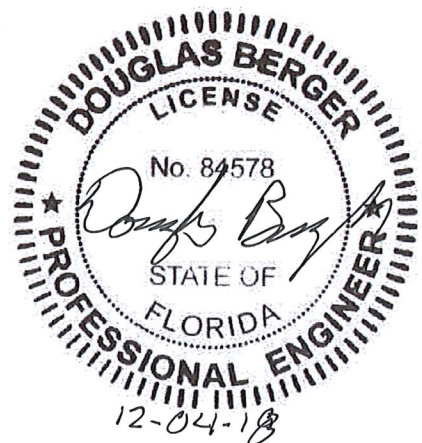

This Engineering Evaluation Report is intended to indicate that the Evaluator has evaluated the product(s) herein based on the information available at the time of report issuance. The Evaluator reserves the right to modify, amend or withdrawal this report at any time based on information that becomes available subsequent to the issuance of this report. The Evaluator makes no warranty, either expressed or implied, regarding the product covered by this report.

Table 6: Allowable Uniform Transverse Loads for SIPs with Openings, 36-in. maximum span (psf)^{1,4,5,6}

| Panel Length (ft) | 4-5/8-in. SIP thickness | | | 6-1/2-in. SIP thickness | | | 8-1/4-in. SIP thickness | | |
|--------------------|-------------------------------|-------|-------|-------------------------------|-------|-------|-------------------------------|-------|-------|
| | Deflection Limit ² | | | Deflection Limit ² | | | Deflection Limit ² | | |
| | L/180 | L/240 | L/360 | L/180 | L/240 | L/360 | L/180 | L/240 | L/360 |
| 8 WAB ³ | 23.1 | 17.3 | 11.5 | 42.6 | 31.9 | 21.3 | 62.0 | 47.7 | 31.8 |
| 8 | 31.0 | 23.2 | 15.5 | 57.4 | 43.3 | 28.9 | 75.1 | 65.3 | 43.5 |
| 10 | 17.6 | 13.2 | 8.8 | 33.9 | 25.4 | 16.9 | 48.1 | 39.3 | 26.2 |
| 12 | 10.8 | 8.1 | 5.4 | 21.3 | 16.0 | 10.7 | 33.4 | 25.1 | 16.7 |
| 14 | 7.1 | 5.3 | -- | 14.1 | 10.6 | 7.1 | 22.5 | 16.9 | 11.3 |
| 16 | -- | -- | -- | 9.8 | 7.4 | -- | 15.8 | 11.8 | 7.9 |
| 18 | -- | -- | -- | 7.1 | 5.3 | -- | 11.4 | 8.6 | 5.7 |
| 20 | -- | -- | -- | -- | -- | -- | 8.5 | 6.4 | -- |

See Table 7 for notes.

Table 7: Allowable Uniform Transverse Loads for SIPs with Openings, 72-in. maximum span (psf)^{1,4,5,6}

| Panel Length (ft) | 4-5/8-in. SIP thickness | | | 6-1/2-in. SIP thickness | | | 8-1/4-in. SIP thickness | | |
|--------------------|-------------------------------|-------|-------|-------------------------------|-------|-------|-------------------------------|-------|-------|
| | Deflection Limit ² | | | Deflection Limit ² | | | Deflection Limit ² | | |
| | L/180 | L/240 | L/360 | L/180 | L/240 | L/360 | L/180 | L/240 | L/360 |
| 8 WAB ³ | 16.6 | 12.5 | 8.3 | 29.9 | 23.8 | 15.8 | 39.2 | 36.4 | 24.3 |
| 8 | 23.3 | 17.5 | 11.6 | 37.5 | 33.5 | 22.3 | 49.1 | 49.1 | 34.4 |
| 10 | 12.9 | 9.7 | 6.4 | 24.0 | 19.0 | 12.7 | 31.4 | 29.9 | 19.9 |
| 12 | 7.8 | 5.8 | -- | 15.6 | 11.7 | 7.8 | 21.8 | 18.7 | 12.4 |
| 14 | 5.0 | -- | -- | 10.2 | 7.7 | 5.1 | 16.0 | 12.3 | 8.2 |
| 16 | -- | -- | -- | 7.0 | 5.3 | -- | 11.4 | 8.5 | 5.7 |
| 18 | -- | -- | -- | 5.0 | -- | -- | 8.2 | 6.1 | -- |
| 20 | -- | -- | -- | -- | -- | -- | 6.1 | -- | -- |

¹ Table values assume a simply supported panel with 1-1/2-in. of continuous bearing on facing at supports ($C_v = 1.0$) with solid wood plates at bearing locations. Values do not include the dead weight of the panel. For wall panel capacities utilizing a zero bearing configuration (Figure 2), the allowable load shall be determined using $C_v = 0.4$.


² Deflection limit shall be selected by building designer based on the serviceability requirements of the structure and the requirements of adopted building code. Values are based on loads of short duration only and do not consider the effects of creep.

³ Tabulated values are based on the strong-axis of the facing material oriented parallel to the direction of panel bending. WAB indicates weak-axis bending of the facing material; the strong-axis of the facing material is oriented perpendicular to the direction of panel bending.

⁴ Permanent loads, such as dead load, shall not exceed 0.50 times the tabulated load.

⁵ Tabulated values assume header depths ranging from 12-in. to 36-in.

⁶ Joints between SIPs are not permitted within 6-in. of the end of the header and are not permitted within the header.

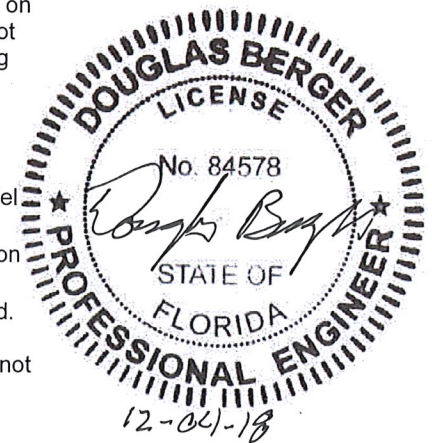

This Engineering Evaluation Report is intended to indicate that the Evaluator has evaluated the product(s) herein based on the information available at the time of report issuance. The Evaluator reserves the right to modify, amend or withdrawal this report at any time based on information that becomes available subsequent to the issuance of this report. The Evaluator makes no warranty, either expressed or implied, regarding the product covered by this report.

Table 8: Allowable Axial Loads for SIPs with Openings, 36-in. maximum span (plf) ^{1,2,3,4,6,7}

| Lateral Brace Spacing (ft) | Panel Thickness | | |
|----------------------------|-----------------|-----------|-----------|
| | 4-5/8-in. | 6-1/2-in. | 8-1/4-in. |
| 8 WAB ⁵ | 770 | 820 | 840 |
| 8 | 1210 | 1355 | 1410 |
| 10 | 1085 | 1295 | 1375 |
| 12 | 935 | 1220 | 1330 |
| 14 | -- | 1130 | 1275 |
| 16 | -- | 1030 | 1210 |
| 18 | -- | 930 | 1140 |
| 20 | -- | -- | 1060 |

See Table 9 for notes.

Table 9: Allowable Axial Loads for SIPs with Openings, 72-in. maximum span (plf) ^{1,2,3,4,6,7}

| Lateral Brace Spacing (ft) | Panel Thickness | | |
|----------------------------|-----------------|-----------|-----------|
| | 4-5/8-in. | 6-1/2-in. | 8-1/4-in. |
| 8 WAB ⁵ | 460 | 490 | 505 |
| 8 | 725 | 810 | 845 |
| 10 | 650 | 775 | 825 |
| 12 | 560 | 730 | 800 |
| 14 | -- | 675 | 765 |
| 16 | -- | 615 | 725 |
| 18 | -- | 555 | 685 |
| 20 | -- | -- | 635 |

¹ Permanent loads, such as dead load, shall not exceed 0.50 times the tabulated load.

² All values are for normal duration and may not be increased for other durations.


³ Axial loads shall be applied concentrically to the top of the panel through repetitive members spaced not more than 24-in. on center. Such members shall be fastened to a rim board or similar member to distribute along the top of the SIP.

⁴ The ends of both facings must bear on the supporting foundation or structure to achieve the tabulated axial loads.

⁵ Tabulated values are based on the strong-axis of the facing material oriented parallel to the direction of panel bending. WAB indicates weak-axis bending of the facing material; the strong-axis of the facing material is oriented perpendicular to the direction of panel bending.

⁶ Tabulated values assume header depths ranging from 12-in. to 36-in.

⁷ Joints between SIPs are not permitted within 6-in. of the end of the header and are not permitted within the header

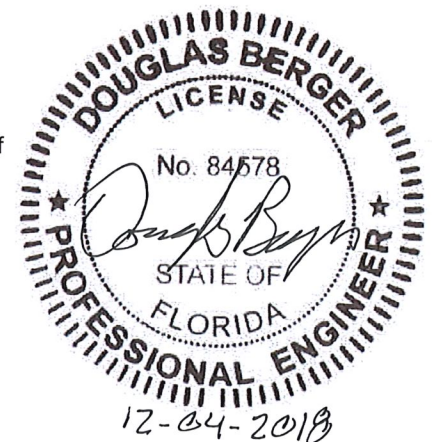

This Engineering Evaluation Report is intended to indicate that the Evaluator has evaluated the product(s) herein based on the information available at the time of report issuance. The Evaluator reserves the right to modify, amend or withdrawal this report at any time based on information that becomes available subsequent to the issuance of this report. The Evaluator makes no warranty, either expressed or implied, regarding the product covered by this report.

Table 10: Allowable In-Plane Shear Strength (Pounds per Foot) for SIP Shear Walls (Wind and Seismic Loads in Seismic Design Categories A, B and C) ^{1, 2}


| Spline Type ³ | Minimum Nominal SIP Thickness (in.) | Minimum Facing Connections ^{3,5} | | | Shear Strength (plf) |
|--------------------------|-------------------------------------|---|---|---|----------------------|
| | | Chord ² | Plate ² | Spline ³ | |
| Block or Surface Spline | 4-5/8 | 0.131-in. x 2-1/2-in. nails, 6-in. on center | 0.131-in. x 2-1/2-in. nails, 6-in. on center | 0.131-in. x 2-1/2-in. nails, 6-in. on center | 380 |
| | 6-1/2 | 0.131-in. x 2-1/2-in. nails, 3-in. on center, 3/8-in. edge distance | 0.131-in. x 2-1/2-in. nails, 3-in. on center, 3/8-in. edge distance | 0.131-in. x 2-1/2-in. nails, 3-in. on center (23/32-in. thick, 3-in. wide spline) | 900 |
| | 8-1/4 | 0.131-in. x 2-1/2-in. nails, 6-in. on center | 0.131-in. x 2-1/2-in. nails, 6-in. on center | 0.131-in. x 2-1/2-in. nails, 6-in. on center | 400 |

¹ Maximum shear wall dimensions ratio shall not exceed 2:1 (height: width) for resisting wind or seismic loads.

² Chords, hold downs and connections to other structural elements must be designed by a registered design professional in accordance with accepted engineering practice.

³ Spline type at interior panel-to-panel joints only. Solid chord members are required at each end of each shear wall segment.

⁴ Required connections must be made on each side of the panel. Dimensional or engineered lumber shall have an equivalent specific gravity of 0.42 or greater.

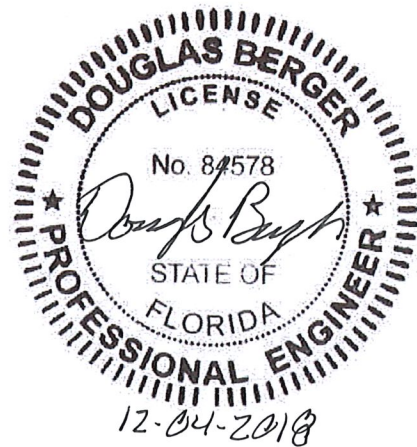

This Engineering Evaluation Report is intended to indicate that the Evaluator has evaluated the product(s) herein based on the information available at the time of report issuance. The Evaluator reserves the right to modify, amend or withdrawal this report at any time based on information that becomes available subsequent to the issuance of this report. The Evaluator makes no warranty, either expressed or implied, regarding the product covered by this report.