

AL-FAROOQ CORPORATION

CONSULTING ENGINEERS & PRODUCT DEVELOPMENT

PRODUCT APPROVAL EVALUATION RULE CHAPTER #61G20-3 • METHOD 1 OPTION D

FL 29512

Date: 02/26/2021

Detailed Product Description:

Manufacturer: VIWINCO, INC.

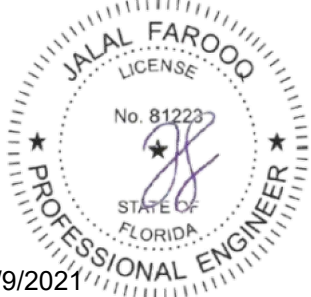
Manufacturer Address: PO BOX 499, MORGANTOWN, PA 19543

Model Name: SIGNATURE SERIES VINYL DOUBLE HUNG WINDOW

Maximum Load: **+71 PSF, -100 PSF** (Non-Impact)

Installation Drawings # 19-13F

This product <u>does not</u> comply with the High Velocity Hurricane Zone (HVHZ) testing requirements.				
For maximum sizes, combination of span vs loads and anchor type refer to installation drawings.				
Comparative analysis used <u> X </u> Yes <u> </u> No				
Mandatory Tests (Tested in accordance with AAMA/WDMA/CSA 101/I.S.2/A440/NAFS)				
Test	Description	Test Location	Test Report Date	Test Report #
ASTM E283	Air Infiltration Leakage	Architectural Testing	1/10/2008	76646.01-109-47
			8/27/2013	D0902.01-109-47
			8/3/2007	75150.01-109-47
			8/9/2011	B1835.01-109-47
			12/17/2007	75561.01-109-47
			12/20/2007	75561.02-109-47
			7/19/2011	B1833.01-109-47
			8/27/2013	D0907.01-109-47
			12/13/2007	75148.03-109-47
			11/2/2007	75148.01-109-47
			12/7/2011	B4046.01-109-47
			12/5/2007	75147.01-109-47
ASTM E331 & ASTM E547	Water Penetration	Architectural Testing	11/14/2007	75148.02-109-47
			1/10/2008	76646.01-109-47
			8/27/2013	D0902.01-109-47
			8/3/2007	75150.01-109-47
			8/9/2011	B1835.01-109-47
			12/17/2007	75561.01-109-47
			12/20/2007	75561.02-109-47
			7/19/2011	B1833.01-109-47
			8/27/2013	D0907.01-109-47
			12/13/2007	75148.03-109-47
			11/2/2007	75148.01-109-47
			12/7/2011	B4046.01-109-47
			12/5/2007	75147.01-109-47
			11/14/2007	75148.02-109-47
			11/13/2007	75595.01-109-47

ASTM E330	Uniform Static Air Press.	Architectural Testing	1/10/2008	76646.01-109-47			
			8/27/2013	D0902.01-109-47			
			8/3/2007	75150.01-109-47			
			8/9/2011	B1835.01-109-47			
			12/17/2007	75561.01-109-47			
			12/20/2007	75561.02-109-47			
			7/19/2011	B1833.01-109-47			
			8/27/2013	D0907.01-109-47			
			12/13/2007	75148.03-109-47			
			11/2/2007	75148.01-109-47			
			12/7/2011	B4046.01-109-47			
			12/5/2007	75147.01-109-47			
			11/14/2007	75148.02-109-47			
			11/13/2007	75595.01-109-47			
ASTM F588	Forced Entry	Architectural Testing	1/10/2008	76646.01-109-47			
			8/27/2013	D0902.01-109-47			
			8/3/2007	75150.01-109-47			
			8/9/2011	B1835.01-109-47			
			12/17/2007	75561.01-109-47			
			12/20/2007	75561.02-109-47			
			7/19/2011	B1833.01-109-47			
			8/27/2013	D0907.01-109-47			
			12/13/2007	75148.03-109-47			
			11/2/2007	75148.01-109-47			
			12/7/2011	B4046.01-109-47			
			12/5/2007	75147.01-109-47			
			Under the limitations of the attached installation drawings, to the best of my knowledge and ability, the above product conforms to the requirements of the 2020 Florida Building Code.				
			Evaluation Report Engineer:				
Jalal Farooq Al-Farooq Corporation							
PE # 81223 EB # 3538		Sealed: 3/9/2021					