

26ga 36" PBU panel over 15/32" plywood

Product: PBU is an exposed fastener panel with nominal rib height of 0.75"

and 36" coverage. (7) ribs across panel width nominally at 6" o.c.

Material: This product is manufactured from 26ga or thicker steel with yield

strength of at least 50ksi, and corrosion resistance per FBC

1507.4.3.

Fastener: #10 x 1.5" fastener with sealing washer, compliant with FBC

1506.6. Sidelap secured with butyl and 1/4" x 7/8" fastener @ 12"

O.C.

Substrate/Deck: Minimum 15/32" thick plywood.

Underlayment: Comply with FBC 1507.1.1 where applicable.

Slope: Comply with FBC 1507.4.2 where applicable.

Max. Allowable Loads & Method A: 71 psf | #10 x 1.5" fastener in 6"-6" pattern @ 24" o.c. Installation Requirements: Method B: 131 psf | #10 x 1.5" fastener in 3"-3" pattern @ 24" o.c.

Factor of Safety of 2.0 applied to calculate allowable loads.

Manufacturer: Quicken Steel, LLC | 188 Georgia Pacific Dr, Claxton GA 30417 |

912-549-4050 | www.QuickenSteel.com

Compliance statement: This product as described has demonstrated compliance with

Florida Building Code 2023, Section 1504.3.2, as required by Rule

61G20-3, method 1D

Technical Documentation: This product has been tested to the UL 580 standard by PRI

(TST-5878), report 267T0007.

Evaluated By: David Eng, PE


Timberlake Cove, LLC

1317 Edgewater Dr Ste 2339

Orlando FL 32804 PE Lic. No: 81377 CA Lic. No: 33344

www.TimberLakeCove.com

This item has been digitally signed and sealed by D.E. Eng, PE, on the date indicated. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies





Certification of Independence: David Eng, PE and Timberlake Cove, LLC do not have, nor will acquire a financial interest in any company manufacturing or distributing products under this evaluation. The same entities do not have, nor will acquire, a financial interest in any other entity involved in the approval process of the product.

Exclusions & Limitations: Design of deck and roof structure (to include deck attachment) shall be completed by others. Fire classification and shear diaphragm design are outside the scope of this evaluation.

This report is limited to compliance with structural wind load requirements of FBC 1504.3.2, as required by Rule 61G20-3. Neither Timberlake Cove nor the manufacturer shall be responsible for any conclusions, interpretations, or designs made by others based on this evaluation report. This report is limited solely to documenting compliance with Rule 61G20-3, and makes no express or implied warranty regarding performance of this product.

Design Process: The load tables in this report provides one prescriptive option for the fastening requirement for the applicable wind loads for roofs within the parameters described. For roofs outside of the listed parameters, design wind loads shall be determined as required by FBC 1609, ASCE 7, or other design code in force, using allowable stress. These load tables are based on ASCE 7-22. Use of these tables assumes that the structure is:

- Enclosed and conforms to wind-borne debris provisions and is a regular shaped building
- Is not subject to across-wind loading, vortex shedding, or instability; nor does it have a site location for which channeling or buffeting warrant consideration


Engineering analysis may be completed by other licensed engineers for project specific approval by local authorities having jurisdiction.

Load Tables: These load tables are provided as a courtesy to provide one possible prescriptive option for a generic, typical structure without calculating the design pressures.

For structures outside the parameters of these load tables (e.g. height above 30 feet), calculate the required allowable design pressure and compare to the maximum allowable loads shown on page 2. These load tables shall not be construed to in any way limit the installation of this product to the cases shown.

Contact the manufacturer for further information, or consult a licensed design professional.



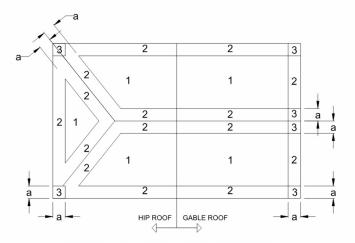

METHOD A: 24" O.C. METHOD B: 24" O.C.

ROOF ZONES FOR GENERIC BUILDING

Use this load table for structures which meet the following criteria: Are located in **Exposure B** area

Have either a flat roof, or gable/hip roof with max slope of 12:12 Have a mean Roof Height of 30 feet or less

FL30339.08: 26ga PBU on 15/32" plywood

Wind	105	110	120	130	140	150	160	170	180	190	200
Zone 1:	Α	Α	Α	Α	Α	Α	Α	Α	Α	В	В
Zone 2:	Α	Α	Α	Α	Α	Α	Α	В	В	В	В
Zone 3:	Α	Α	Α	Α	Α	В	В	В	В	В	NR

Use this load table for structures which meet the following criteria: Are located in Exposure B area

Have either a flat roof less than 1.5:12, hip roof with

Have a mean Roof Height of 30 feet or less

FL30339.08: 26ga PBU on 15/32" plywood

			00.00	· = • ;	<u> </u>			<u> </u>	o.,	000		
Wind	10)5	110	120	130	140	150	160	170	180	190	200
Zone 1:	A	4	Α	Α	Α	Α	Α	Α	Α	Α	Α	В
Zone 2:	A	4	Α	Α	Α	Α	Α	Α	Α	В	В	В
Zone 3:	A	4	Α	Α	Α	Α	Α	В	В	В	В	В

Use this load table for structures which meet the following criteria: Are located in B, C, or D exposure area

Have either a flat roof, or gable/hip roof with max slope of 12:12 Have a mean Roof Height of 30 feet or less

FL30339.08: 26ga PBU on 15/32" plywood

Wind	105	110	120	130	140	150	160	170	180	190	200
Zone 1:	Α	Α	Α	Α	Α	В	В	В	В	В	NR
Zone 2:	Α	Α	Α	В	В	В	В	В	NR	NR	NR
Zone 3:	Α	Α	В	В	В	В	NR	NR	NR	NR	NR

Use this load table for structures which meet the following criteria:

Are located in B, C, or D exposure area

Have either a flat roof less than 1.5:12, hip roof with

max slope of 12:12, or gable roof with slope between 4.4:12 and 12:12 max slope of 12:12, or gable roof with slope between 4.4:12 and 12:12 Have a mean Roof Height of 30 feet or less

FL30339.08: 26ga PBU on 15/32" plywood

				9				P . J .			
Wind	105	110	120	130	140	150	160	170	180	190	200
Zone 1:	Α	Α	Α	Α	Α	Α	В	В	В	В	В
Zone 2:	Α	Α	Α	Α	В	В	В	В	NR	NR	NR
Zone 3:	Α	Α	В	В	В	В	NR	NR	NR	NR	NR