

# WOLTERS ENGINEERING

ENGINEERING, DRAFTING, CONSULTING

15211 97<sup>th</sup> Road N  
West Palm Beach, FL 33412  
Ph/Fx: (561) 225-1982

## PRODUCT EVALUATION

PRODUCT: MASTER SERIES 1 1/2" STANDING SEAM 24 Ga STEEL ROOF PANEL  
16" WIDE, OVER 1/2" (NOMINAL) OR GREATER PLYWOOD  
(FLPA# 32387.1)

MANUFACTURER: METAL MASTER SHOP  
7484 NW 8<sup>TH</sup> STREET  
MIAMI, FL 33126

To all concerned,

The Master Series 1 1/2" Standing Seam 24 Gauge Steel Roof Panel, manufactured by Metal Master Shop, is a 16" wide, non-structural Fluoropon coated 24 ga. steel roof panel (50 ksi min), with 1 1/2" ribs that are mechanically seamed to 90° or 180°. This panel system meets the requirements of Sections 1507.4 and 1518.9 of the 7<sup>th</sup> Edition (2020) Florida Building Code. It has been tested per TAS 100, TAS 125, and ASTM E2140 by Intertek B&C, with results shown in test reports L0234.01-450-18, L0234.04-450-18, L0234.15-450-18, L0234.17-450-18, and N0714.02-450-18. It has also been tested per ASTM B117 and G155 by PRI Construction Materials Technologies, with results shown in test reports 1272T0002 and 1272T0005.

### Technical Documentation:

1. Drawing "M15SHVHZ" dated 2/14/22, signed and sealed by Scott Wolters, PE.
2. Test Reports listed above by Intertek B&C. signed and sealed by Vinu Abraham, PE
3. Test Reports listed above by PRI Construction Materials Technologies, signed and sealed by Zachary Priest, PE.
4. Supplemental Calculations to support "M15SHVHZ", signed and sealed by Scott Wolters, PE.

I have reviewed this submittal per the requirements of FAC Product Approval Rule Chapter 61G20-3.005 (4). Based on the limitations listed below and those provided in the documents above, this product meets all of the requirements of the 7<sup>th</sup> Edition (2020) Florida Building Code generally, and chapter 15 specifically, including the HVHZ provisions.

Limitations: This Roof System is approved for use inside and outside of the HVHZ.

<u>Overall Limitations:</u>	Maximum Panel Width:	16"
	Minimum Rib Height:	1 1/2"
	Minimum Slope:	1"/12" (HVHZ) 1/4"/12" (Outside of HVHZ)
	Clip Anchors:	24 Ga galvanized steel (see chart below for size and spacing)

---

SPECIALIZING IN IMPACT RESISTANT CURTAINWALLS, STOREFRONTS, & WINDOWS

Field Installation - over 1/2" (Min) Plywood

Maximum Design Pressure: 97.25 psf.  
Clip Anchor Length: 2" long  
Clip Anchor Spacing: 4" from ends, 24" max. O.C.  
Clip Anchor Fasteners: #10x1" Pancake Head fast's, (2) per clip  
**Panels are seamed to 90°.**

Perimeter/Corner Option #1 - over 1/2" (Min) Plywood

Maximum Design Pressure: 101 psf  
Clip Anchor Length: 3" long  
Clip Anchor Spacing: 4" from ends, 6" max. O.C.  
Clip Anchor Fasteners: #10x1" Pancake Head fast's, (2) per clip  
**Panels are seamed to 90°.**

Perimeter/Corner Option #2 - over 1/2" (Min) Plywood

Maximum Design Pressure: 123.5 psf  
Clip Anchor Length: 2" long  
Clip Anchor Spacing: 4" from ends, 6" max. O.C.  
Clip Anchor Fasteners: #10x1" Pancake Head fast's, (2) per clip  
**Panels are seamed to 180°.**

Perimeter/Corner Option #3 - over 1/2" (Min) Plywood

Maximum Design Pressure: 138.5 psf  
Clip Anchor Length: Continuous Clip  
Clip Anchor Fasteners: #10x1-1/2" Pancake Head fast's  
Clip Anchor Spacing: 4" from ends, 6" max. O.C.  
**Panels are seamed to 90°.**

Perimeter/Corner Option #4 - over 5/8" (Min) Plywood

Maximum Design Pressure: 161.0 psf  
Clip Anchor Length: Continuous Clip  
Clip Anchor Fasteners: #10x1-1/2" Pancake Head fast's  
Clip Anchor Spacing: 4" from ends, 6" max O.C.  
**Panels are seamed to 90°**

Underlayment:

Any underlayment meeting the requirements of FBC Sections 1518.2 thru 1518.4 (HVHZ) or Section 1507.1.1 (Outside HVHZ).  
(or)

Any underlayment with a valid Florida Product Approval or Miami-Dade NOA

Fire Barrier:  
(Where req'd by code) 1 layer of VersaShield with 4" overlaps, anchored with .120"x1 1/4" galvanized roof nails with 32 Ga. Tin caps spaced 6" O.C. in rows at the perimeter, at overlaps, and two intermediate rows per sheet.  
(or)  
Any fire barrier with a valid FLPA or Miami-Dade NOA

Minimum Substrate: 1/2" (15/32" min) 4-ply CDX Plywood (19/32" min required for Perimeter/ Corner Option #4), nailed to 2x rafters spaced 24" max. O.C. with 8d ring-shank nails spaced 4" O.C.  
(or)  
3/4" minimum solid wood plank (S.G.=0.42 min)

Note: The 3/4" wood planking must be installed as a solid deck and must be nailed or fastened in a manner equal to the deck above, or as specified by a Florida licensed Architect/Engineer.

Other Limitations:

1. Fire classification is not a part of this evaluation. Refer to a current Approved Roofing Materials Directory for fire ratings of this product.
2. Shear diaphragm values are not a part of this evaluation.
3. Design of substrate is by others and is not a part of this evaluation.
4. All panels shall be permanently labeled with the manufacturer's name and/or logo, and "Metal Master Shop FLPA# 32387.1, 1 1/2" x 16" Standing Seam Roof System".

Panel Forming: These panels may be jobsite roll formed with the following Metal Master Shop machines, per approval of 3rd party QA provider, to the dimensions shown in Drawing M15SHVHZ:

#100801

#109212207

Re-Roofing: The Master Series 1 1/2" Standing Seam 24 ga. Steel Roof Panel System may be installed over a single layer of existing shingles, provided the existing roof meets the requirements of FBC Section 1521 (HVHZ) or 1511 (outside of HVHZ).


If you have any questions or need more information concerning this approval, please contact me.

Thank you,



Scott Wolters  
FL PE# 62354

FEB 14 2022

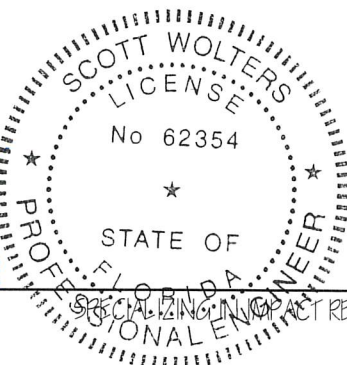

SPECIALIZING IN IMPACT RESISTANT CURTAIN WALLS, STOREFRONTS, & WINDOWS