



Farabaugh Engineering and Testing Inc.

Project No. T146-19

Report Date: March 14, 2019

Total Pages: 26 pages (inclusive)

ASTM E 1592
STANDARD TEST METHOD FOR
STRUCTURAL PERFORMANCE OF SHEET METAL ROOF AND SIDING SYSTEMS
BY UNIFORM STATIC AIR PRESSURE DIFFERENCE


ON

T-PANEL - METAL ROOF PANEL
16" WIDE X 22 GA. STEEL
WITH CONTINUOUS CLIPS AND INTERMITTENT CLIPS
(5 SPANS @ 5'-0" O.C. & 12 SPANS @ 2'-0" O.C.)


FOR



PETERSEN ALUMINUM CORP.
10551 PAC ROAD
TYLER, TX. 75707

Report Prepared By:

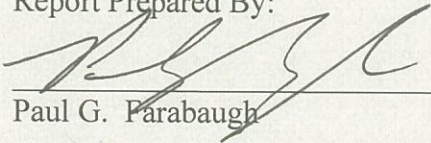
Paul G. Farabaugh

Reviewed and Approved By:

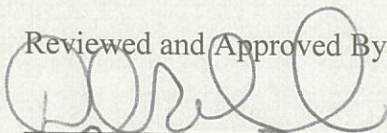
Daniel G. Farabaugh

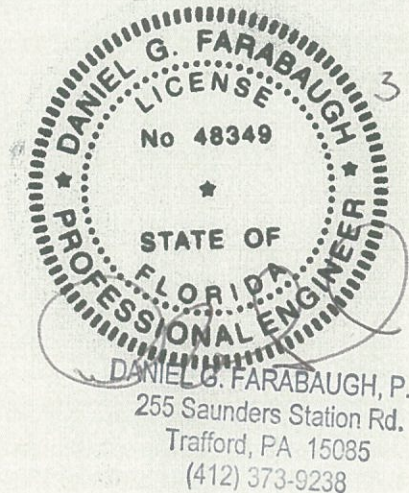

Project No. T146-19

ASTM E1592-05
STANDARD TEST METHOD FOR
STRUCTURAL PERFORMANCE OF SHEET METAL ROOF AND SIDING SYSTEMS
BY UNIFORM STATIC AIR PRESSURE DIFFERENCE

Purpose

This test method covers the evaluation of the structural performance of Sheet Metal Panels and Anchor to Panel Attachments for roof or siding systems under uniform static air pressure difference.

Test Date

2/27/19 Test #1 - 5 Spans @ 5'-0" o.c. with intermittent clips
3/4/19 Test #2 - 5 Spans @ 5'-0" o.c. with continuous clips
3/1/19 Test #3 - 12 Spans @ 2'-0" o.c. with intermittent clips
3/7/19 Test #4 - 12 Spans @ 2'-0" o.c. with continuous clips

Test Specimen

Manufacturer: Petersen Aluminum
10551 PAC Rd.
Tyler, TX. 75707

Panel: T-PANEL - Metal Roof Panel, 16" wide x 22 ga. steel with 22 ga. steel cap

Intermittent Clip: 6" wide x 16 ga. galvanized steel clip

Continuous Clip: 120" wide x 16 ga. galvanized steel clip

Testing Apparatus

A test chamber was used with two static pressure taps located at diagonally opposite corners. A controlled blower provided a uniformly load the specimen mock-up. Calibrated manometers were used to measure the pressure at each pressure tap. The uniform load pressure was performed in the negative direction to monitor wind uplift on the panel specimen mock-up. Calibrated deflectometers were attached to monitor panel deformation as shown.

Installation

- The panels were installed on to 16 ga supports with using (2) #14-13 X 1-1/2" long, DP1, Concealor, self-drill fasteners per intermittent/continuous clips at supports. Test #1 & Test #3 used intermittent clips and Test #2 & #4 used continuous clips. Additional screw was used at each end of a continuous clip. The panel sidejoints used a 22 ga. seam cap and were seamed with a mechanical seamer. The seam cap used 2 beads of factory sealant, one bead on each side of cap corners. The panel ends were fastened with (5) 1/4-14 x 1-1/2 long, self-drill, hex head fasteners with washer. The outer side panels were fastened with (2)1/4-14 x 1-1/2" long self- drill, hex head fasteners with washer at each support along each side of the mock-up.
- Plastic (4 mil thick) was employed loosely between the panels and subgirts and in the side joints to create a vacuum seal.

Procedure

- The specimen was checked for proper adjustment and all vents closed in the pressure measuring lines.
- The required deflection measuring apparatus were installed at their specified locations.
- A nominal initial pressure was applied equal to at least four times but not more than ten times the dead weight of the specimen. This nominal pressure was used as the reference zero and initial deflection readings were recorded.
- At each load increment, pressure was maintained for a period of not less than 60 seconds and until the deflection gages indicated no further increase in deflections.
- Successive increments were achieved as above until failure or ultimate load was reached.

The test was conducted according to the procedure in ASTM E-1592-05 and as noted herein. In our opinion the tape and plastic had no influence on the results of the test.

Project No. T146-19

TEST #1

Specimen: T-PANEL - Metal Roof Panel, 16" wide x 22 ga. steel with intermittent Clip

Clip Spacing: 5 ft o/c

NEGATIVE (UPLIFT) PRESSURE



PETERSEN ALUM. T-PANEL 16" WIDE X 22 GA. STEEL (5 SPANS @ 5' O.C.) INTERMITTENT CLIP



DEFLECTION DIAL READINGS (INCHES)						
LOAD (PSF)	D-1	D-2	D-3	D-4	D-5	D-6
0.0	0.000	0.000	0.000	0.000	0.000	0.000
10.4	0.052	0.341	0.050	0.349	0.034	0.351
0.0	0.006	0.010	0.007	0.014	0.004	0.010
20.8	0.106	0.819	0.103	0.894	0.075	0.873
0.0	0.017	0.030	0.018	0.031	0.010	0.024
31.2	0.163	1.556	0.161	1.811	0.127	1.771
0.0	0.024	0.044	0.030	0.048	0.021	0.037
41.6	0.211	2.152	0.206	2.494	0.166	2.446
0.0	0.033	0.062	0.044	0.019	0.036	0.051
52.0	0.263	2.571	0.256	2.930	0.206	2.877
0.0	0.050	0.089	0.067	0.098	0.056	0.085
62.4	0.327	2.961	0.327	3.341	0.254	3.284
0.0	0.075	0.118	0.097	0.131	0.075	0.113
78.1	0.426	3.556	0.405	3.998	0.329	3.945
0.0	0.143	0.202	0.162	0.209	0.114	0.179
93.7	0.562	4.237	0.554	4.727	0.427	4.692
0.0	0.228	0.274	0.234	0.339	0.175	0.385



RESULTS:

Load held for 1 minute = 93.7 psf

Maximum Test Load = 104.5 psf (Panel disengaged from clip – Clip straightened out)

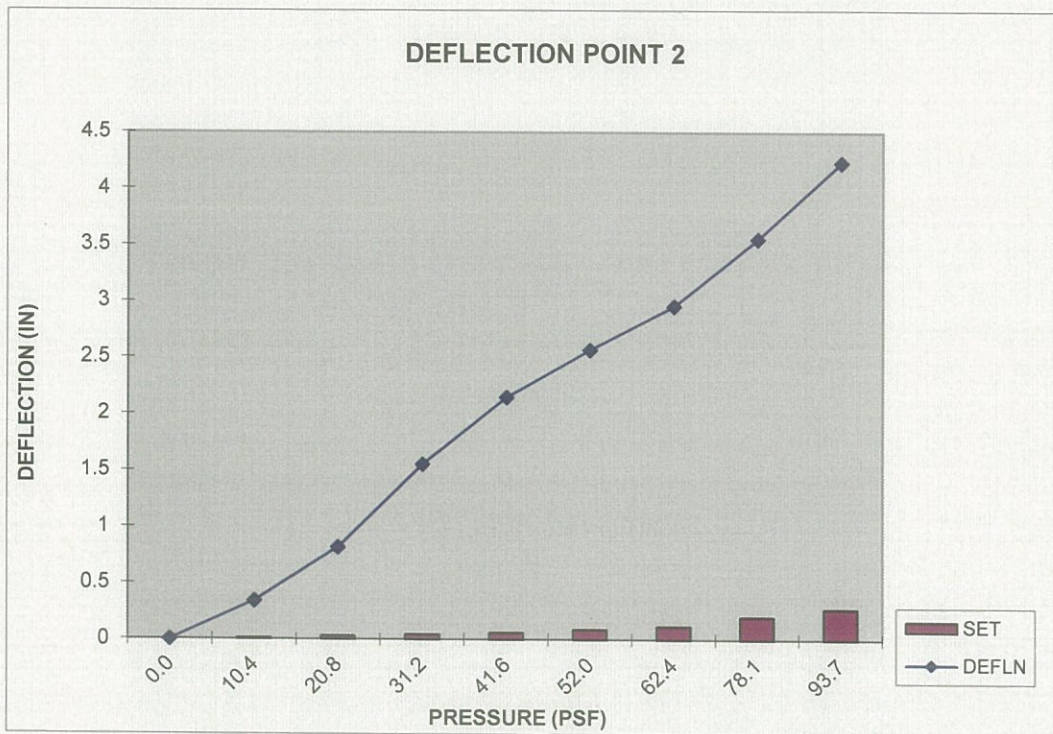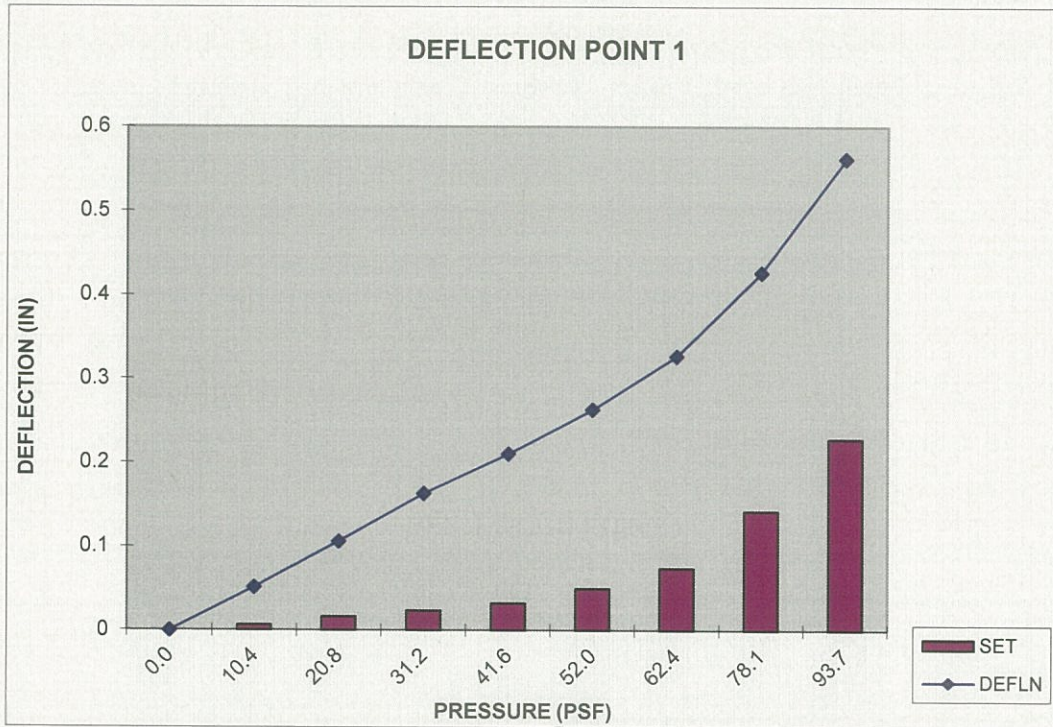

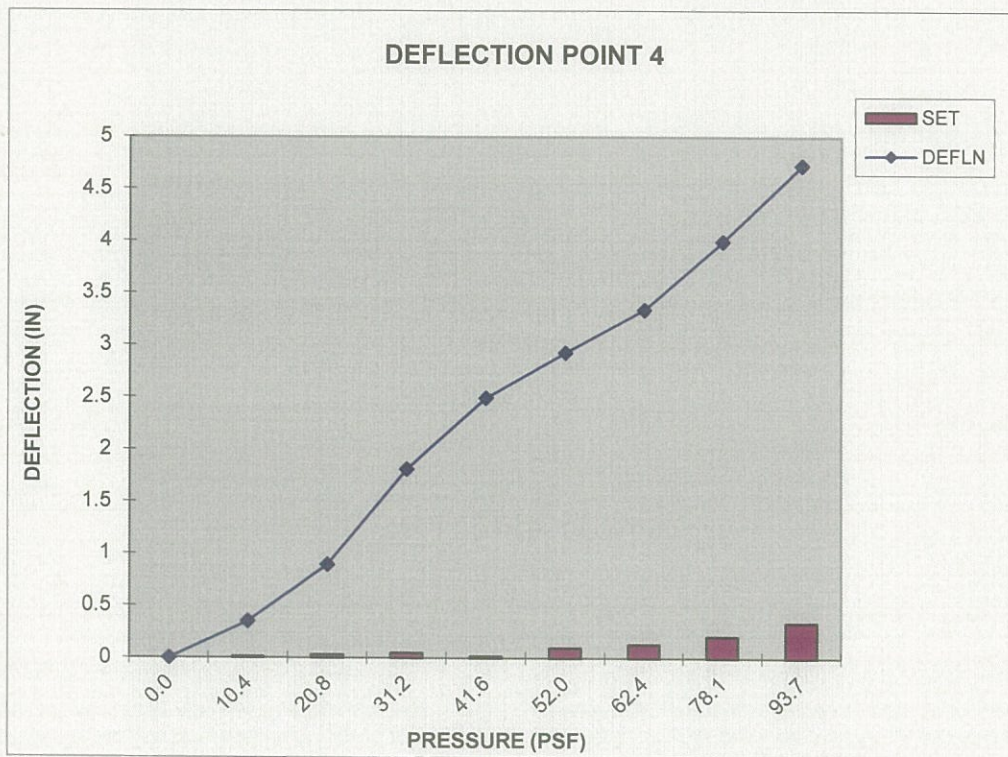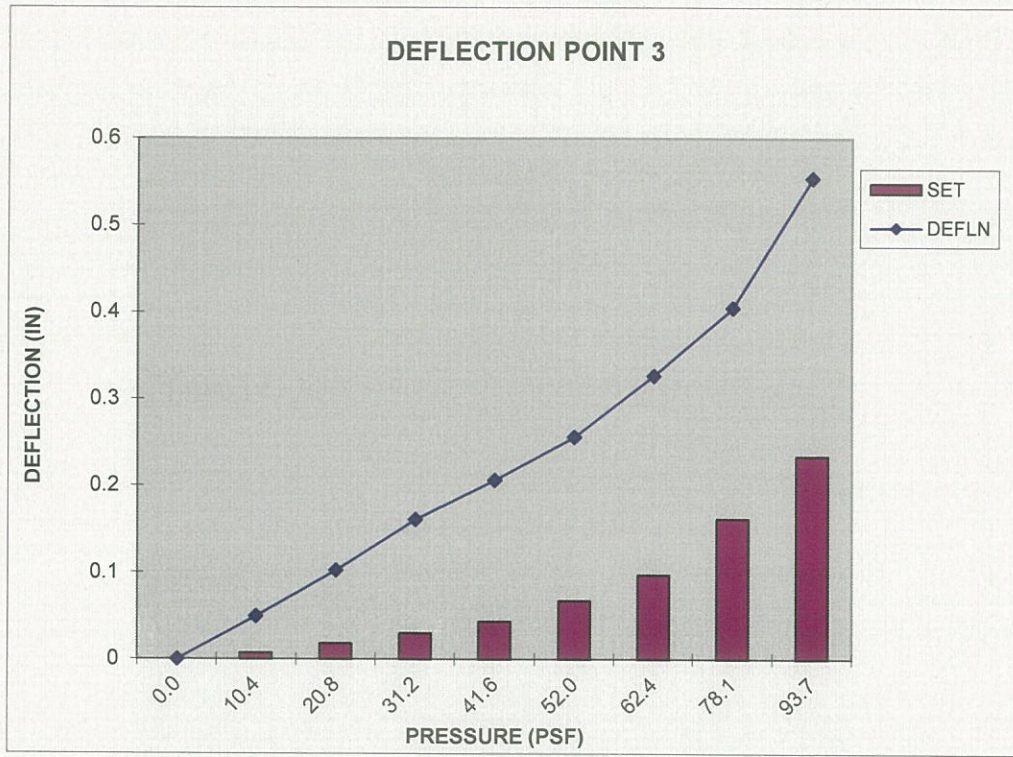

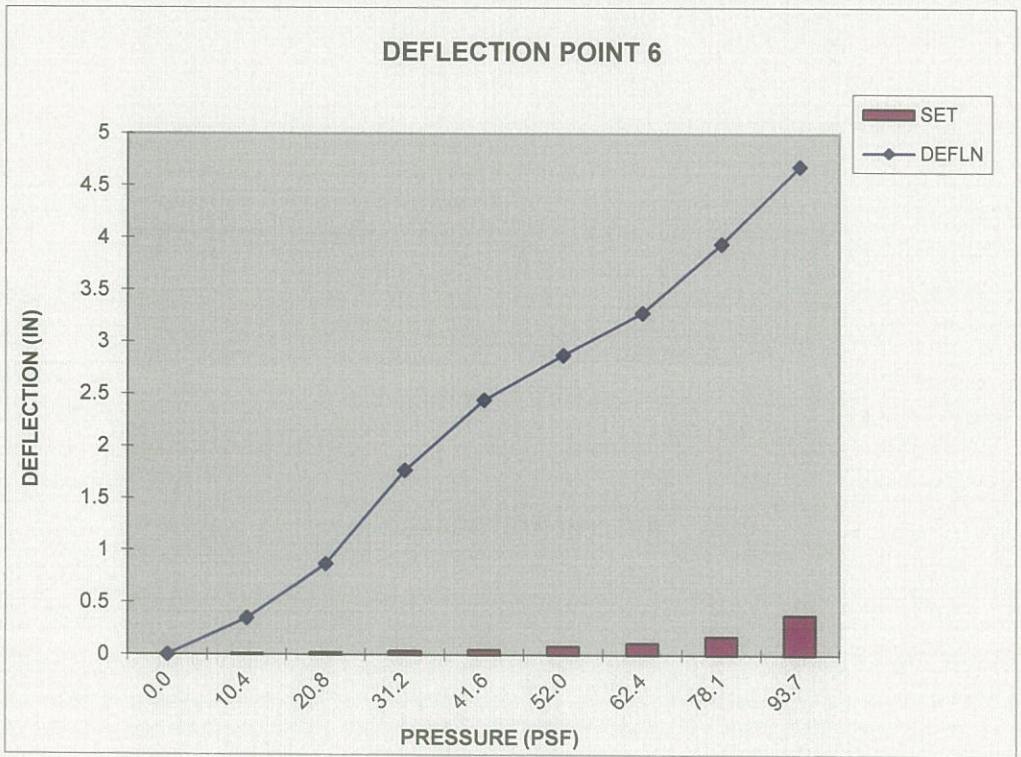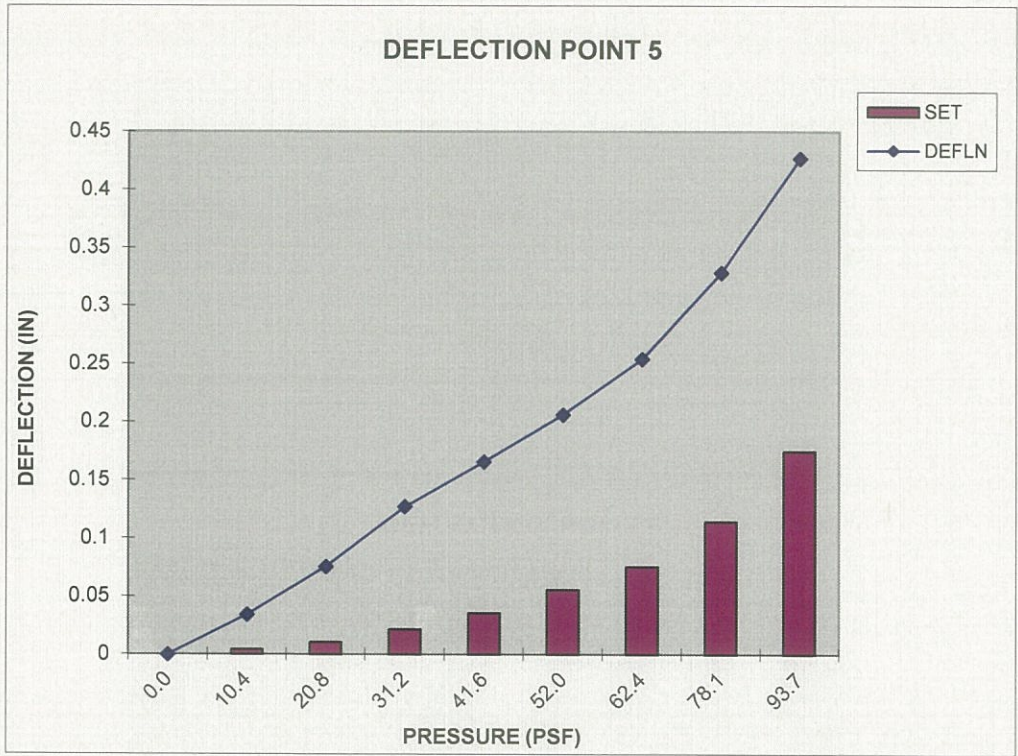

Project No. T146-19

TEST #2

Specimen: T-PANEL - Metal Roof Panel, 16" wide x 22 ga. steel with continuous Clip

Clip Spacing: 5 ft o/c

NEGATIVE (UPLIFT) PRESSURE



PETERSEN ALUM. T-PANEL 16" WIDE X 22 GA. STEEL (5 SPANS @ 5' O.C.) CONT. CLIP



LOAD (PSF)	DEFLECTION DIAL READINGS (INCHES)					
	D-1	D-2	D-3	D-4	D-5	D-6
0.0	0.000	0.000	0.000	0.000	0.000	0.000
15.6	0.022	0.576	0.021	0.533	0.021	0.546
0.0	0.005	0.015	0.004	0.008	0.005	0.013
31.2	0.059	1.303	0.051	1.231	0.058	1.268
0.0	0.013	0.034	0.010	0.022	0.013	0.036
46.8	0.095	1.875	0.084	1.789	0.097	1.843
0.0	0.022	0.047	0.019	0.037	0.025	0.055
62.4	0.137	2.271	0.123	2.187	0.145	2.246
0.0	0.032	0.064	0.030	0.061	0.039	0.089
78.1	0.180	2.583	0.166	2.504	0.198	2.567
0.0	0.044	0.081	0.042	0.098	0.054	0.117
93.7	0.231	2.862	0.213	2.788	0.256	2.866
0.0	0.056	0.103	0.060	0.137	0.075	0.145
109.3	0.285	3.166	0.269	3.105	0.329	3.190
0.0	0.143	0.815	0.123	0.145	0.179	0.797
124.9	0.326	3.366	0.312	3.325	0.392	3.400
0.0	0.132	0.417	0.091	0.162	0.199	0.602
140.5	0.358	3.579	0.353	3.562	0.443	3.638
0.0	0.155	0.322	0.160	0.540	0.229	0.498



RESULTS:

Load held for 1 minute = 182 psf

Maximum Test Load = 185.6 psf (clip fastener pulled thru clip)

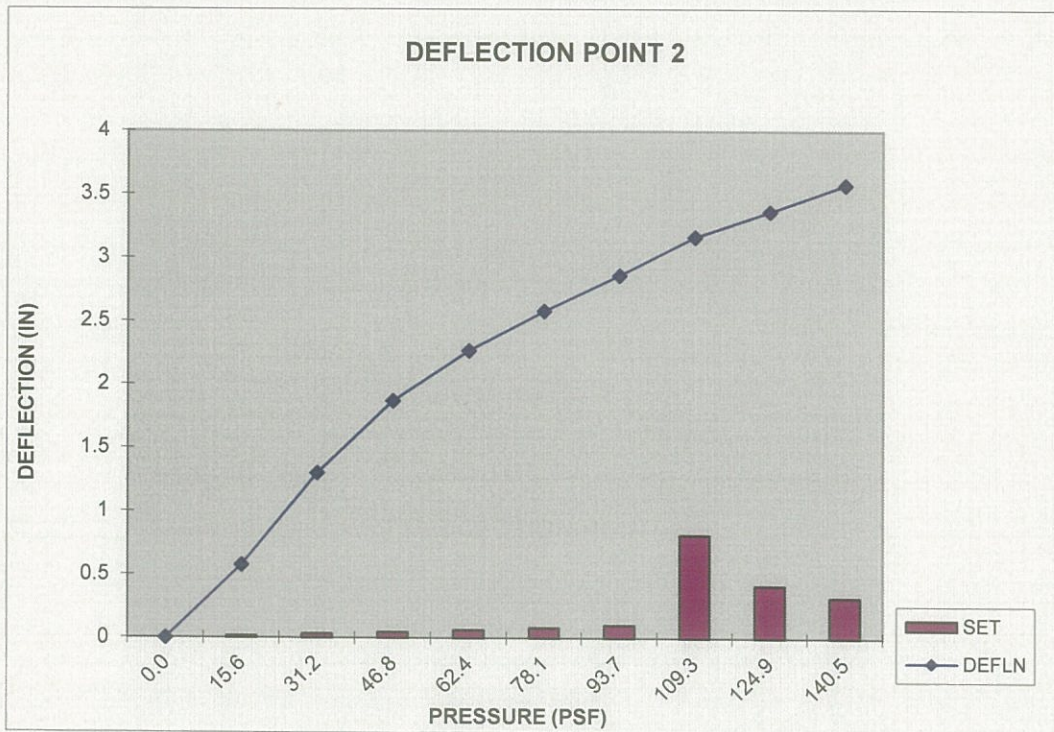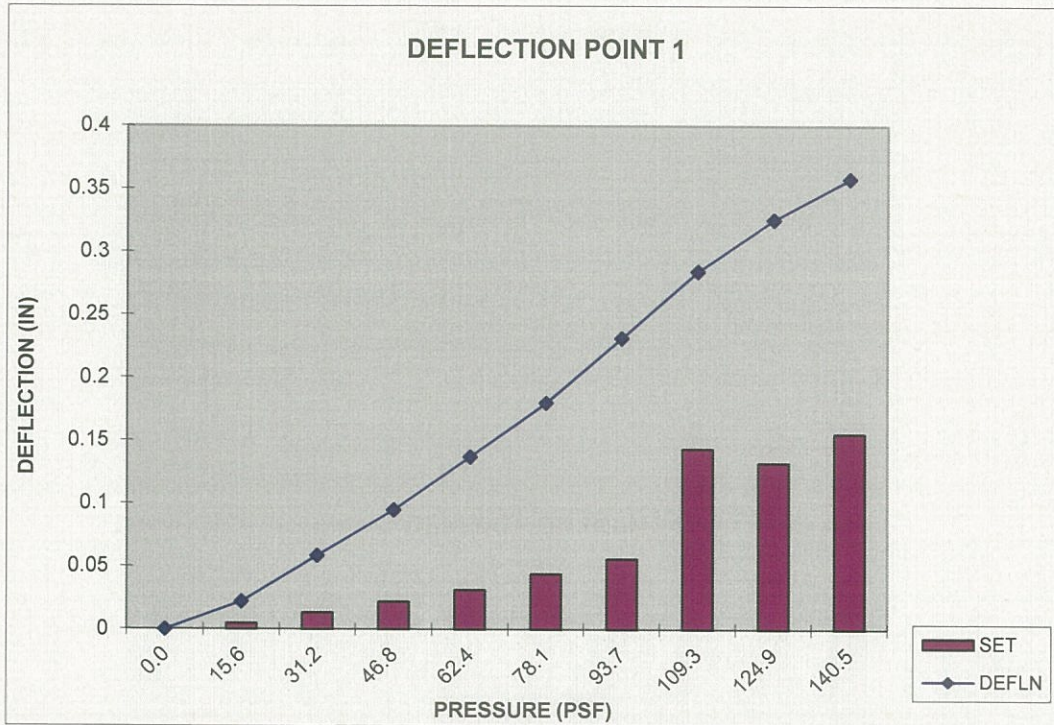

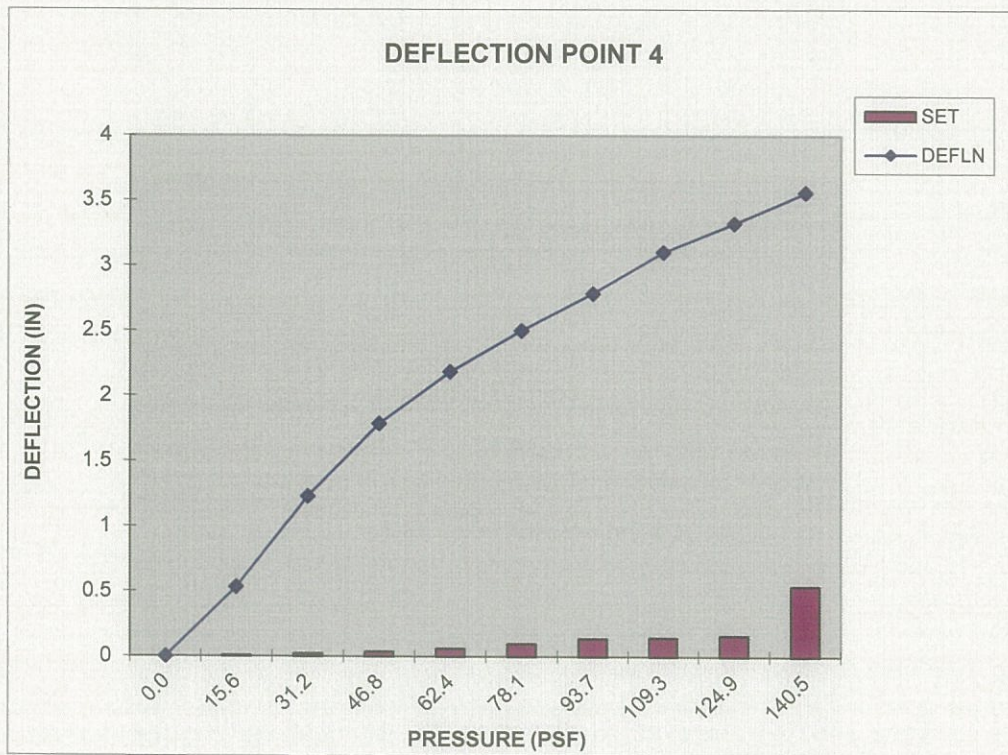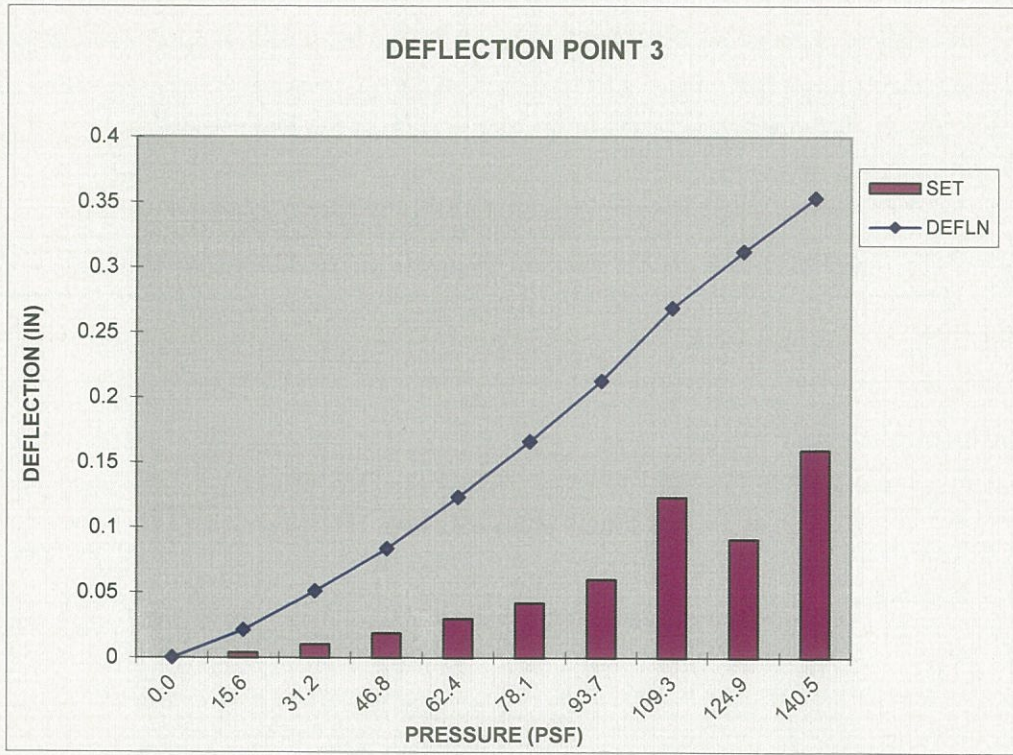

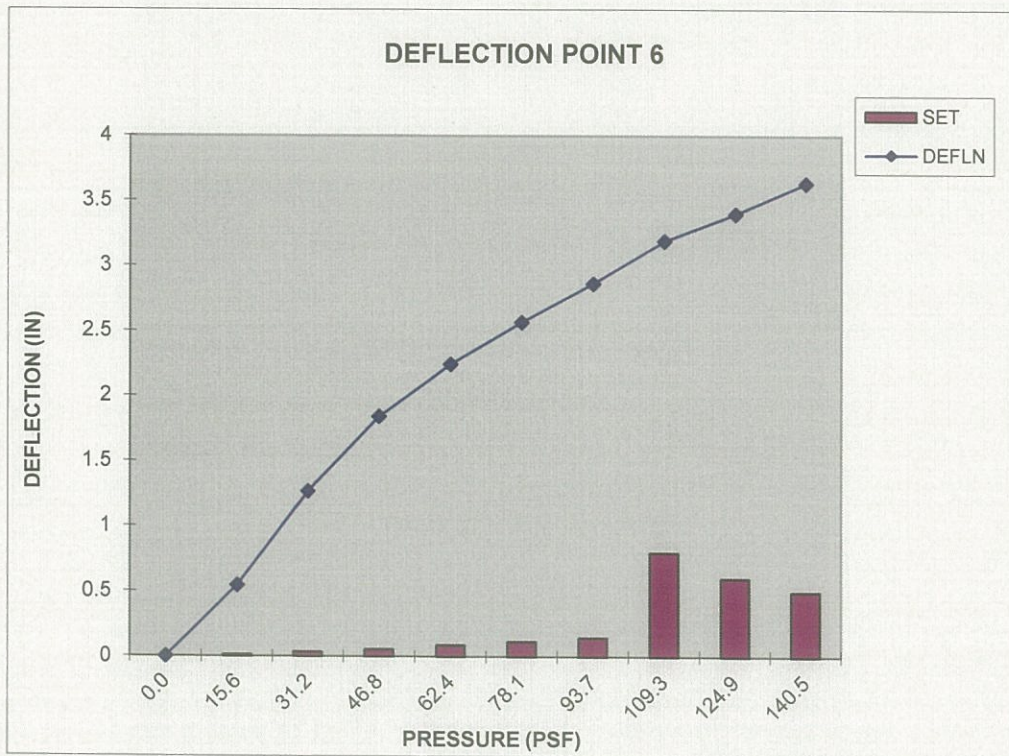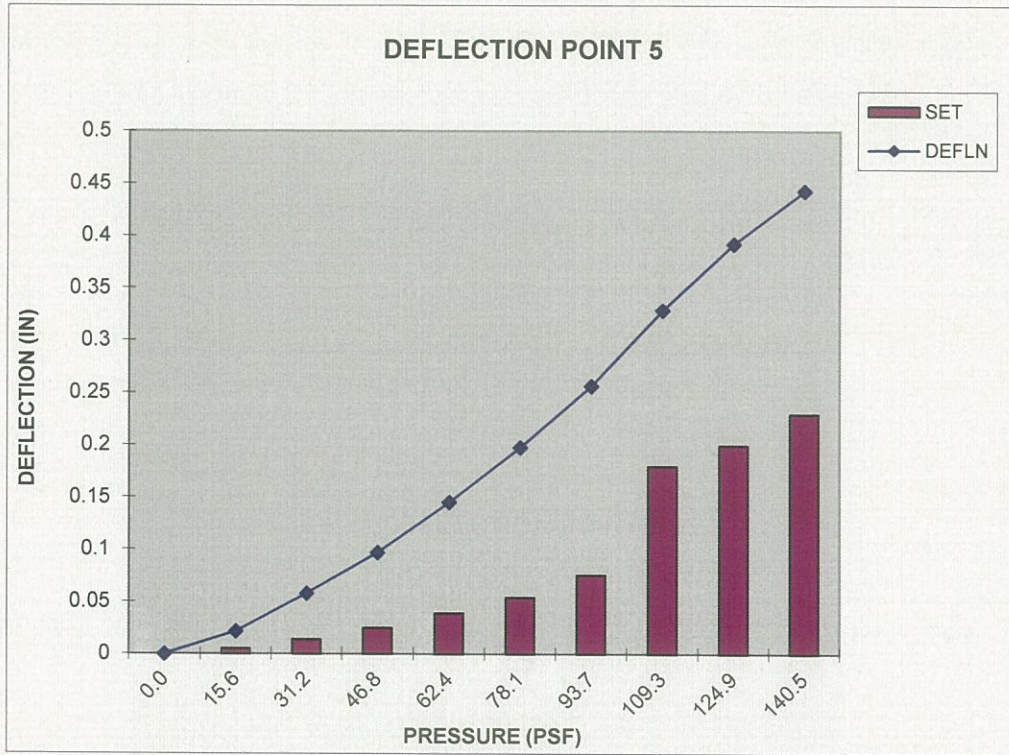

Project No. T146-19

TEST #3

Specimen: T-PANEL - Metal Roof Panel, 16" wide x 22 ga. steel with intermittent Clip

Clip Spacing: 2 ft o/c

NEGATIVE (UPLIFT) PRESSURE



PETERSEN ALUM. T-PANEL 16" WIDE X 22 GA. STEEL (12 SPANS @ 2' O.C.) INTERMITTENT CLIP



LOAD (PSF)	DEFLECTION DIAL READINGS (INCHES)					
	D-1	D-2	D-3	D-4	D-5	D-6
0.0	0.000	0.000	0.000	0.000	0.000	0.000
15.6	0.032	0.521	0.025	0.600	0.034	0.527
0.0	0.010	0.025	0.006	0.031	0.008	0.021
31.2	0.069	1.579	0.062	1.625	0.064	1.636
0.0	0.016	0.049	0.010	0.066	0.014	0.041
46.8	0.099	2.488	0.095	2.490	0.094	2.585
0.0	0.025	0.063	0.018	0.075	0.017	0.050
62.4	0.105	2.957	0.126	2.935	0.119	3.080
0.0	0.005	0.067	0.025	0.071	0.021	0.051
78.1	0.153	3.396	0.174	3.393	0.160	3.555
0.0	0.020	0.087	0.036	0.094	0.029	0.070
93.7	0.206	3.782	0.220	3.824	0.210	3.998
0.0	0.047	0.130	0.056	0.178	0.048	0.112
109.3	0.263	4.117	0.273	4.171	0.278	4.404
0.0	0.067	0.129	0.077	0.161	0.063	0.103
124.9	0.332	4.412	0.323	4.554	0.364	4.800
0.0	0.115	0.206	0.127	0.470	0.098	0.226



RESULTS:

Load held for 1 minute = 145.6 psf

Maximum Test Load = 149.7 psf (Panel disengaged from clip – Clip straightened out)

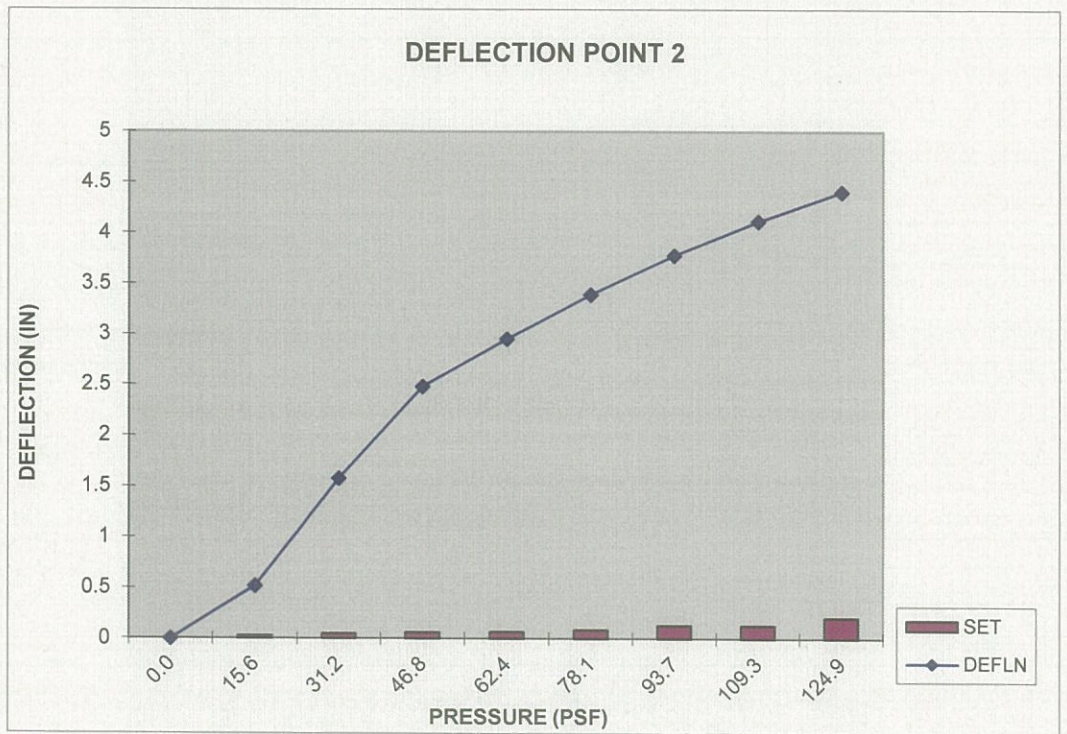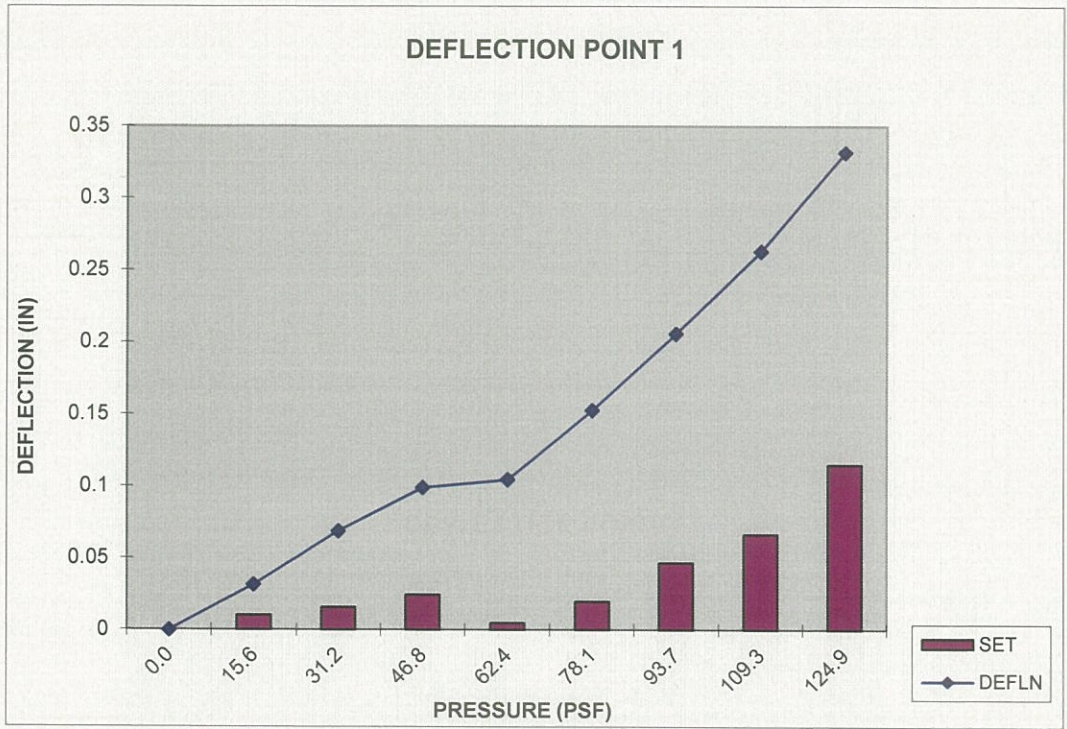

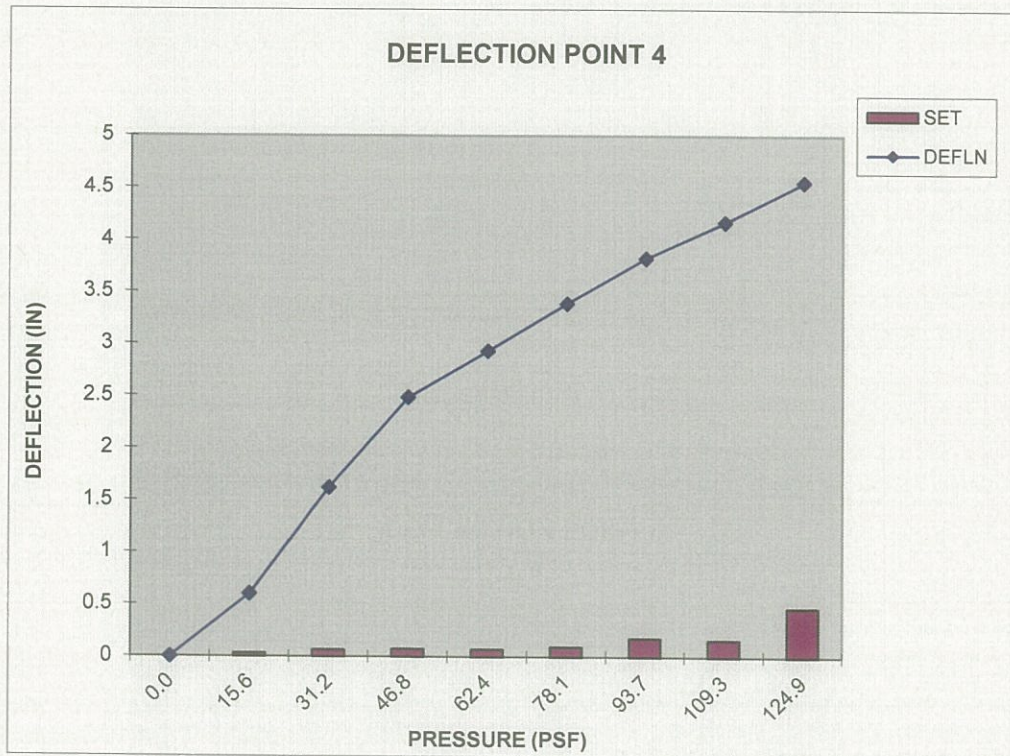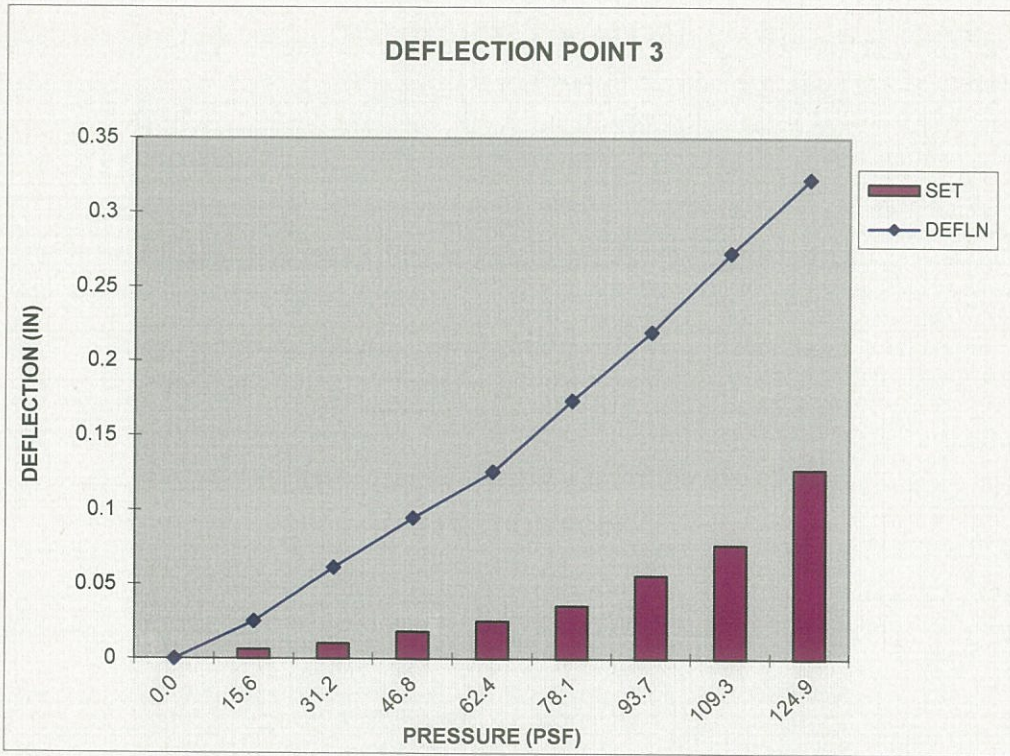

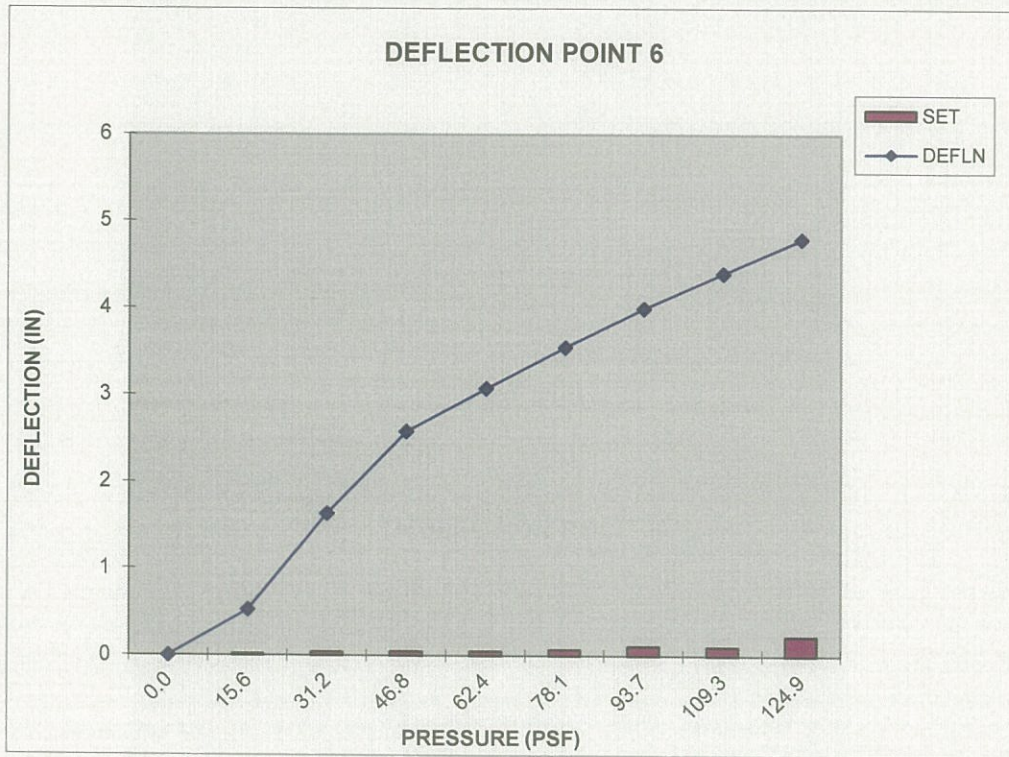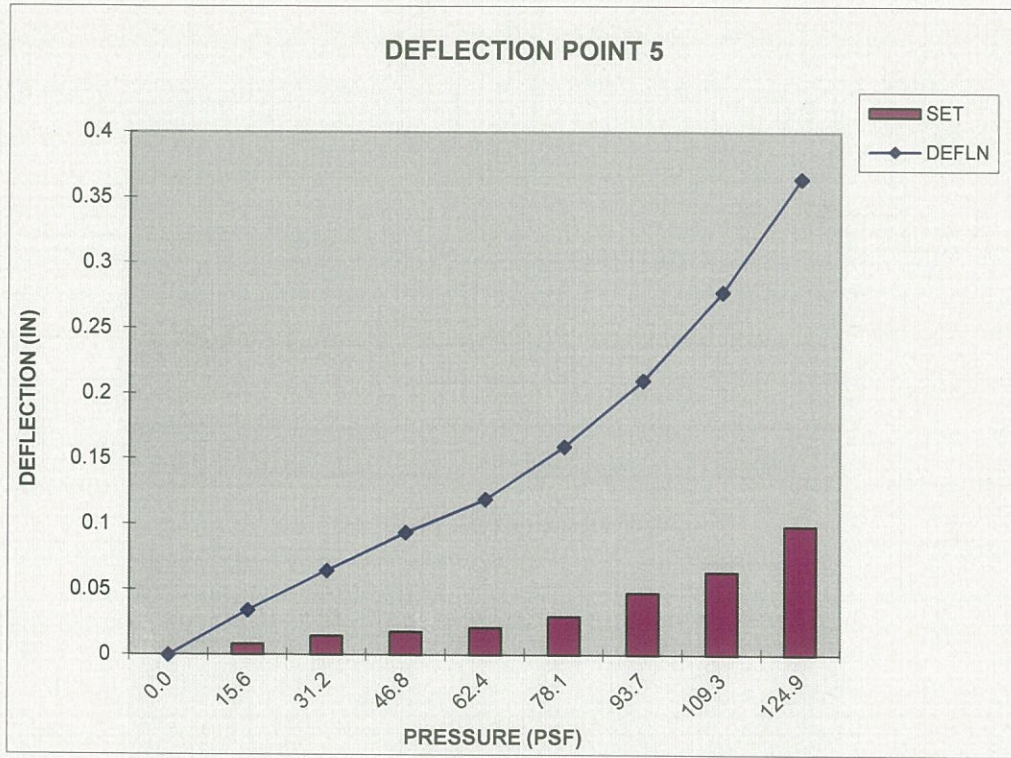

Project No. T146-19

TEST #4

Specimen: T-PANEL - Metal Roof Panel, 16" wide x 22 ga. steel with continuous Clip

Clip Spacing: 2 ft o/c

NEGATIVE (UPLIFT) PRESSURE



PETERSEN ALUM. T-PANEL 16" WIDE X 22 GA. STEEL (12 SPANS @ 2' O.C.) CONT. CLIP



DEFLECTION DIAL READINGS (INCHES)						
LOAD (PSF)	D-1	D-2	D-3	D-4	D-5	D-6
0.0	0.000	0.000	0.000	0.000	0.000	0.000
15.6	0.002	0.475	0.011	0.496	0.005	0.487
0.0	0.002	0.013	0.003	0.013	0.001	0.013
31.2	0.010	1.128	0.028	1.181	0.015	1.136
0.0	0.006	0.018	0.006	0.019	0.005	0.017
46.8	0.016	1.730	0.045	1.769	0.025	1.728
0.0	0.010	0.029	0.012	0.026	0.009	0.024
62.4	0.025	2.149	0.066	2.153	0.038	2.145
0.0	0.013	0.039	0.017	0.036	0.013	0.031
78.1	0.036	2.447	0.089	2.441	0.056	2.444
0.0	0.015	0.062	0.024	0.057	0.017	0.051
93.7	0.043	2.667	0.106	2.661	0.068	2.666
0.0	0.016	0.079	0.028	0.075	0.021	0.066
109.3	0.048	2.876	0.123	2.875	0.082	2.882
0.0	0.020	0.103	0.034	0.113	0.028	0.087
124.9	0.055	3.084	0.142	3.074	0.094	3.093
0.0	0.022	0.118	0.039	0.130	0.033	0.099
140.5	0.059	3.313	0.163	3.271	0.104	3.327
0.0	0.021	0.144	0.043	0.163	0.035	0.121
156.1	0.060	3.488	0.175	3.460	0.111	3.506
0.0	0.022	0.194	0.047	0.204	0.038	0.161
171.7	0.059	3.710	0.183	3.680	0.117	3.744
0.0	0.029	0.266	0.055	0.262	0.044	0.223



RESULTS:

Load held for 1 minute = 295.9 psf


Maximum Test Load = 295.9 psf (No Failures)

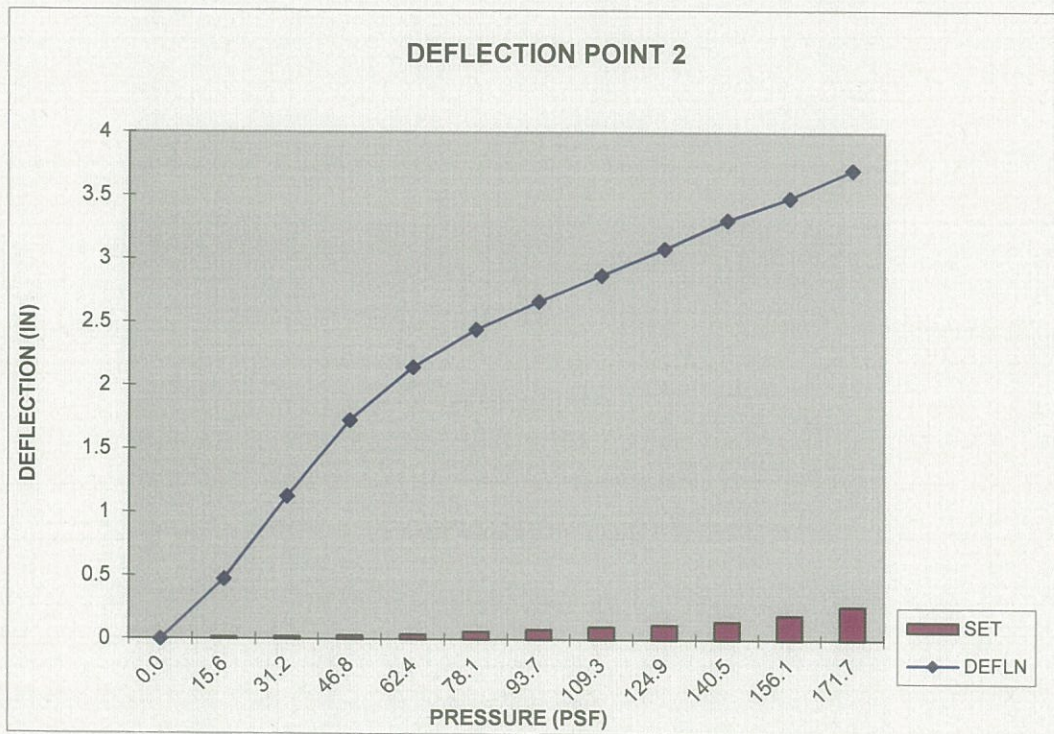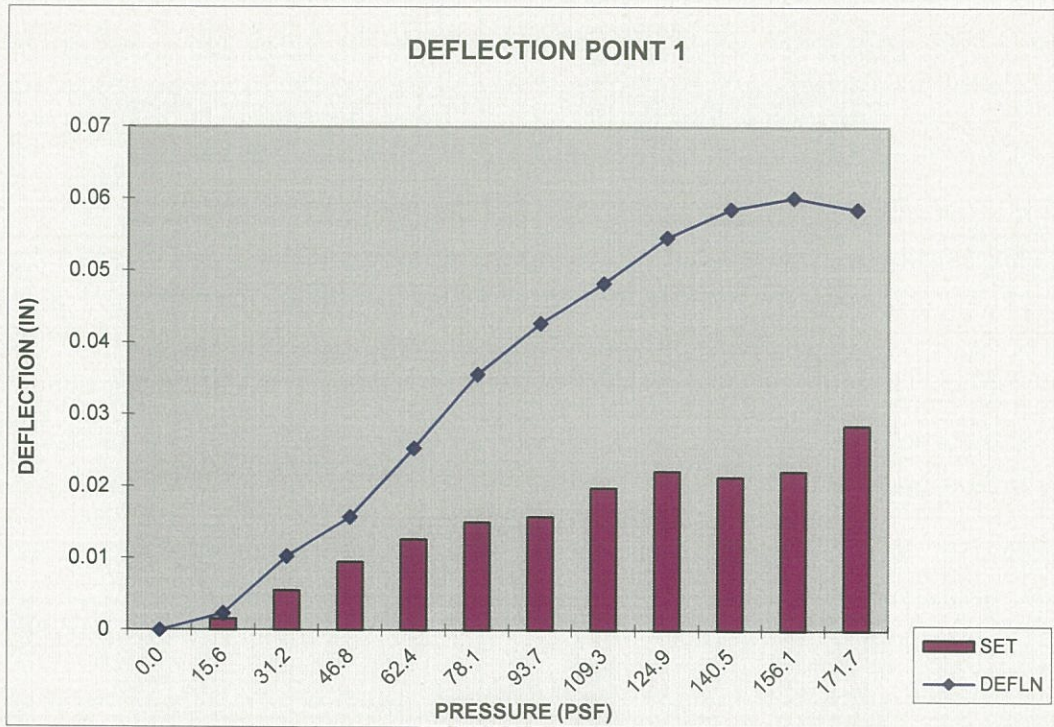

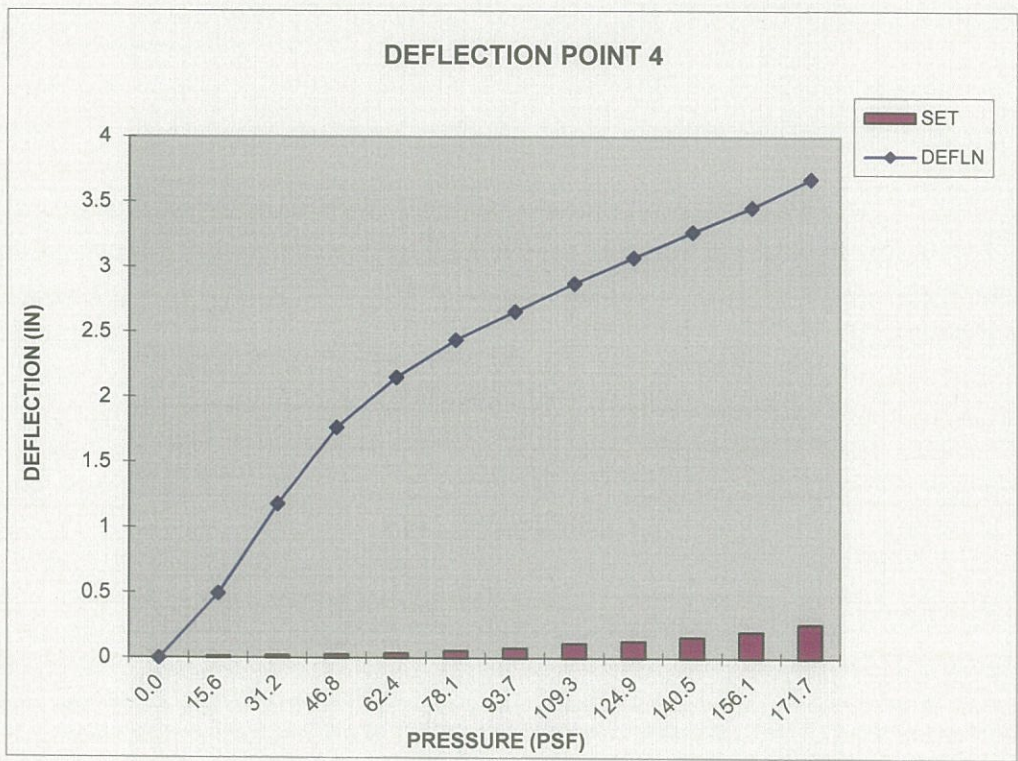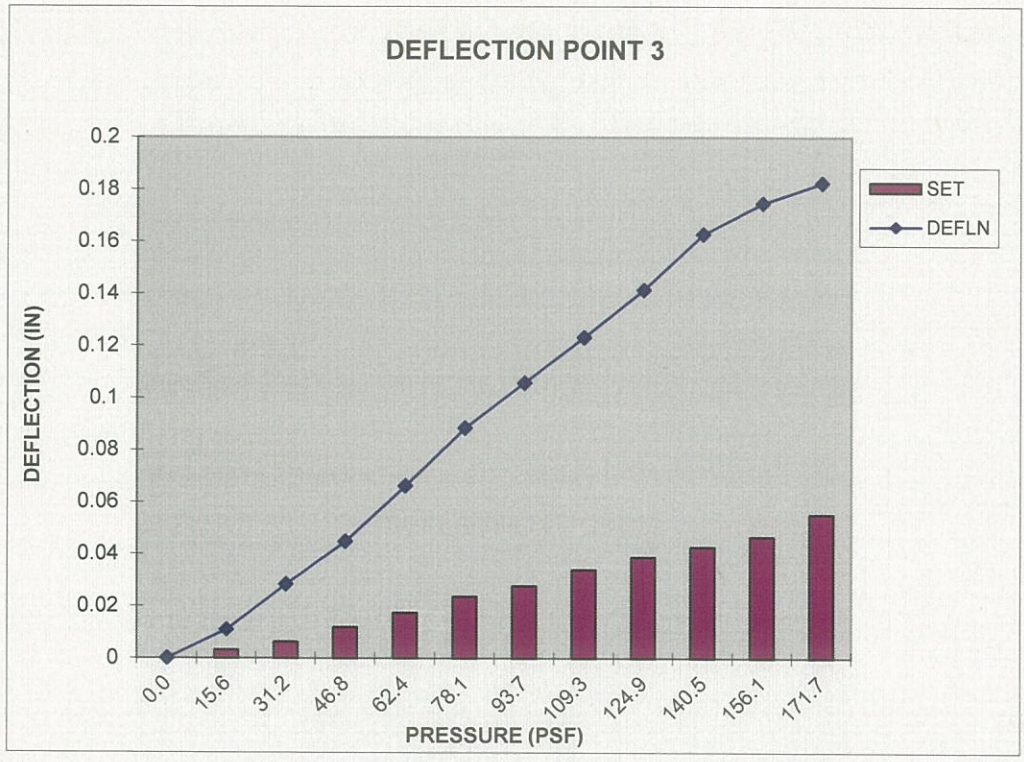

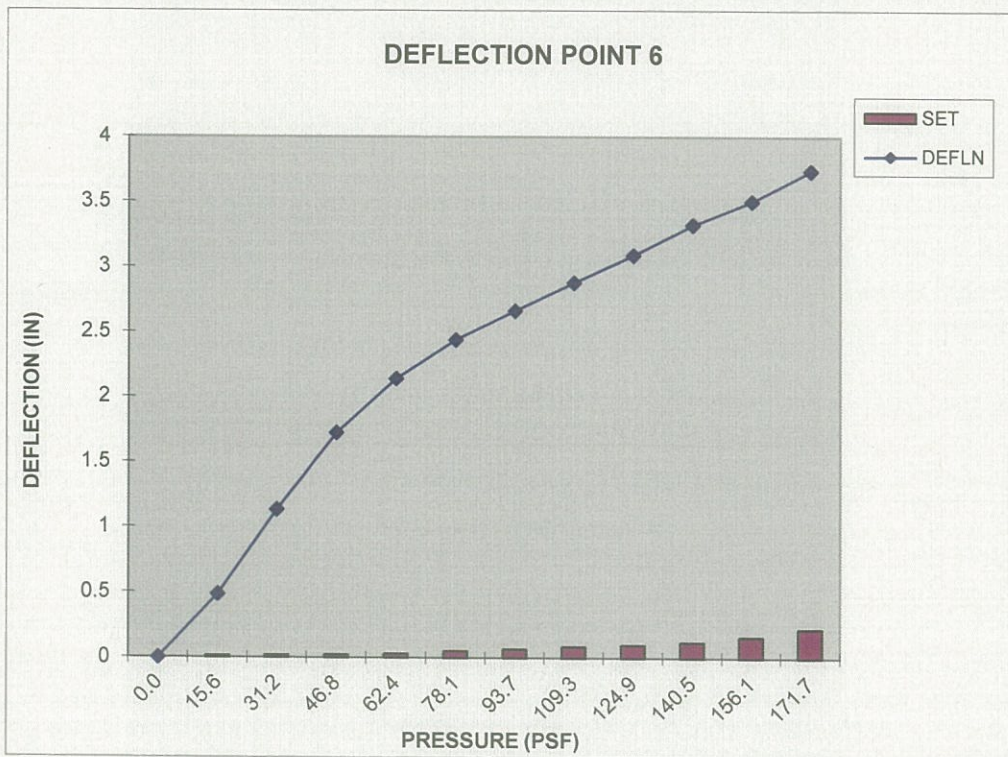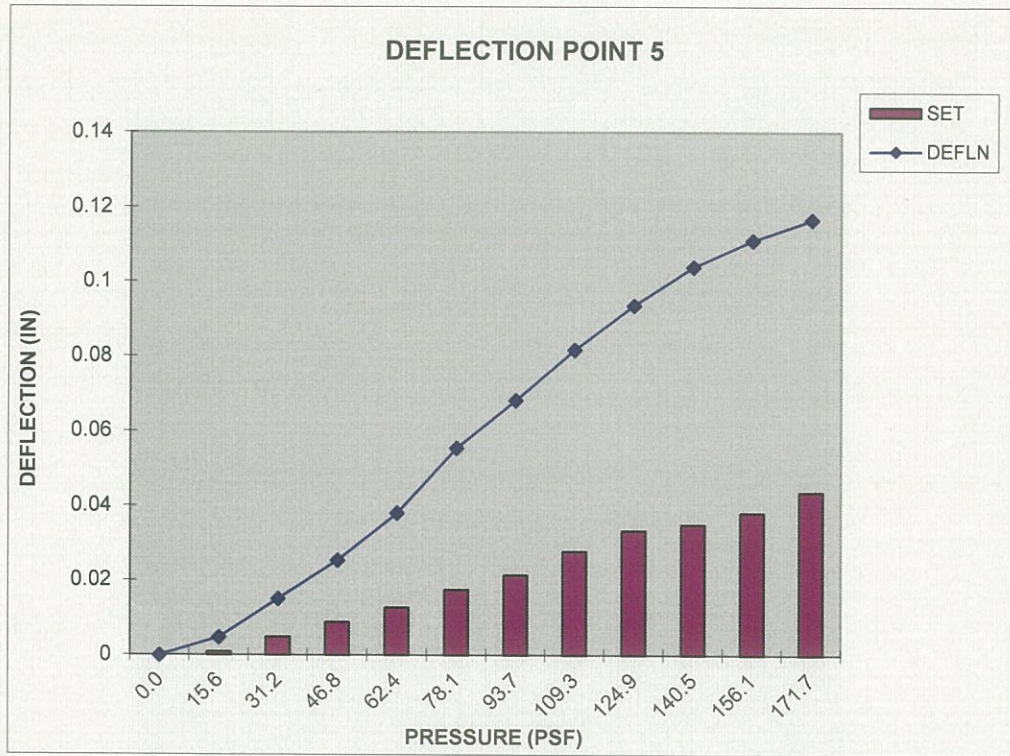


TEST #1 & #2

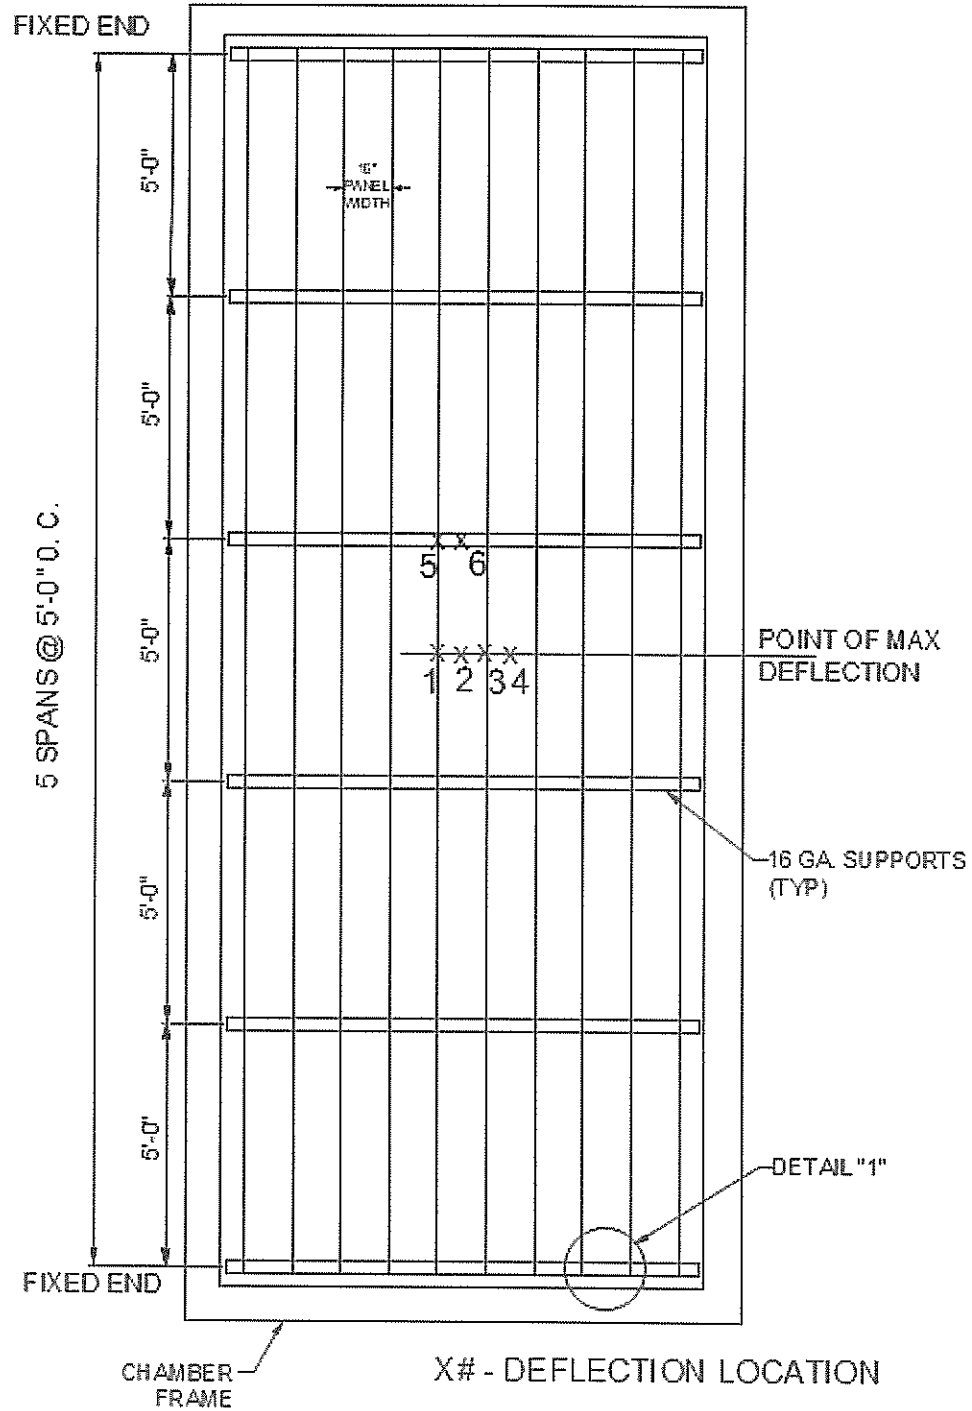


PLAN VIEW

TEST #3 & #4

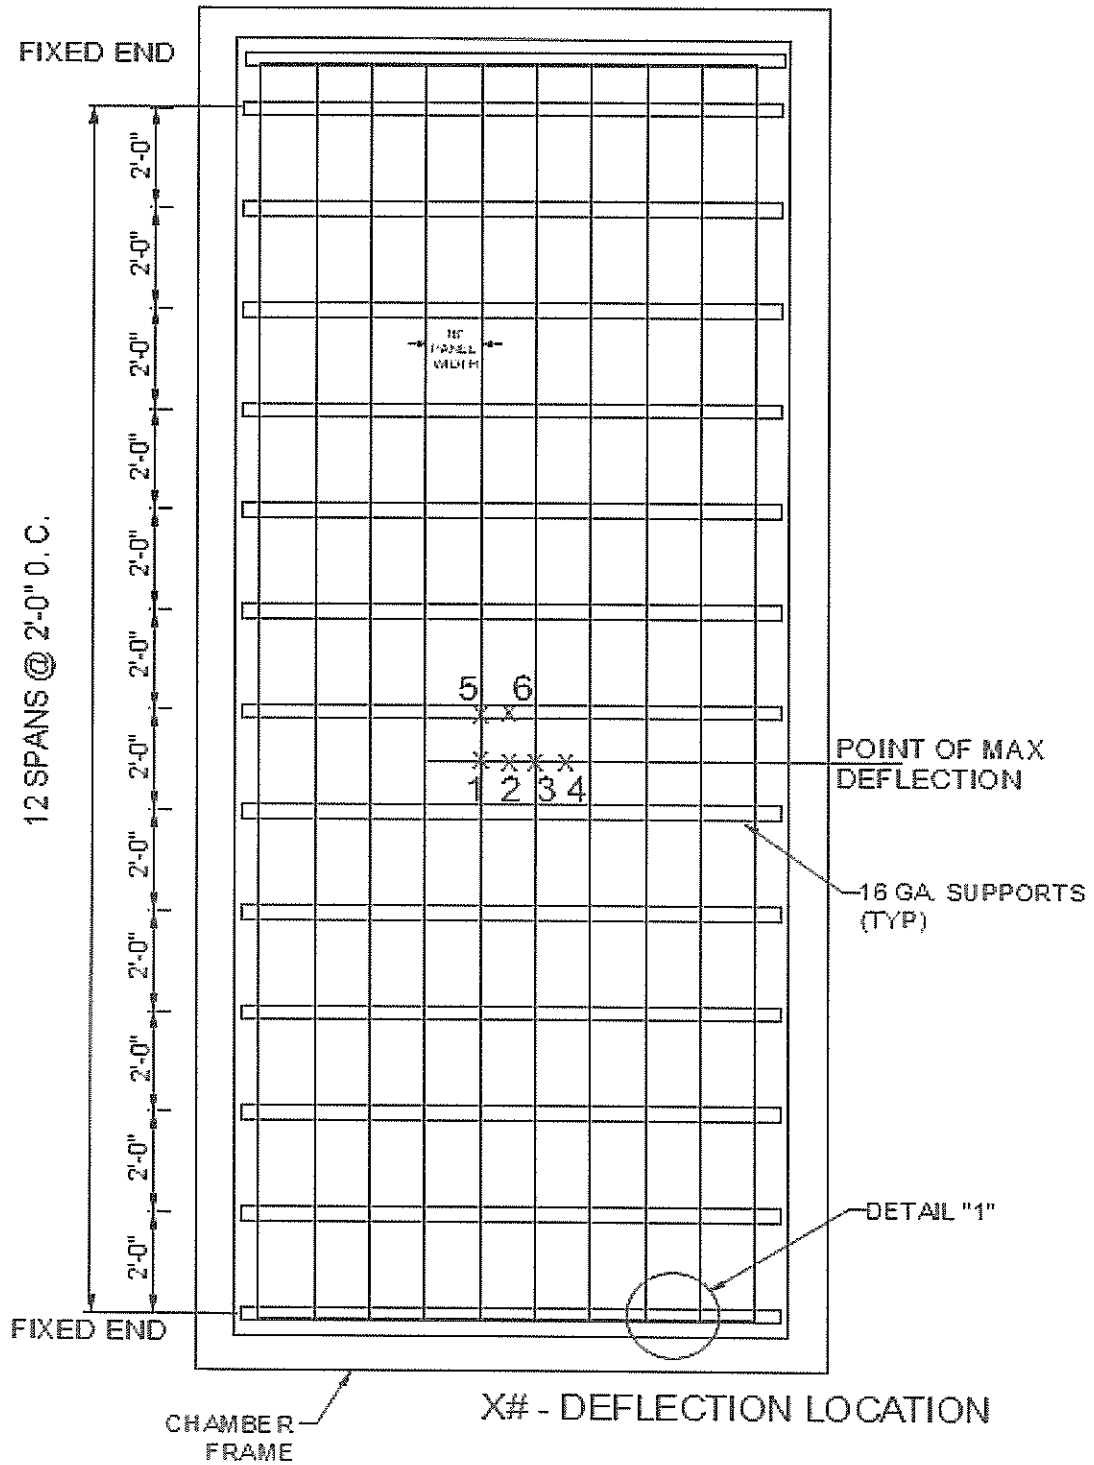


PLAN VIEW

1/4-14 SELF DRILLING FASTENERS
(5 PER PANEL AT FIXED ENDS)



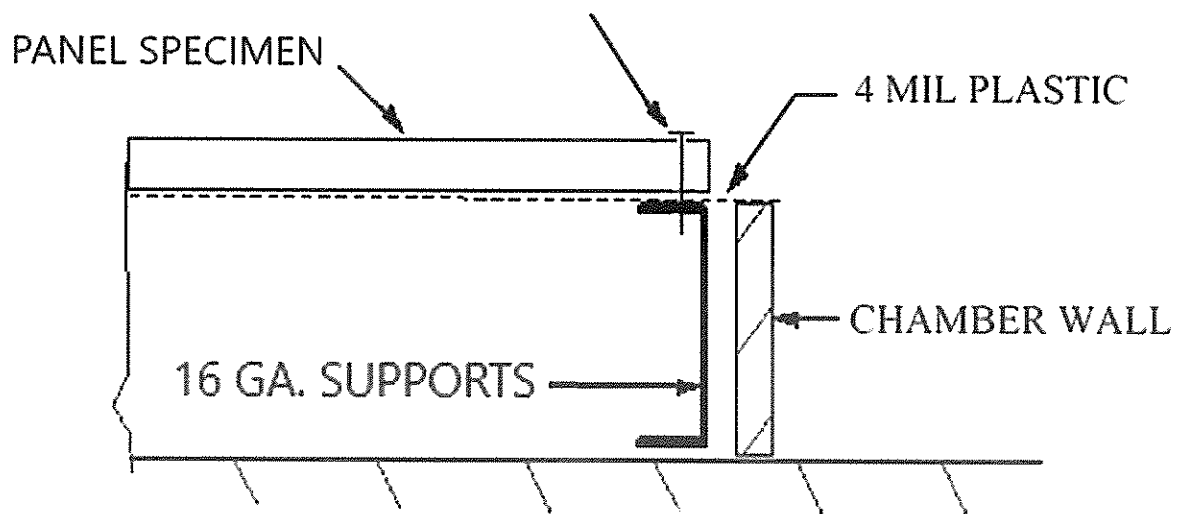


DETAIL 1

Project No. T146-19

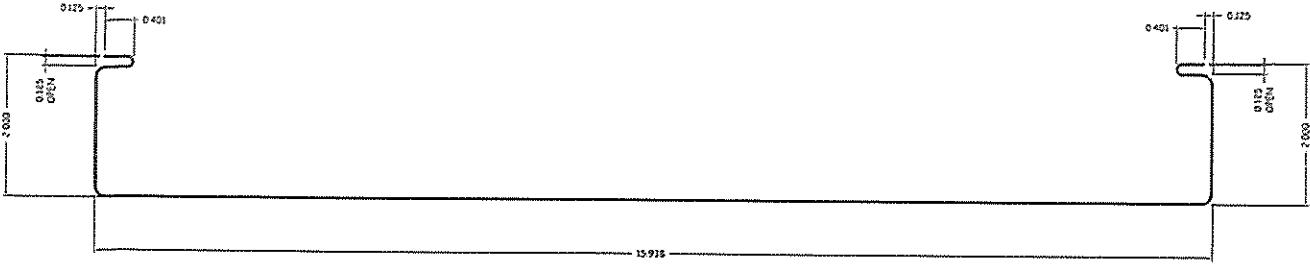


16" T PANEL

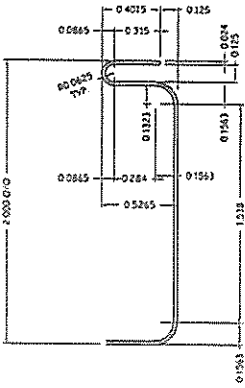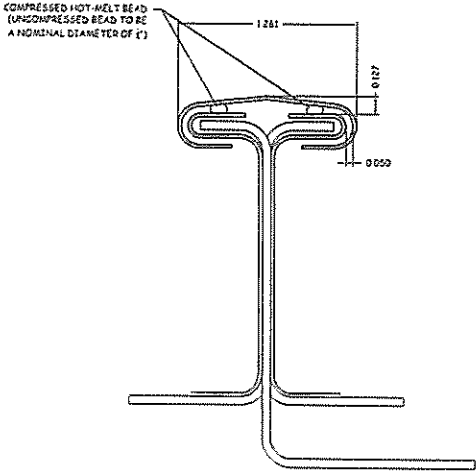

ENLARGED SIDE JOINT DETAIL

STUDY AT SIDE JOINT W/ CLIP CAP (AFTER SEAMING)

PANEL PROFILE

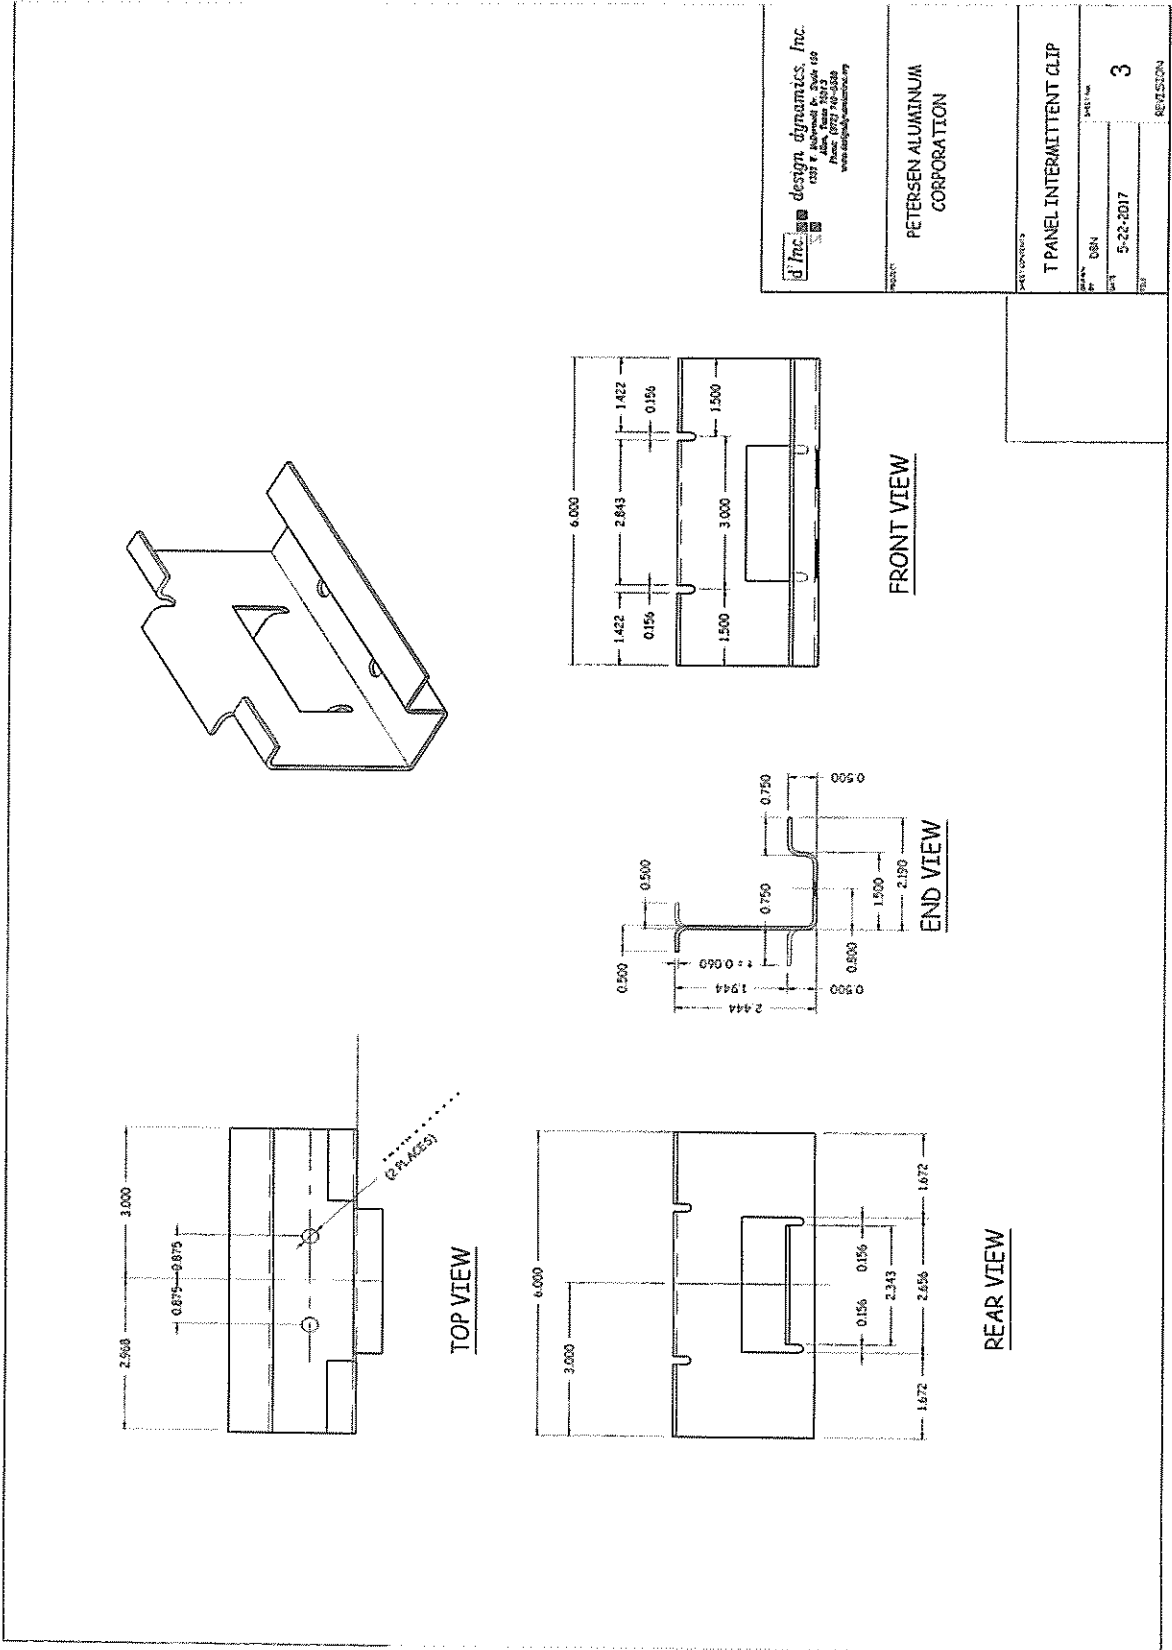

d'Arc design dynamics, Inc.
 1111 E. Alameda Ave., Suite 110
 Aurora, CO 80012
 Phone: (303) 740-3838
 www.darcengineering.com


PETERSEN ALUMINIA CORPORATION

T PANEL INTERMITTENT CLIP

DATE: 5-22-2017

REV: 3

REVISION

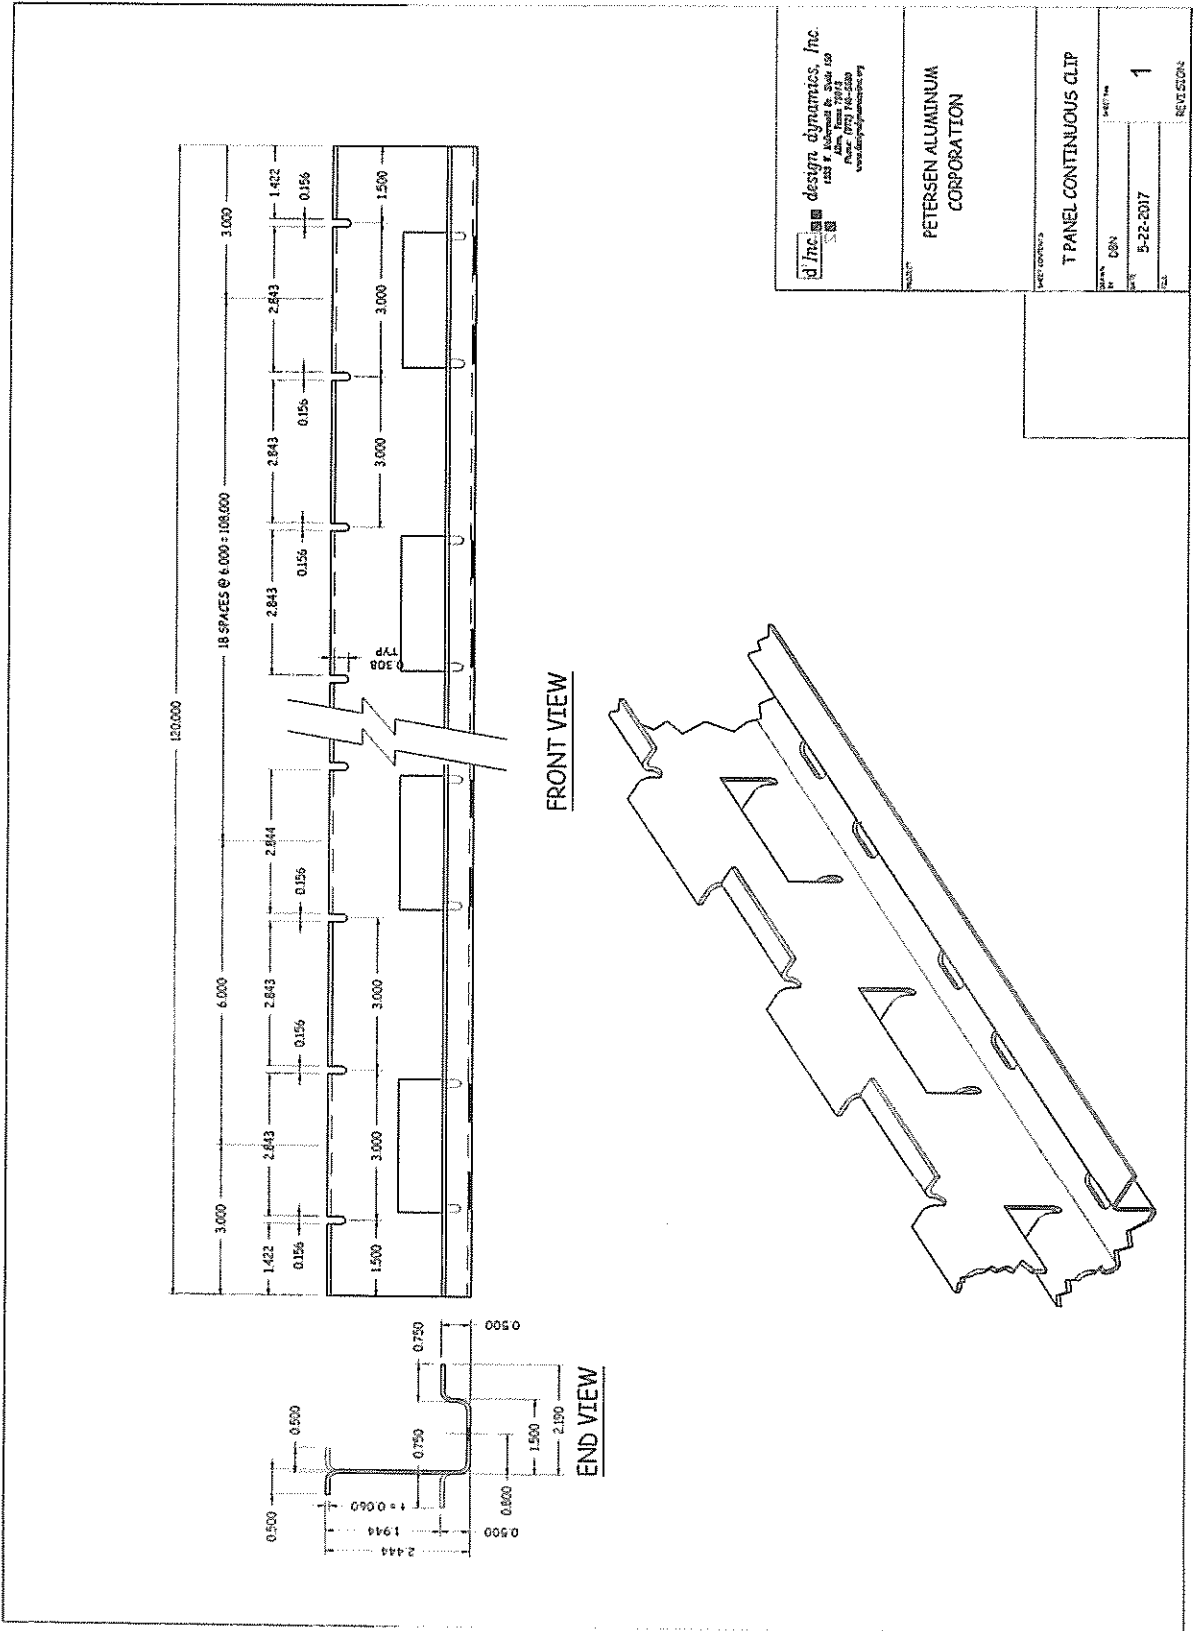

Project No. T146-19

TENSILE TEST REPORT

Client: Petersen Aluminum
10551 PAC Rd.
Tyler, TX. 75707

Test Date: March 13, 2019

Test Method: ASTM A370-10

Material Description: T-PANEL - Metal Roof Panel, 16" wide x 22 ga. steel

Sample No.	Width (in)	Thickness (in)	Yield Load (lb)	Max. Load (lb)	0.2% Offset Yield Strength (psi)	Tensile Strength (psi)	Elongation (% in 2 inches)
19010	0.507	0.027	741.2	858.4	54,144	62,704	29.9

Equipment Used: Tensile Machine #QT7-061196-020
Caliper #1074379
Extensometer #10311744D
Micrometer #110596927