



1900 NE MIAMI CT. SUITE 2-15, MIAMI, FL 33132

Product Evaluation Report

of

Croft, LLC

**Series 96W/96WB Single Hung Window
(Non-HVHZ) (Non-Impact)**

for

Florida Product Approval

FL# FL37180

Report No. 9042

Current Florida Building Code

Method:	1 – A (Certificate)
Category:	Windows
Sub – Category:	Single Hung
Product:	Series 96W/96WB Single Hung Window
Materials:	Aluminum 6063-T5
Product Dimensions:	See Installation Instructions, CRF014

Prepared for:


Croft, LLC
1800 North Clark Ave.
Magnolia, MS 39652

Prepared by:

Hermes F. Norero, P.E.
Florida Professional Engineer # 73778
Date: 12/26/23

Contents:

Evaluation Report Pages 1 – 3

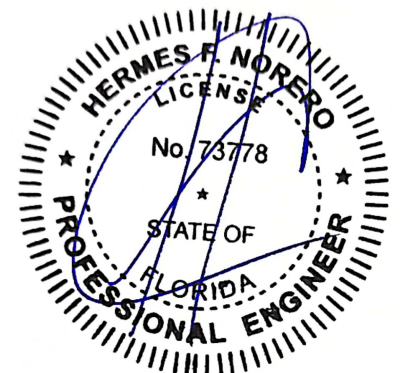

Hermes F. Norero, P.E.
Florida P.E. No. 73778

1900 NE MIAMI CT. SUITE 2-15, MIAMI, FL 33132

Manufacturer: Croft, LLC
Product Category: Windows
Product Sub-Category: Single Hung
Compliance Method: State Product Approval Method (1)(a)
Product Name: Series 96W/96WB Single Hung Window (Non-HVHZ) (Non-Impact)

Scope: This is a Product Evaluation Report issued by Hermes F. Norero, P.E. (FL # 73778) **Croft, LLC** based on Method 1a of the State of Florida Product Approval, Department of Business and Professional Regulation - Florida Building Commission.

Hermes F. Norero, P.E. does not have nor will acquire financial interest in the company manufacturing or distributing the product or in any other entity involved in the approval process of the product named herein.

This product has been evaluated for use in locations adhering to the current Florida Building Code.

See Installation Instructions **CRF014**, signed and sealed by Hermes F. Norero, P.E. (FL # 73778) for specific use parameters.

Limits of Use:

1. This product has been evaluated and is in compliance with the current Florida Building Code, **excluding** the “High Velocity Hurricane Zone” (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment into substrate material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection this product complies with Chapter 16 of the current Florida Building Code and **does require** an impact resistant covering.
4. Site conditions that deviate from the details of installation instructions **CRF014** require further engineering analysis by a licensed engineer or registered architect.
5. See Installation Instructions **CRF014** for size and design pressure limitations.

1900 NE MIAMI CT. SUITE 2-15, MIAMI, FL 33132

Certification Agency: The manufacturer has demonstrated compliance of manufacture of products in accordance with the Florida Building Code for manufacturing under an approved certification agency through **National Accreditation and Management Institute, Inc.** (FBC Organization # CER1773).

Performance Standards: The product described herein has been evaluated per:

- AAMA/WDMA/CSA 101/I.S.2/A440-08

Referenced Data:

1. Product Testing performed by **Architectural Testing, Inc.** (FBC Organization # TST1910)
Report #: B7508.01-801-47 Report Date: 03/21/12
2. Product Testing performed by **PRI Construction Materials Technologies, LLC** (FBC Organization # TST5878)
Report #: 2189T0009.01 Report Date: 08/28/2020
2189T0009.02 Report Date: 08/28/2020
3. Certification Agency
National Accreditation and Management Institute, Inc.
(FBC Organization #: CER1773)

Installation:

Refer to Installation Instructions (**CRF014**) for anchor spacing and more details of the installation requirements.

Design Pressure:

Refer to Installation Instructions (**CRF014**) for design pressures based on size, configuration, and glass types.