



398 E DANIA BEACH BLVD. SUITE 338, DANIA BEACH, FL 33004

## Product Evaluation Report

*of*

**Arcadia Inc.  
Series IPTC-470 Aluminum Storefront  
(WZ3) (Impact)**

*for*

**Florida Product Approval**

**FL# FL40951**

**Report No. 7863**

**Current Florida Building Code**


<b>Method:</b>	<b>1 – D (Engineering Evaluation)</b>
<b>Category:</b>	<b>Panel Walls</b>
<b>Sub – Category:</b>	<b>Storefront</b>
<b>Product:</b>	<b>Series IPTC-470 Aluminum Storefront</b>
<b>Materials:</b>	<b>Aluminum 6063-T6</b>
<b>Product Dimensions:</b>	<b>See Installation Instructions, ARC001</b>

**Prepared for:**

**Arcadia Inc.  
2301 East Vernon Ave.  
Vernon, CA 90058**

**Prepared by:**

**Hermes F. Norero, P.E.**  
Florida Professional Engineer # 73778  
Date: 2/15/2022

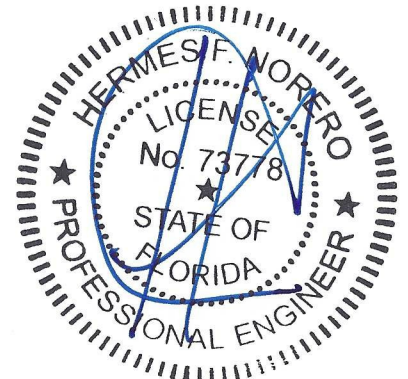

Contents:

Evaluation Report      Pages 1 – 4

Hermes F. Norero, P.E.  
Florida P.E. No. 73778

398 E DANIA BEACH BLVD. SUITE 338, DANIA BEACH, FL 33004

**Manufacturer:** Arcadia Inc.  
**Product Category:** Panel Walls  
**Product Sub-Category:** Storefront  
**Compliance Method:** State Product Approval Method (1)(d)  
**Product Name:** Series IPTC-470 Aluminum Storefront (WZ3) (Impact)

**Scope:** This is a Product Evaluation Report issued by Hermes F. Norero, P.E. (FL # 73778) for **Arcadia Inc.** based on Method 1d of the State of Florida Product Approval, Department of Business and Professional Regulation - Florida Building Commission.

Hermes F. Norero, P.E. does not have nor will acquire financial interest in the company manufacturing or distributing the product or in any other entity involved in the approval process of the product named herein.

This product has been evaluated for use in locations adhering to the current Florida Building Code.

See Installation Instructions **ARC001**, signed and sealed by Hermes F. Norero, P.E. (FL # 73778) for specific use parameters.

**Limits of Use:**

1. This product has been evaluated and is in compliance with the current Florida Building Code, **excluding** the “High Velocity Hurricane Zone” (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment into substrate material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection this product complies with Chapter 16 of the current Florida Building Code and **does not require** an impact resistant covering in wind zone 3 or less.
4. When used in areas requiring wind borne debris protection this product complies with Chapter 16 of the current Florida Building Code and **requires** an impact resistant covering in wind zone 4.
4. Site conditions that deviate from the details of installation instructions **ARC001** require further engineering analysis by a licensed engineer or registered architect.
5. See Installation Instructions **ARC001** for size and design pressure limitations.

398 E DANIA BEACH BLVD. SUITE 338, DANIA BEACH, FL 33004

**Quality Assurance:** The manufacturer has demonstrated compliance of manufacture of products in accordance with the Florida Building Code for manufacturing under a quality assurance program audited by an approved quality assurance entity through **Architectural Testing, Inc.** (FBC Organization # QUA1844).

**Performance Standards:** The product described herein has been evaluated per:

- ASTM E1886-13
- ASTM E1996-14
- ASTM E283-04(2012)
- ASTM E330-14
- ASTM E331-00(2009)
- AAMA 501-15

**Referenced Data:**

1. Product Testing performed by **Architectural Testing, Inc.**  
(FBC Organization # TST9424)  
Report: C1752.01-701-44 Dated: 10/02/2012  
Test Report Signed and Sealed by Tyler Westerling, P.E. No. 72012
2. Product Testing performed by **Fenestration Testing Laboratory, Inc.**  
(FBC Organization # TST4129)  
Report: T15-104 Dated: 12/11/2015
3. Quality Assurance  
**Architectural Testing, Inc.**  
(FBC Organization #: QUA1844)
4. Material Certification  
**Miami-Dade County Notice of Acceptance**  
**Kuraray America Inc.**  
SentryGlas Interlayer

398 E DANIA BEACH BLVD. SUITE 338, DANIA BEACH, FL 33004

**Equivalence of Test Standards:**

Various test standards have been evaluated for differences in test methodology, if any, between tested editions of the test standards listed below and those editions referenced in the current Florida Building Code. Arcadia Inc., has tested their products to the following test standard edition(s):

1. ASTM E1886-05
2. ASTM E1996-05

Chapter 35 of the current Florida Building Code references the following editions of the above mentioned test standards:

1. ASTM E1886-13
2. ASTM E1996-14

After review of the above mentioned referenced standards and editions, it has been found that the results and tests carried out meet the requirements for compliance. All referenced standards have been found to be equivalent.

**Installation:**

Refer to Installation Instructions (**ARC001**) for anchor spacing and more details of the installation requirements.

**Design Pressure:**

Refer to Installation Instructions (**ARC001**) for design pressures based on size, configuration, and glass types.