



# BUILDING DROPS

A Perfect Solution in Every Drop  
Certificate of Authorization: 29578

398 E. Dania Beach Blvd.  
Suite 338  
Dania Beach, FL 33004  
954.399.8478 PH  
954.744.4738 FX  
contact@buildingdrops.com

## Product Evaluation Report *of*

**JELD-WEN, Inc.**

**Premium Atlantic Vinyl Single Hung**

*for*

**Florida Product Approval**

**Report No. 4870**

**Current Florida Building Code**


**Method:** 1 – A (Certificate)  
**Category:** Windows  
**Sub – Category:** Single Hung

**Product:** *Premium Atlantic Vinyl Single Hung*  
**Material:** PVC  
**Product Dimensions:** 52-1/8" x 75" (O/X)

**Prepared For:**  
**JELD-WEN, Inc.**  
**3737 Lakeport Blvd.**  
**Klamath Falls, OR 97601**

**Prepared by:**  
**Hermes F. Norero, P.E.**  
Florida Professional Engineer # 73778  
Date: 06/10/2017

Contents:  
Evaluation Report Pages 1 – 4

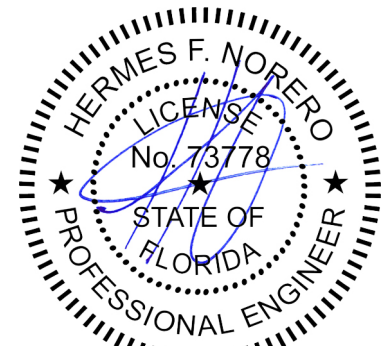

Hermes F. Norero, P.E.  
Florida No. 73778



# BUILDING DROPS

A Perfect Solution in Every Drop

Certificate of Authorization: 29578

Date: 06/10/2017

Report No: 4870

---

**Manufacturer:** JELD-WEN, Inc.

**Product Category:** Windows

**Product Sub-Category:** Single Hung

**Compliance Method:** State Product Approval Method (1)(a)

**Product Name:** Premium Atlantic Vinyl Single Hung  
(Non-Impact)  
52-1/8" x 75" (O/X)

**Scope:** This is a Product Evaluation Report issued by Hermes F. Norero, P.E. (FL # 73778) for **JELD-WEN, Inc.** based on Method 1a of the State of Florida Product Approval, Department of Business and Professional Regulation - Florida Building Commission.

Hermes F. Norero, P.E. does not have nor will acquire financial interest in the company manufacturing or distributing the product or in any other entity involved in the approval process of the product named herein.

This product has been evaluated for use in locations adhering to the current Florida Building Code.

See Installation Instructions **NCTL210-3876-1-FBC**, signed and sealed by Hermes F. Norero, P.E. (FL # 73778) for specific use parameters.

## Limits of Use:

1. This product has been evaluated and is in compliance with the current Florida Building Code, including the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment into substrate material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection this product complies with Section 1609.1.2 of the current Florida Building Code and does require an impact resistant covering.
4. Site conditions that deviate from the details of drawing **NCTL210-3876-1-FBC** require further engineering analysis by a licensed engineer or registered architect.
5. See Installation Instructions **NCTL210-3876-1-FBC** for size and design pressure limitations.

Hermes F. Norero, P.E.

Florida No. 73778

Page 2 of 4



# BUILDING DROPS

**A Perfect Solution in Every Drop**

Certificate of Authorization: 29578

Date: 06/10/2017

Report No: 4870

---

**Quality Assurance:** The manufacturer has demonstrated compliance of products in accordance with the Florida Building Code for manufacturing under a quality assurance program audited by an approved quality assurance entity through **National Accreditation and Management Institute** (FBC Organization #: QUA 1789).

**Performance Standards:** The product described herein has been tested per:

- TAS 202-94

**Referenced Data:**

1. Product Testing performed by **National Certified Testing Laboratories NW** (FBC Organization # TST9341)  
Report #: NCTL-210-3876-1, Report Date: 4/18/2013  
Report #: NCTL-110-16-136, Report Date: 2/2/2017
2. Certification Agency  
**National Accreditation and Management Institute**  
(FBC Organization #: CER 1773)
3. Material Certification  
**Miami Dade RER – Product Control Section NOA**  
Quanex Building Products: PVC Extrusions



# BUILDING DROPS

A Perfect Solution in Every Drop

Certificate of Authorization: 29578

Date: 06/10/2017

Report No: 4870

**Through Frame Installation:** 1. Approved anchor types and substrates are as follows:

- A. For concrete (Min.  $f'c = 3000$  psi) or masonry substrate (Min.  $f'c = 1500$  psi) where one by (1X), non-structural, wood bucking is employed, use **(1) 3/16" diameter ITW Tapcon** type concrete screw anchors per location of sufficient length to achieve minimum embedment of 1.25" into concrete or masonry.
- B. For concrete (Min.  $f'c = 3000$  psi) or masonry substrate (Min.  $f'c = 1500$  psi) where wood bucking is NOT employed, use **(1) 3/16" diameter ITW Tapcon** type concrete screw anchors per location of sufficient length to achieve minimum embedment of 1.25" into concrete or masonry.
- C. For steel substrate, use **(1) #8 Tek Screw** type steel frame (min. 18ga.) anchors per location of sufficient length to achieve minimum three threads of penetration beyond steel structure.

**Nail Fin Installation (Where applicable):**

- A. For wood substrates (Min. S.G. = 0.42) use **(1) #10 Wood Screw** type installation anchors per location of sufficient length to achieve a minimum embedment of 1.50" into the wood substrate.

Refer to Installation Instructions (**NCTL210-3876-1-FBC**) for anchor spacing and more details of the installation requirements.

**Design Pressure:**

Design Pressure	
Positive	65 PSF
Negative	70 PSF

Hermes F. Norero, P.E.

Florida No. 73778

Page 4 of 4