	PROJECT: QUAKER C600/C605 W600/W605 Casement Windows	BY: TAD DATE: 10/17/23
	PROJECT NO.: Q5070.01-122-34	CKD: ARK SHEET: 1 OF 20

Window Installation Analysis

QUAKER WINDOWS & DOORS
C600/C605 One Tone Casement Windows
C600/C605 Two Tone Casement Windows
W600/W605 Wood Two Tone Casement Windows

Report Q5070.01-122-34

Rendered to:

Quaker Windows & Doors
P.O. Box 128
504 Highway 63 South
Freeburg, MO 65035

Prepared by:


Tanya A. Dolby, P.E.
Adam Kunkel

Architectural Testing, Inc.
130 Derry Court
York, Pennsylvania 17406
(717) 764-7700

October 17, 2023

Tanya A. Dolby, P.E.
Manager, Engineering Services

Adam Kunkel
Project Engineer

	PROJECT: QUAKER C600/C605 W600/W605 Casement Windows	BY: TAD DATE: 10/17/23
	PROJECT NO.: Q5070.01-122-34	CKD: ARK SHEET: 2 OF 20

Scope

Architectural Testing, Inc., an Intertek company, was contracted by Quaker Window & Doors to perform installation analysis for C600/C605 and W600/W605 Casement Windows on test report L0630.01-801-47-R5.

The analyses performed satisfy the methods and requirements of the following:

Florida Building Code, Building, 8th Edition (2023). International Code Council, 2023.

ADM-2020 Aluminum Design Manual. The Aluminum Association, Inc., 2020.

AAMA TIR-A9-14 Design Guide for Metal Cladding Fasteners, Includes 2020 Addendum. American Architectural Manufacturers Association, 2014.


AISI S100-16(2020) North American Specification for the Design of Cold-Formed Steel Structural Members, 2016 Edition (Reaffirmed 2020). American Iron and Steel Institute, 2020.

ICC-ES Report ESR-1976 ITW Buildex TEKS Self-Drilling Fasteners. ICC Evaluation Service. 01/2023.

GANA Glazing Manual, 50th Anniversary Edition

ANSI/AWC NDS-2018 National Design Specification (NDS) for Wood Construction with 2018 Supplement. American Wood Council, 2018.


The calculations presented herein are for the integrity of the window installations based on wind load only. The weather tightness of the installation is not addressed by this report. The air/water/structural performance of the individual products is not proven by this report.

	PROJECT: QUAKER C600/C605 W600/W605 Casement Windows	BY: TAD DATE: 10/17/23
	PROJECT NO.: Q5070.01-122-34	CKD: ARK SHEET: 3 OF 20

Certification of Independence

In accordance with Rule 61G20-3 Florida Administrative Code, Architectural Testing, Inc. hereby certifies the following:

- Architectural Testing does not have, nor does it intend to acquire or will it acquire, a financial interest in any company manufacturing or distributing products tested or labeled by the agency.
- Architectural Testing is not owned, operated or controlled by any company manufacturing or distributing products it tests or labels.
- Tanya A. Dolby, P.E. and Adam R. Kunkel do not have nor will acquire, a financial interest in any company manufacturing or distributing products for which the reports are being issued.
- Tanya A. Dolby, P.E. and Adam R. Kunkel do not have, nor will acquire, a financial interest in any other entity involved in the approval process of the product.

	PROJECT: QUAKER C600/C605 W600/W605 Casement Windows	BY: TAD DATE: 10/17/23
	PROJECT NO.: Q5070.01-122-34	CKD: ARK SHEET: 4 OF 20

Analyses

Summary of Test Results

The following table summarizes the C600/C605 and W600/W605 Casement Windows and the corresponding performance level established by testing.

Table 1 Summary of Test Results

Series/Model	Test Report Number	Product Certification	Size (W x H)	Performance
C600/C605 and W600/W605 Casement Window	L0630.01-801-47 (Revision 5, 08/16/23)	NI014355.01-R1	48" x 84"	+/- 70 psf


Testing documented in Table 1 was conducted by the Architectural Testing laboratory in Plano, Texas (Florida Department of Business & Professional Regulation Test Lab No. TST1910, IAS Accredited Laboratory TL-331).

As-Tested Installation Analysis

The specimen was secured to a 2x Spruce-Pine-Fir wood buck with #8 x 1-5/8" course thread wood/deck screws. The as-tested installation method is evaluated on page 8 and the established design capacity summarized in Table 2. Alternate anchorage is shown in Table 3 with on center spacings in Table 4 on page 6.

Table 2 As-Tested Anchorage Design Capacities

Installation	Connection	Capacity	Comments
Nailing Fin to Wood	#8 PH Wood Screw	86 lb	1. Limited by pull-over 2. 1 ½" minimum penetration 3. G = 0.55 Minimum SPF

	PROJECT: QUAKER C600/C605 W600/W605 Casement Windows	BY: TAD DATE: 10/17/23
	PROJECT NO.: Q5070.01-122-34	CKD: ARK SHEET: 5 OF 20

Anchorage Requirements

#8 x 1-5/8" course thread wood/deck screws actual test anchor capacity based on tested spacing:

Punched Opening Anchor Reactions


Roark's Formulas for Stress & Strain (Sixth Ed.) Table 26-1a

Design Pressure	70.0 psf					
Anchor Spacing	15.0 inch					
	Width, w	Height, h			R	Anchor Capacity for Specified Spacing
Window Mark	(inch)	(inch)	w/h	gamma	(lb/inch)	(lb)
L0630.01-801-47	48.00	84.00	1.75	0.497	11.61	174
	48.00	48.00	1.00	0.420	9.80	147

Calculated alternate anchors on the following pages are shown for 70 psf design pressure, #10 fasteners into wood and metal stud substrates.

The alternate anchorage conditions have design capacities which are comparable to or exceeds the least capacity of the as tested anchorage. All anchorage is installed 3" from corners and at the spacing calculated shown on pages 9 to 11 for 70 psf Design Load. Maximum shim space between the window frame and surrounding substrate is 1/4" for all conditions. Anchors must be fully shimmed and supported.

Glazing analysis for tested units is shown on pages 12 and 13. The glass Load Resistance was greater than or equal to the tested design pressures.

	PROJECT: QUAKER C600/C605 W600/W605 Casement Windows	BY: TAD DATE: 10/17/23
	PROJECT NO.: Q5070.01-122-34	CKD: ARK SHEET: 6 OF 20

Alternate Anchorage Capacities

Table 3 Alternate Anchorage Capacity – Nail Fin

Installation	Connection	Capacity	Comments
Nailing Fin to Wood	#10 PH Wood Screw	114 lb	1. Limited by pull-over 2. 1 ½" minimum penetration 3. G = 0.55 Minimum SYP
Nailing Fin to Wood	#10 Round Washer Head Wood Screw	178 lb	1. Limited by pull-over 2. 1 ½" minimum penetration 3. G = 0.55 Minimum SYP
Nailing Fin to Steel	#10 HWH TEKS Screw	128 lb	1. Limited by pull-out 2. Full penetration +3 threads 3. Min 18 gauge 33 KSI steel

Required Anchor Spacing at 70 psf Design Pressure


Anchorage Requirements

Although the capacities of the alternate anchorages exceed the capacity of the as-tested anchorage, it must be determined the anchorages are not overloaded for the approved window size and design pressures. Calculations presented in pages 9 to 11 show required spacing for the evaluated anchorage conditions. Results are summarized in the following table.

Table 4 Nail Fin Anchorage Requirements

Substrate	Anchor	70 psf Casement 48" x 84" Anchor Spacing	
		Jams	Head/Sill
Nailing Fin to Wood	#10-13 PH Wood Screw	10	12
	#10-13 Round Washer Head Wood Screw	15	18
Nailing Fin to Steel	#10 TEKS Screw	11	13


If the spacing reported in Table 5 exceeds the as-tested spacing reported in Table 2, the as tested spacing of 15" on center maximum shall govern.

	PROJECT: QUAKER C600/C605 W600/W605 Casement Windows	BY: TAD DATE: 10/17/23
	PROJECT NO.: Q5070.01-122-34	CKD: ARK SHEET: 7 OF 20

Reference Drawings

The reference drawings are the basis of the analysis presented herein and may not reflect the requirements established by this analysis.

- C600/C605 Casement One Tone Installation Instructions, 08-22-2023
- C600/C605 Casement Two Tone Installation Instructions, 08-22-2023
- W600/W605 Casement Wood Two Tone Installation Instructions, 08-22-2023

	PROJECT: QUAKER C600/C605 W600/W605 Casement Windows	BY: TAD DATE: 10/17/23
	PROJECT NO.: Q5070.01-122-34	CKD: ARK SHEET: 8 OF 20

As-Tested Installation – Nailing Fin to Wood Blocking

#8 x 1-5/8" Pan Head Wood/Deck Screw (Non-Countersunk)
 $D_{ws} = (0.322" + 0.306")/2 = 0.314"$ (Nominal Screw Head Diameter)
 $D_H = 0.177"$ (Section 11.0, AAMA TIR-A9)

1-1/2" Minimum Penetration

1/16" thick 6063-T6 Aluminum Nailing Fin

G = 0.55 Minimum SYP 2x Wood Blocking

¼" maximum shim space

ASD Withdrawal

Withdrawal of #8 Wood Screw

$$W' = 2,850(G^2)(D)(Cd)(Cm)(Ct)(Ceg)(Ctn)(L)$$

$$W' = 2,850 (0.55^2)(0.164")(1.6)(0.7)(0.7)(1.00)(1.0)(1.50")$$

$$W' = 142 \text{ lb}$$

Adjustment Factors

- Load Duration Factor - Ten Minutes, Cd = 1.6
- Moisture Factor - Fabrication > 19% and In-Service > 19%, Cm = 0.7
- Temperature Factor - 100°F < T ≤ 125°F, Ct = 0.7
- End Grain Factor - No, Ceg = 1.00
- Toe Nail Factor - No, Ctn = 1.0


Pull-Over of #8 PH Wood Screw

$$P_{nov} = C_{pov}t_1F_{tu1}(D_{ws}-D_h)/3.0$$

$$P_{nov} = 1.0(0.0625")(30,000 \text{ psi})(0.314" - 0.177")/3.0$$

$$P_{nov} = 86 \text{ lb}$$

Calculated Capacity of Connection is 86 lb
Actual Tested Capacity is 147 lb
Safety Factor = 147/86 = 1.7
Qualifies 10% Increase to Alternate Anchor Capacity Based on Tested Unit

	PROJECT: QUAKER C600/C605 W600/W605 Casement Windows	BY: TAD DATE: 10/17/23
	PROJECT NO.: Q5070.01-122-34	CKD: ARK SHEET: 9 OF 20

1 - Alternate Installation – #10 Pan Head Wood Screw, Nail Fin to Wood

#10 Pan Head Wood Screw

$$D_{ws} = (0.373'' + .0357'')/2 = 0.365'' \text{ (Nominal Screw Head Diameter)}$$

$$D_H = 0.201'' \text{ (Nominal Hole Size, AAMA TIR-A9, Table 11.1)}$$

1-1/2" Minimum Penetration

1/16" thick 6063-T6 Aluminum Nailing Fin

G = 0.55 Minimum SYP 2x Wood Blocking

¼" maximum shim space

ASD Withdrawal

Withdrawal of #10 PH Wood Screw

$$W' = 2,850(G^2)(D)(Cd)(Cm)(Ct)(Ceg)(Ctn)(L)$$

$$W' = 2,850 (0.55^2)(0.190'')(1.6)(0.7)(0.7)(1.00)(1.0)(1.50'')$$

$$W' = 192 \text{ lb}$$

Adjustment Factors

Load Duration Factor - Ten Minutes, Cd = 1.6

Moisture Factor - Fabrication > 19% and In-Service > 19%, Cm = 0.7

Temperature Factor - 100°F < T ≤ 125°F, Ct = 0.7

End Grain Factor - No, Ceg = 1.00

Toe Nail Factor - No, Ctn = 1.0


Pull-Over of #10 PH Wood Screw

$$P_{nov} = C_{pov}t_1F_{tu1}(D_{ws}-D_h)/3.0$$

$$P_{nov} = 1.0(0.0625'')(30,000 \text{ psi})(0.365'' - 0.201'')/3.0$$

$$P_{nov} = 104 \text{ lb}$$

**Calculated Capacity of Connection is 104 lb
 Capacity of Connection at 10% Over is 114 lb (OK per Tested Capacity)**

	PROJECT: QUAKER C600/C605 W600/W605 Casement Windows	BY: TAD DATE: 10/17/23
	PROJECT NO.: Q5070.01-122-34	CKD: ARK SHEET: 10 OF 20

2 - Alternate Installation – #10 Round Washer Head Wood Screw, Nail Fin to Wood

#10 Round Washer Head Wood Screw

$$D_{ws} = (0.500'' + .472'')/2 = 0.486'' \text{ (Nominal Screw Head Diameter)}$$

$$D_H = 0.201'' \text{ (Nominal Hole Size, AAMA TIR-A9, Table 11.1)}$$

1-1/2" Minimum Penetration

1/16" thick 6063-T6 Aluminum Nailing Fin

G = 0.55 Minimum SYP 2x Wood Blocking

¼" maximum shim space

ASD Withdrawal

Withdrawal of #10 Wood Screw

$$W' = 2,850(G^2)(D)(Cd)(Cm)(Ct)(Ceg)(Ctn)(L)$$

$$W' = 2,850 (0.55^2)(0.190'')(1.6)(0.7)(0.7)(1.00)(1.0)(1.50'')$$

$$W' = 192 \text{ lb}$$

Adjustment Factors

Load Duration Factor - Ten Minutes, Cd = 1.6

Moisture Factor - Fabrication > 19% and In-Service > 19%, Cm = 0.7

Temperature Factor - 100°F < T ≤ 125°F, Ct = 0.7

End Grain Factor - No, Ceg = 1.00

Toe Nail Factor - No, Ctn = 1.0


Pull-Over of #10 Round Washer Head Wood Screw

$$P_{nov} = C_{pov}t_1F_{tu1}(D_{ws}-D_h)/3.0$$

$$P_{nov} = 1.0(0.0625'')(30,000 \text{ psi})(0.486'' - 0.201'')/3.0$$

$$P_{nov} = 178 \text{ lb}$$

Calculated Capacity of Connection is 178 lb

	PROJECT: QUAKER C600/C605 W600/W605 Casement Windows	BY: TAD DATE: 10/17/23
	PROJECT NO.: Q5070.01-122-34	CKD: ARK SHEET: 11 OF 20

3 - Alternate Installation – #10 HWH TEKS Screw, Nailing Fin to Steel Stud

#10 HWH TEKS Screw

Full Penetration +3 Threads

1/16" thick 6063-T6 Aluminum Nailing Fin

Minimum 18 Gauge 33 KSI Steel Stud (Qualifies thicker and stronger steel)

¼" maximum shim space

Allowable Tension of #10-16 TEKS Screw

$$V_a = 885 \text{ lb} \quad (\text{ESR-1976})$$

Pull-Over of #10 HWH TEKS Screw in Nail Fin

$$P_{nov} = C_{pov} t_1 F_{tu1} (D_{ws} - D_h) / 3.0$$

$$P_{nov} = 1.0(0.0625)(30,000 \text{ psi})(0.400" - 0.190") / 3.0$$

$$P_{nov} = 131 \text{ lb}$$

Pull-Out of #10 HWH TEKS Screw in Steel Stud

$$P_{not} = 0.85 t_c d F_{u2} / 3.0$$



$$P_{not} = 0.85(0.0478)(0.190)(45,000 \text{ psi}) / 3.0$$

$$P_{not} = 116 \text{ lb}$$

Calculated Capacity of Connection is 116 lb
Capacity of Connection at 10% Over is 128 lb (OK per Tested Capacity)

Glass Analysis

Test Reports L0630.01-801-47-R5

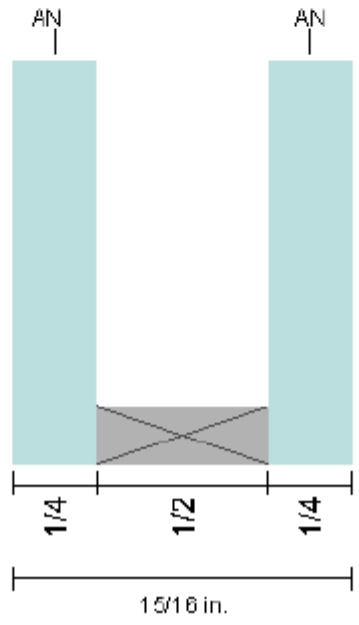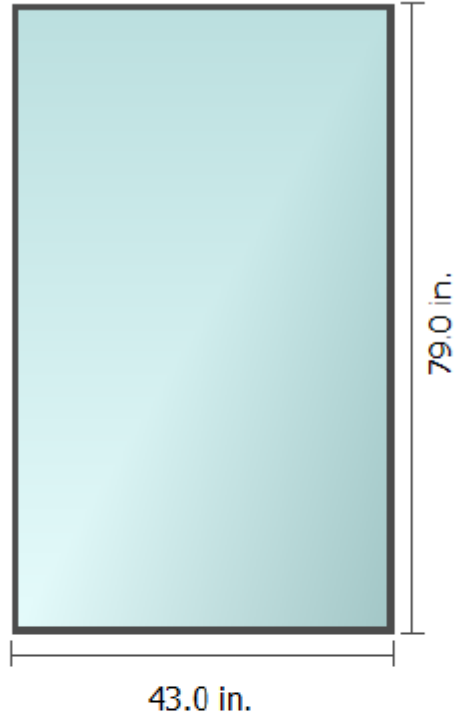

Analysis 1

Load Resistance Report

August 25, 2023

Details

Selected standard: ASTM E1300 Extended Basic

Glazing Construction (Double Glazed Insulating Unit)

Exterior Lite Properties (1/4 in. Monolithic)

Construction: 1/4 in. (AN)

Airspace Properties

Thickness: 0.480 in.

Interior Lite Properties (1/4 in. Monolithic)

Construction: 1/4 in. (AN)

Load Resistance

Short Duration (3 Sec)


Description	NFL	GTF	LSF	LR
Exterior Lite	39.0 psf	0.900	1/0.500	70.2 psf
Interior Lite	39.0 psf	0.900	1/0.500	70.2 psf

Comparisons

Scenario 1	
70.0 psf 3.00 sec \leq 70.2 psf	OK
Approximate center of glass deflection	
Exterior Lite	0.56 in.
Interior Lite	0.56 in.

Notes

Load resistance values are computed in accordance with ASTM E1300-16 Section 6.2 and are based on non-factored load values calculated in a manner consistent with those presented in ASTM E1300-16.

	PROJECT: QUAKER C600/C605 W600/W605 Casement Windows	BY: TAD DATE: 10/17/23
	PROJECT NO.: Q5070.01-122-34	CKD: ARK SHEET: 14 OF 20

Anchorage Spacing Calculation


Punched Opening Anchor Reactions

Roark's Formulas for Stress & Strain (Sixth Ed.) Table 26-1a

Nail Fin **Window Design Pressure:** **70.00**
Anchor

Substrate	Anchor	Anchor Capacity	Width, w (inch)	Height, h (inch)	w/h	gamma	R (lb/in)	Anchor Spacing (in)
Wood	#10 Wood Screw	114 lb	48.00	84.00	1.75	0.50	11.61	10"
			48.00	48.00	1.00	0.42	9.80	12"
	#10 Round Washer Head Wood Screw	178 lb	48.00	84.00	1.75	0.50	11.61	15"
			48.00	48.00	1.00	0.42	9.80	18"
Steel Stud	#10-16 TEKS	128 lb	48.00	84.00	1.75	0.50	11.61	11"
			48.00	48.00	1.00	0.42	9.80	13"

Anchor Spacing is limited to the least of the above calculated spacing or as tested spacing of 15" maximum on center.

	PROJECT: QUAKER C600/C605 W600/W605 Casement Windows	BY: TAD DATE: 10/17/23
	PROJECT NO.: Q5070.01-122-34	CKD: ARK SHEET: 15 OF 20

REFERENCE MATERIAL

#10-16 TEKS Screw References

TABLE 5—FASTENER STRENGTH OF SCREWS^{1, 2, 3, 4, 5}

SCREW DESIGNATION	DIAMETER (in.)	ALLOWABLE FASTENER STRENGTH		NOMINAL FASTENER STRENGTH	
		Tensile, P _{ts} /Ω (lbf)	Shear, P _{ss} /Ω (lbf)	Tensile, P _{ts} (lbf)	Shear, P _{ss} (lbf)
10-16	0.190	885	573	2654	1718
12-14	0.216	1184	724	3551	2171
12-24	0.216	1583	885	4750	2654
1/4-14	0.250	1605	990	4816	2970
1/4-28	0.250	1922	1308	5767	3925

For S_I: 1 inch = 25.4 mm, 1 lbf = 4.45 N.

¹For tension connections, the least of the allowable pull-out, pullover, and fastener tension strength found in Tables 2, 3, and 5, respectively, must be used for design.

²For shear connection, the lower of the allowable shear (bearing) and the allowable fastener shear strength found in Table 4 and 5, respectively, must be used for design.

³See Section 4.1 for fastener spacing and end distance requirements.

⁴Nominal strengths are based on laboratory tests

⁵To calculate LRFD values, multiply nominal strength values by the LRFD Φ factor of 0.5.

TABLE 22.11 (Spaced Threads)

6063-T6												
Nominal Thread Diameter & Thread Per Inch	D Nominal Thread Diameter (Inch)	Aluminum Thickness (Inches)										
		0.038	0.060	0.072	0.080	0.094	0.125	0.156	0.188	0.250	0.312	0.375
Allowable Pullout (Pounds)												
#8-18	0.1640	53	83	100	132	155	235	350	468	669	835	1004
#10-16	0.1900	61	96	116	153	180	239	372	509	775	968	1163
#12-14	0.2160	--	110	132	174	204	271	374	530	833	1100	1322
1/4-14	0.2500	--	127	152	201	236	314	433	614	964	1273	1530
5/16-12	0.3125	--	--	--	--	--	--	--	809	1334	1860	2296
3/8-12	0.3750	--	--	--	--	--	--	--	971	1601	2232	2755
				6063-T6								
F _U (Tensile Ultimate Strength)				30000		psi		Shading indicates transition region.				
F _Y (Tensile Yield Strength)				25000		psi						

NOTE 32:


- Each table lists allowable pull-out (internal threads) values. S_F = 3.0 for D ≤ 0.25"; S_F = 2.5 for D ≥ 0.3125". Fastener allowable strength (basic tension and external threads) needs to be checked separately.
- For pilot hole sizes refer to tables 21.1 to 21.7
- Fastener pullout not shown for aluminum thickness less than approximately 2 threads, unless tested at a lesser thickness.
- Multiple fastener connections and embrittlement need to be checked separately.

Appendix

WOOD SCREWS

**Pan Head w/
Phillips Recess**

TYPE-17 DEEP THREAD

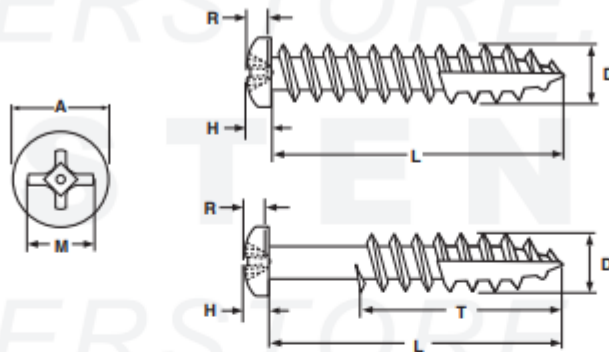

PAN PHILLIPS RECESS DEEP THREAD WOOD SCREW WITH TYPE-17 POINT


Nominal Diameter & Threads per Inch	A		H		R		M	D		T		Torque Kg/cm (Steel screws)	Recess Size
	Head Diameter		Head Height		Recess Penetration Depth		Recess Diameter	Major Diameter		Threaded Length			
	Max	Min	Max	Min	Max	Min	Ref	Max	Min	L ≤ 1"	L > 1"	Min	
6-13	0.270	0.256	0.097	0.087	0.080	0.055	0.159	0.142	0.131	Full thread	2/3 thread	21	#2
7-12	0.296	0.281	0.106	0.096	0.089	0.064	0.170	0.158	0.147	Full thread	2/3 thread	28	#2
8-11	0.322	0.306	0.115	0.105	0.097	0.071	0.175	0.169	0.159	Full thread	2/3 thread	37	#2
10-9	0.373	0.357	0.133	0.122	0.113	0.089	0.192	0.194	0.185	Full thread	2/3 thread	55	#2
12-8	0.425	0.407	0.151	0.139	0.124	0.098	0.252	0.230	0.213	Full thread	2/3 thread	64	#3
Tolerance on Length	Up to 5/8"						± 0.03						
	Over 5/8 to 1.5"						± 0.05						
	Over 1.5 to 2.75"						± 0.06						
	Over 2.75"						± 0.09						

Description	An externally threaded fastener with a dome-shaped head, cross recess and a single lead thread. The shank has a reduced diameter and a chip cavity cut out where the final several threads end at the tip.	
Applications / Advantages	The deeper thread design offers greater resistance to pull-out forces. Popular in fastening cabinet hardware in locations that do not require the head to countersink. The chip cavity (or auger point) are designed to attach hinges to the edge of hardwood face frames.	Used in environments where corrosion resistance is necessary. The type-17 point enables the screw to more easily penetrate the material into which it's fastened. Can be used in particle board, wood and some plastics.
Material	C1018 - 1022 case-hardened steel	18-8 Stainless Steel
Surface Hardness	Vickers 450 HV minimum	
Case Depth	0.004" - 0.009"	
Torque	See values in above table	
Plating	See Appendix-A for plating information	Stainless deep thread screws are usually supplied without additional finish.

WOOD SCREWS

Round Washer Head w/
Square/Phillips Combo Recess

TYPE-17 DEEP THREAD

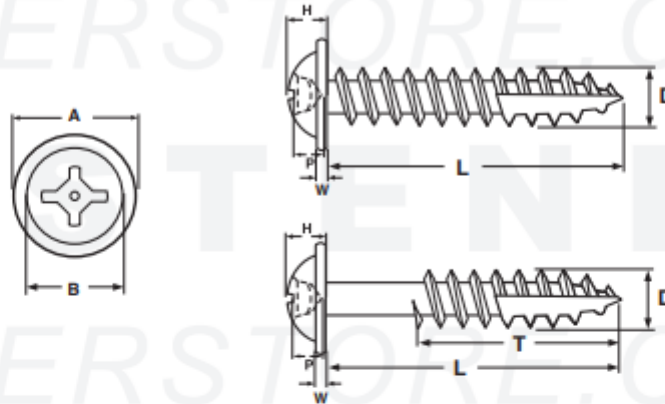

ROUND WASHER SQUARE/PHILLIPS RECESS DEEP THREAD WOOD SCREW W/ TYPE-17 POINT


Nominal Diameter	A		B	H		P		W		D		T		Recess Size (Square & Phillips)
	Washer Diameter		Head Diameter	Total Head Height		Recess Depth		Washer Thickness		Major Diameter		Threaded Length		
	Max	Min	Ref	Max	Min	Max	Min	Max	Min	Max	Min	L ≤ 1"	L > 1"	
8	0.376	0.352	0.305	0.120	0.110	0.080	0.065	0.050	0.030	0.174	0.164	Full thread	2/3 thread	#2
10	0.500	0.472	0.300	0.130	0.118	0.073	0.049	0.060	0.040	0.197	0.183	Full thread	2/3 thread	#2
Tolerance on Length	Up to 5/8"										+0 / -0.03			
	Over 5/8 to 1.5"										+0 / -0.05			
	Over 1.5 to 2.75"										+0 / -0.06			
	Over 2.75 to 5"										+0 / -0.09			

Description	An externally threaded fastener with a dome-shaped head and an integrally formed washer; a recess that can accommodate either a Phillips or Square screwdriver; and a single lead thread. The shank has a reduced diameter and a chip cavity cut out where the final several threads, ending at the tip.
Applications / Advantages	The deeper thread design offers greater resistance to pull-out forces. The chip cavity (or auger point) enables the fastener to drive—especially in denser woods—without pre-drilling a pilot hole. The head offers a greater bearing surface than a countersunk design. Used to attach surface-mounted door hinges or master lock hasps into dense woods or when attaching two pieces of wood through a pocket hole.
Material	C1022 case-hardened steel
Surface Hardness	Rockwell C 45 minimum
Case Depth	0.004" - 0.009"
Torque	#8 Diameter: 35 kg/cm minimum #10 Diameter: 50 kg/cm minimum
Plating	See Appendix-A for plating information

SELF-TAPPING SCREWS

Hex & Hex Washer Heads

HEAD DIMENSIONS

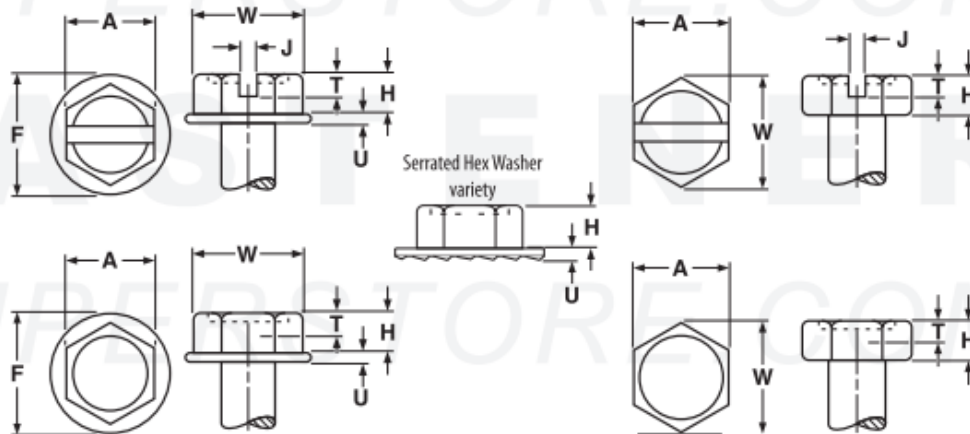

HEX & HEX WASHER HEADS FOR SELF-TAPPING & SELF-DRILLING SCREWS													ASME B18.6.3—2013*	
Nominal Size	A		W		H		F		U		J		T	
	Width Across Flats		Width Across Corners		Height of Head		Diameter of Washer		Thickness of Washer		Width of Slot		Depth of Slot	
	Max	Min	Min	Max	Min	Max	Min	Max	Min	Max	Min	Max	Min	
4	.188	.181	.202	.060	.049	.243	.225	.019	.011	.039	.031	.036	.025	
6	.250	.244	.272	.093	.080	.328	.302	.025	.015	.048	.039	.046	.033	
7	.250	.244	.272	.093	.080	.328	.302	.029	.017	.048	.039	.054	.040	
8	.250	.244	.272	.110	.096	.348	.322	.031	.019	.054	.045	.066	.052	
10	.312	.305	.340	.120	.105	.414	.384	.031	.019	.060	.050	.072	.057	
12	.312	.305	.340	.155	.139	.432	.398	.039	.022	.067	.056	.093	.077	
14	.375	.367	.409	.190	.172	.520	.480	.050	.030	.075	.064	.101	.083	
1/4 (standard)	.375	.367	.409	.190	.172	.520	.480	.050	.030	.075	.064	.101	.083	
1/4 (special)	.438	.428	.484	.188	.150	.618	.574	.055	.030	.084	.072	.110	.090	
5/16 (special)	.438	.428	.484	.230	.172	.676	.574	.063	.040	.084	.072	.122	.090	
5/16 (standard)	.500	.489	.545	.230	.208	.676	.624	.055	.035	.084	.072	.122	.100	
3/8	.562	.551	.614	.295	.270	.780	.720	.063	.037	.094	.081	.156	.131	
1/2*	.750	.735	.820	.400	.367	1.040	.960	.085	.050	.106	.091	.190	.165	

* Slot dimensions for 1/2-inch diameter hex washer head tapping screws are independent of ASME B18.6.3




PROJECT: QUAKER C600/C605 W600/W605
Casement Windows

BY: TAD DATE: 10/17/23

PROJECT NO.: Q5070.01-122-34

CKD: ARK SHEET: 19 OF 20

Tap & Clearance Drill Sizes				Tap Drill				Clearance Drill			
Screw Size	Major Diameter	Threads Per Inch	Minor Diameter	75% Thread for Aluminum, Brass, & Plastics		50% Thread for Steel, Stainless, & Iron		Close Fit		Free Fit	
				Drill Size	Dec. Eq.	Drill Size	Dec. Eq.	Drill Size	Dec. Eq.	Drill Size	Dec. Eq.
0	.0600	80	.0447	3/64	.0469	55	.0520	52	.0635	50	.0700
1	.0730	64	.0538	53	.0595	1/16	.0625	48	.0760	46	.0810
		72	.0560	53	.0595	52	.0635				
2	.0860	56	.0641	50	.0700	49	.0730	43	.0890	41	.0960
		64	.0668	50	.0700	48	.0760				
3	.0990	48	.0734	47	.0785	44	.0860	37	.1040	35	.1100
		56	.0771	45	.0820	43	.0890				
4	.1120	40	.0813	43	.0890	41	.0960	32	.1160	30	.1285
		48	.0864	42	.0935	40	.0980				
5	.125	40	.0943	38	.1015	7/64	.1094	30	.1285	29	.1360
		44	.0971	37	.1040	35	.1100				
6	.138	32	.0997	36	.1065	32	.1160	27	.1440	25	.1495
		40	.1073	33	.1130	31	.1200				
8	.1640	32	.1257	29	.1360	27	.1440	18	.1695	16	.1770
		36	.1299	29	.1360	26	.1470				
10	.1900	24	.1389	25	.1495	20	.1610	9	.1960	7	.2010
		32	.1517	21	.1590	18	.1695				
12	.2160	24	.1649	16	.1770	12	.1890	2	.2210	1	.2280
		28	.1722	14	.1820	10	.1935				
		32	.1777	13	.1850	9	.1960				
1/4	.2500	20	.1887	7	.2010	7/32	.2188	F	.2570	H	.2660
		28	.2062	3	.2130	1	.2280				
		32	.2117	7/32	.2188	1	.2280				
5/16	.3125	18	.2443	F	.2570	J	.2770	P	.3230	Q	.3320
		24	.2614	I	.2720	9/32	.2812				
		32	.2742	9/32	.2812	L	.2900				
3/8	.3750	16	.2983	5/16	.3125	Q	.3320	W	.3860	X	.3970
		24	.3239	Q	.3320	S	.3480				
		32	.3367	11/32	.3438	T	.3580				
7/16	.4375	14	.3499	U	.3680	25/64	.3906	29/64	.4531	15/32	.4687
		20	.3762	25/64	.3906	13/32	.4062				
		28	.3937	Y	.4040	Z	.4130				
1/2	.5000	13	.4056	27/64	.4219	29/64	.4531	33/64	.5156	17/32	.5312
		20	.4387	29/64	.4531	15/32	.4688				
		28	.4562	15/32	.4688	15/32	.4688				
9/16	.5625	12	.4603	31/64	.4844	33/64	.5156	37/64	.5781	19/32	.5938
		18	.4943	33/64	.5156	17/32	.5312				
		24	.5114	33/64	.5156	17/32	.5312				
5/8	.6250	11	.5135	17/32	.5312	9/16	.5625	41/64	.6406	21/32	.6562
		18	.5568	37/64	.5781	19/32	.5938				
		24	.5739	37/64	.5781	19/32	.5938				
11/16	.6875	24	.6364	41/64	.6406	21/32	.6562	45/64	.7031	23/32	.7188
3/4	.7500	10	.6273	21/32	.6562	11/16	.6875	49/64	.7656	25/32	.7812
		16	.6733	11/16	.6875	45/64	.7031				
		20	.6887	45/64	.7031	23/32	.7188				
13/16	.8125	20	.7512	49/64	.7656	25/32	.7812	53/64	.8281	27/32	.8438
7/8	.8750	9	.7387	49/64	.7656	51/64	.7969	57/64	.8906	29/32	.9062
		14	.7874	13/16	.8125	53/64	.8281				
		20	.8137	53/64	.8281	27/32	.8438				
15/16	.9375	20	.8762	57/64	.8906	29/32	.9062	61/64	.9531	31/32	.9688
1	1.000	8	.8466	7/8	.8750	59/64	.9219	1-1/64	1.0156	1-1/32	1.0313
		12	.8978	15/16	.9375	61/64	.9531				
		20	.9387	61/64	.9531	31/32	.9688				

	PROJECT: QUAKER C600/C605 W600/W605 Casement Windows	BY: TAD DATE: 10/17/23
	PROJECT NO.: Q5070.01-122-34	CKD: ARK SHEET: 20 OF 20

Revision Log

<u>Rev. #</u>	<u>Date</u>	<u>Page(s)</u>	<u>Revision(s)</u>
0	10/17/23	N/A	Original report issue