



1900 NE MIAMI CT. SUITE 2-15, MIAMI, FL 33132

Product Evaluation Report

Of

ODL, Inc.

**Inswing & Outswing Flush Glazed Fiberglass Door
(WZ3) (Impact)**

For

Florida Product Approval

FL# FL47925

Report No. 10215

Current Florida Building Code


Method:	1 – D (Engineering Evaluation)
Category:	Exterior Doors
Sub – Category:	Swinging Exterior Door Assemblies
Product:	Inswing & Outswing Flush Glazed Fiberglass Door (WZ3) (Impact)
Materials:	Fiberglass
Product Dimensions:	See Installation Instructions, ODL008

Prepared for:

**ODL, Inc.
215 East Roosevelt Ave.
Zeeland, Michigan 49464**

Prepared by:

**Hermes F. Norero, P.E.
Florida Professional Engineer #73778
Date: 12/01/2025**

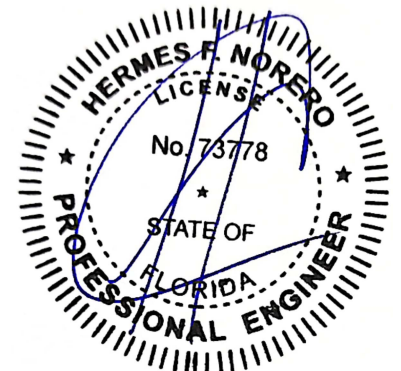

Contents:

Evaluation Report Pages 1 – 4

Hermes F. Norero, P.E.
Florida No. 73778

1900 NE MIAMI CT. SUITE 2-15, MIAMI, FL 33132

Manufacturer: ODL, Inc.
Product Category: Exterior Doors
Product Sub-Category: Swinging Exterior Door Assemblies
Compliance Method: State Product Approval Method (1)(d)
Product Name: Inswing & Outswing Flush Glazed Fiberglass Door (WZ3) (Impact)

Scope: This is a Product Evaluation Report issued by Hermes F. Norero, P.E. (FL # 73778) for **ODL, Inc.** based on Method 1d of the State of Florida Product Approval, Department of Business and Professional Regulation - Florida Building Commission.

Hermes F. Norero, P.E. does not have nor will acquire financial interest in the company manufacturing or distributing the product or in any other entity involved in the approval process of the product named herein.

This product has been evaluated for use in locations adhering to the current Florida Building Code.

See Installation Instructions **ODL008**, signed and sealed by Hermes F. Norero, P.E. (FL # 73778) for specific use parameters.

Limits of Use:

1. This product has been evaluated and is in compliance with the current Florida Building Code, **excluding** the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment into substrate material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection this product complies with Chapter 16 of the current Florida Building Code and **does not require** an impact resistant covering in Wind Zone 3 or less.
4. When used in areas requiring wind borne debris protection this product complies with Chapter 16 of the current Florida Building Code and **does require** an impact resistant covering in Wind Zone 4.
5. Site conditions that deviate from the details of installation instructions **ODL008** require further engineering analysis by a licensed engineer or registered architect.
6. See Installation Instructions **ODL008** for size and design pressure limitations.

1900 NE MIAMI CT. SUITE 2-15, MIAMI, FL 33132

Quality Assurance: The manufacturer has demonstrated compliance of manufacture of products in accordance with the current Florida Building Code for manufacturing under a quality assurance program audited by an approved quality assurance entity through **Keystone Certifications, Inc.** (FBC Organization #QUA1824)

Performance Standards: The product described herein has been evaluated per:

- ASTM E1886-19
- ASTM E1996-20
- ASTM E330-14
- ASTM E331-00
- ASTM E283-04
- TAS 203-94

Referenced Data:

1. Product Testing performed by **IFET, Inc.** (FBC Organization #TST14775)
Report #: TR-IFET-25-0051 Report Date: 09/19/2025
TAS report signed and sealed by Arshad Viqar, P.E. No. 38863
2. Product Testing performed by **Testing Evaluation Laboratories, Inc.** (FBC Organization #TST4317)
Report #: TEL 01313863 Report Date: 08/06/2024
TEL 01313855 07/12/2024
TEL 01313855-A 08/20/2024
TEL 01313855-B 02/03/2025
TEL 01313863A 11/14/2024
3. Quality Assurance
Keystone Certifications, Inc.
(FBC Organization #QUA1824)
4. Material Certification
Miami-Dade County Notice of Acceptance
Eastman Chemical Company
Saflex PVB Interlayer



FL#: FL47925
Date: 12/01/2025
Report No: 10215

1900 NE MIAMI CT. SUITE 2-15, MIAMI, FL 33132

Installation:

Refer to Installation Instructions (**ODL008**) for anchor spacing and more details of the installation requirements.

Design Pressure:

Refer to Installation Instructions (**ODL008**) for design pressures based on size, configuration, and glass types.