

PERFORMANCE TEST REPORT


Rendered to:

GLASSCRAFT DOOR COMPANY

SERIES/MODEL: Buffalo Forge Steel Doors/ Double with Transom
PRODUCT TYPE: LH-A In-swing Double Door with Half-Round Transom

Title	Summary of Results
Uniform Load Deflection Test Pressure	+2715 Pa (+56.70 psf)
Uniform Load Deflection Test Pressure	-3097 Pa (-64.68 psf)
Uniform Load Structural Test Pressure	+4072Pa (+85.05 psf)
Uniform Load Structural Test Pressure	-4645Pa (-97.02 psf)

Secure Electronic Seal
for Electronic Submittal

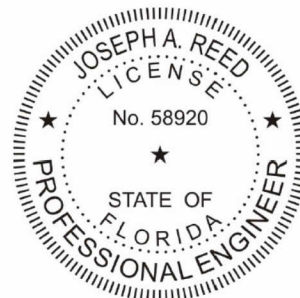

This report contains in its entirety:

Cover Page: 1 page
Report Body: 6 pages
Drawings: 7 pages



Digitally Signed by: Joseph A. Reed

Date: 2010.07.21 10:26:47 -04'00'

Reference should be made to Report No. 72619.01-801-44 for complete test specimen description and data.

PERFORMANCE TEST REPORT

Rendered to:

GLASSCRAFT DOOR COMPANY
2002 Brittmoore Road
Houston, Texas 77043

Report No.: 72619.01-801-44

Revision 2: 07/21/10

Test Date: 04/18/07

Report Date: 06/18/07

**Record Retention End Date: 04/18/11

Project Summary: Architectural Testing, Inc. was contracted by GlassCraft Door Company to perform testing on a Series/Model Buffalo Forge Steel Doors/ Double with Transom, LH-A in-swing double door with half-round transom. Test specimen description and results are reported herein. The sample was provided by the client. Testing was conducted at the Architectural Testing, Inc. laboratory in Southlake, Texas.

Test Method: The test specimen was evaluated in accordance with:

ASTM E 330-02, Test Method for Structural Performance of Exterior Windows, Curtain Walls and Doors by Uniform Static Air Pressure Difference

Test Specimen Description:

Series/Model: Buffalo Forge Steel Doors/ Double with Transom

Product Type: LH-A In-swing Double Door with Half-Round Transom

Overall Size: 1889 mm (74-3/8") wide by 3474 mm (136") high

Transom Size: 1889 mm (74-3/8") wide by 959 mm (37-3/4") high

Transom Daylight Opening Size: 787 mm (31") wide by 1530 mm (60-1/4") high

Leaf Size (2): 914 mm (36") wide by 2438 mm (96") high

Door Daylight Opening Size (2): 572 mm (22-1/2") wide by 2184 mm (86") high

Overall Area: 6.11 m² (65.80 ft²)

Test Specimen Description: (Continued)

Finish: Brown paint

Glazing Details: The insulating glass unit was exterior glazed. It was comprised of two pieces of 1/8" thick tempered pattern glass with a 1/4" air spacer providing 5/8" overall thickness. Butyl tape was located at the exterior and interior with a screw applied steel glazing bead at the interior. Glazing bead screws were located 7" from each corner and 10" on center thereafter.

Weatherstripping:

<u>Description</u>	<u>Quantity</u>	<u>Location</u>
Foam filled vinyl leaf	1 Row	Jambs and head
Adhesive back foam 1/2" by 1/4"	1 Row	Perimeter of vent frame

Frame Construction: The door frame section was constructed of 4-5/8" thick steel jambs, head and transom frame and included an adjustable extruded aluminum threshold. The steel jambs, head and transom frame were welded at each joint. The aluminum threshold was secured to the jambs with three #8 x 3" screws at each end.

Leaf Construction: The door leaf was constructed from steel with a foam core. A glass frame was secured to the door leaf with three barrel hinges and three sweep latches. Sweep latch keepers were welded to the door leaf. A decorative iron grille was secured at the exterior of the unit.

Hardware:

<u>Description</u>	<u>Quantity</u>	<u>Location</u>
Prodeco hinge	4	10" and 68" from the bottom of each leaf
Glass frame hinge	6	12" from each end and the midpoint of each glass frame
Lockset	1	37" from the bottom of the lock stile
Deadbolt	1	43" from the bottom of the lock stile
Flush bolt	2	Top and bottom of the fixed leaf
Sweep latch	6	12" from each end and the midpoint of the glass frame
Sweep latch keeper	6	Door leaf corresponding to each sweep latch

Test Specimen Description: (Continued)

Drainage: Sloped sill

Mullion Construction: The transom sill was secured to the door head with #14 x 2-3/4" screws located 14" from each end and 16" on center thereafter.

Installation: The jambs and transom head were secured to a #2 Yellow Pine test buck with #14 x 3" screws 9" from each corner and 16" on center thereafter.

**Detailed drawings, data sheets, representative samples of test specimens, a copy of this report, or other pertinent project documentation will be retained by Architectural Testing, Inc. for a period of four years from the original test date. At the end of this retention period, such materials shall be discarded without notice and the service life of this report will expire.


Results obtained are tested values and were secured by using the designated test methods. If test specimen contains glazing, no conclusions of any kind regarding the adequacy or inadequacy of the glass in the test specimen can be made. This report does not constitute certification of this product nor an opinion or endorsement by this laboratory. It is the exclusive property of the client so named herein and relates only to the specimen(s) tested. This report may not be reproduced, except in full, without the written approval of Architectural Testing, Inc.

For ARCHITECTURAL TESTING, INC:



Digitally Signed by: Andy Cost

Andy Cost
Laboratory Manager



Digitally Signed by: Joseph A. Reed

Joseph A. Reed, P.E.
Director - Engineering/ Product Testing

AC:aly/cmd

Attachment (pages): This report is complete only when all attachments listed are included.
Appendix-A: Drawings (7)

Revision Log

<u>Rev. #</u>	<u>Date</u>	<u>Page(s)</u>	<u>Revision(s)</u>
0	06/18/07	N/A	Original report issue
1	06/22/07	Cover, 1	Removed Buffalo Forge Milabo from series/ model description Replaced with Buffalo Forge Steel Doors/ Double with Transom
2	07/21/10	1, 5	Replaced Expiration Date wording with Record Retention End Date.

Appendix A

Drawings


Straight top
Double door
w/
Full arch transom




Architectural Testing

Test sample complies with these details.
Deviations are noted.

Report# 72619.01-801-44
Date 6-12-07 Tech Q

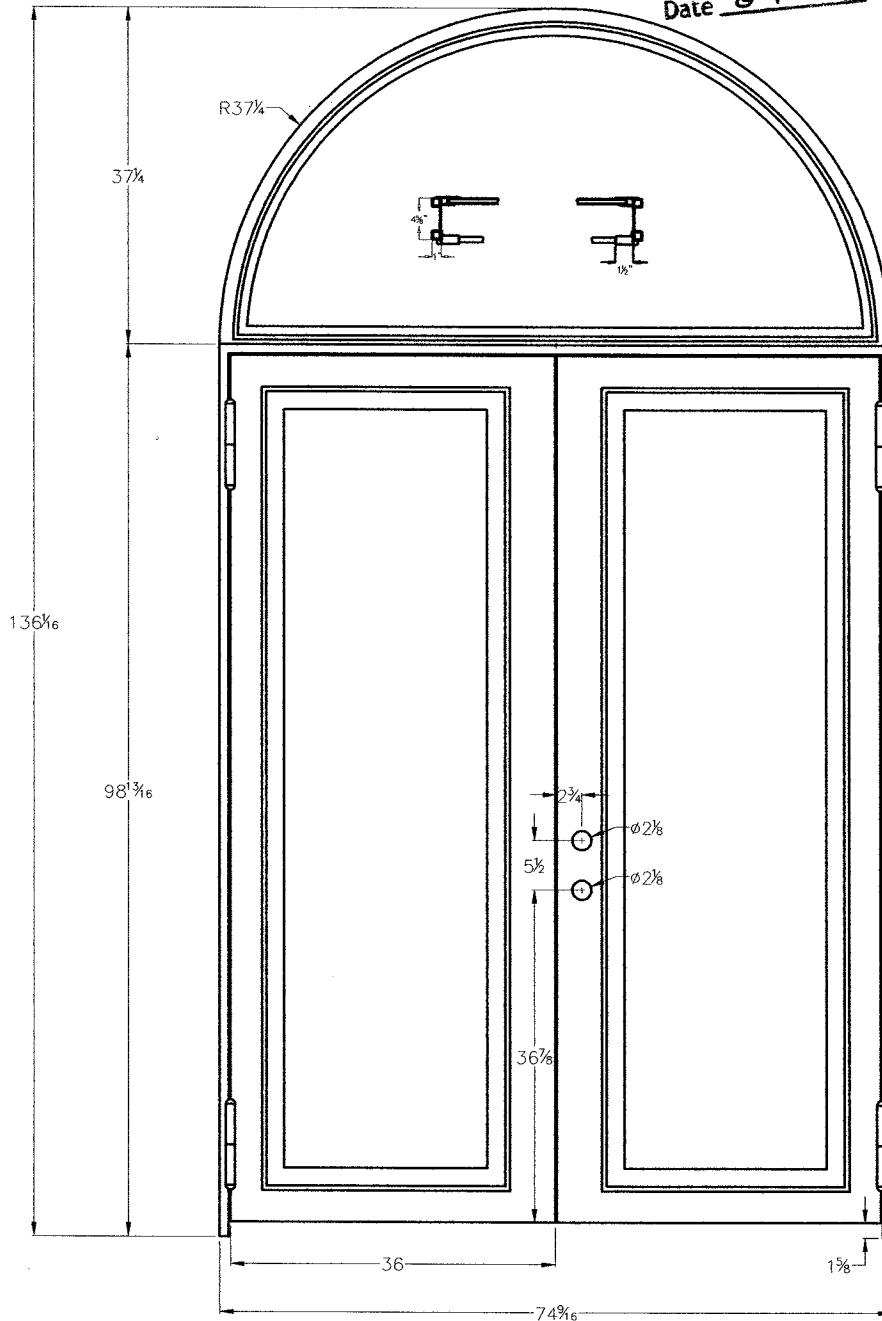

Glass*Craft
Door Company

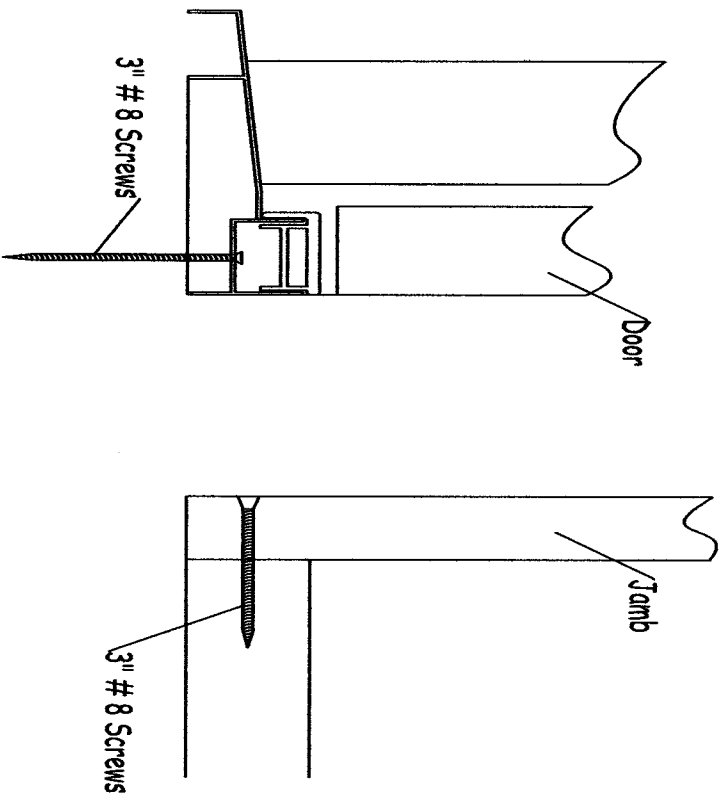

End Section View

Front View

Test sample complies with these details.
Deviations are noted.



Report# TA619.01-801-44


Date 6-12-07

Tech R

Threshold In Swing

Glass*Craft
Door Company

Transom Cross Section

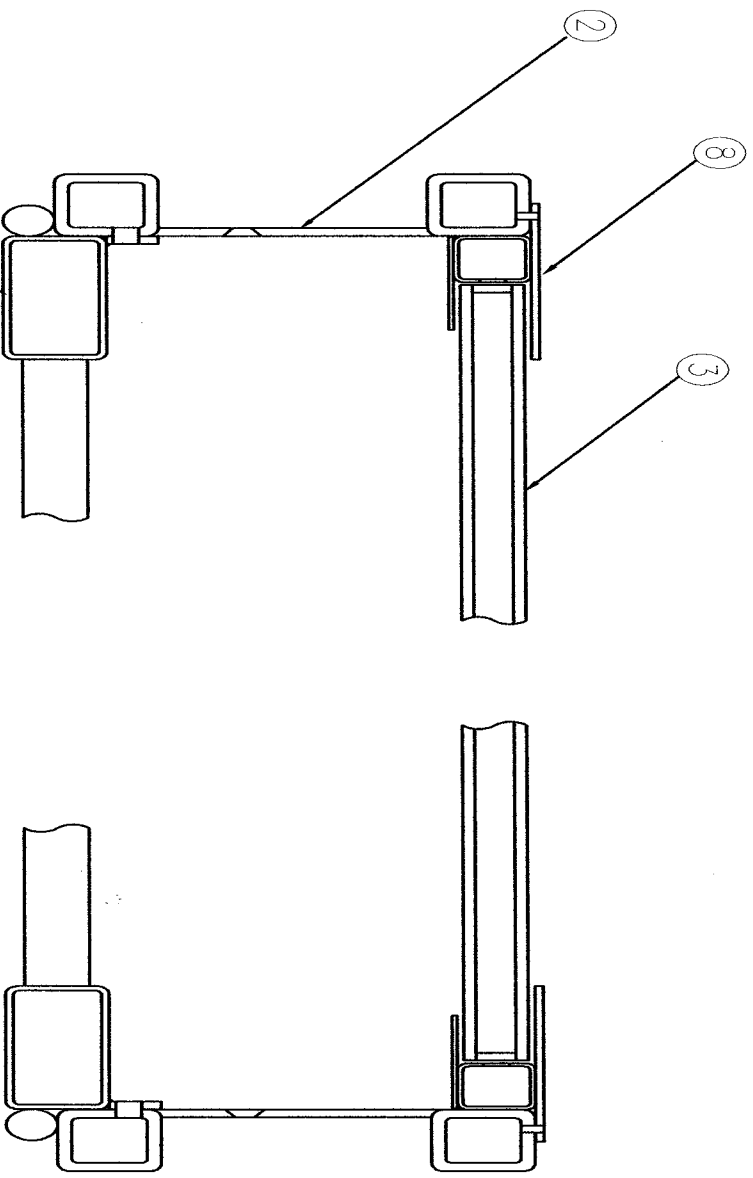

- 2 Sillie
- 3 Glass
- 4 Forge
- 5 Door stop
- 6 Astragal
- 7 Prodeco hinge
- 8 Glass frame
- 9 Forge frame
- 10 Fixed glass stop
- 11 Screwed glass stop



Architectural Testing


Test sample complies with these details.
Deviations are noted.


Report# 72619.01-801

Date 6-12-07 Tech [Signature]

Glass*Craft
Door Company

Door Jam Cross Section

 Architectural Testing
 10000
 122619-01-801-44
 Date 6-12-07 Tech R

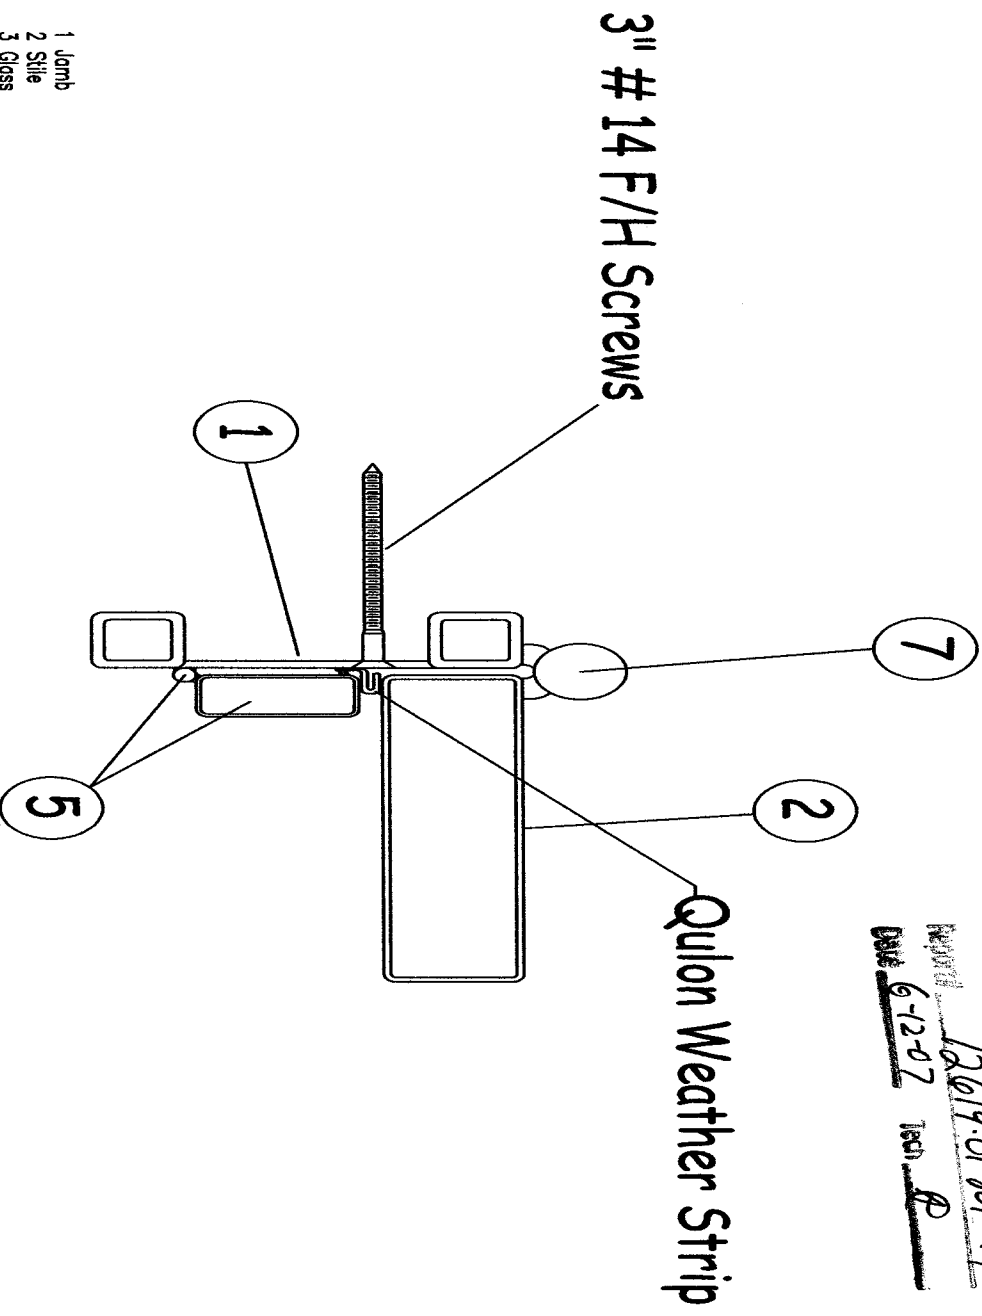

- 1 Jamb
- 2 Stile
- 3 Glass
- 4 Forge
- 5 Door stop
- 6 Astragal
- 7 Prodeco hinge
- 8 Glass frame hinge
- 9 Forge frame
- 10 Fixed glass stop
- 11 Screwed glass stop

Glass*Craft
 Door Company



Architectural Test

Test sample complies with the
Deviations are:

Report# 72619.01-801-44

Date 6-2-07 Initials [Signature]

Z/C FLUSH BOLT

Product code: FB1
Zinc alloy flush bolt with
11" rod.

*Positive "U" joint actuator with 7/8" throw

*1/8" offset with 3/4" backset.

*5/8" adjustment on rod length.

*Round brass tip

*Finish option:

AL: Baked satin aluminum.

DU: Baked duronodic.

BK: Baked black.

Technical Information

